


Infrastructure Master Plan 2024 2024/2025 - 2054/2055

VOLUME 9

uMfolozi System and uMkuze-
uPhongolo-Lake Sibiya System

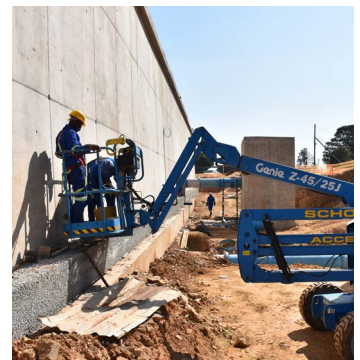

Infrastructure Development Division, uMngeni-uThukela Water

310 Burger Street, Pietermaritzburg, 3201, Republic of South Africa
P.O.Box 9, Pietermaritzburg, 3200, Republic of South Africa
Tel: +27 (33) 341 1111 / Fax: +27 (33) 341 1167 / Toll free: 0800 331 820
Email: info@umngeni.co.za / Web: www.umngeni-uthukela.co.za

To create value for our customers by providing water services at the right quality and quantity, within acceptable levels of reliability and affordability, to support sustainable economic development in KwaZulu-Natal.



For further information, please contact:

Planning Services
Infrastructure Development Division
Umgeni Water

P.O.Box 9, Pietermaritzburg, 3200
KwaZulu-Natal, South Africa

Tel: 033 341-1522
Fax: 033 341-1218
Email: info@umgeni.co.za
Web: www.umgeni-uthukela.co.za




UMNGENI-UTHUKELA WATER

INFRASTRUCTURE MASTER PLAN 2024

2024/2025 – 2054/2055

JUNE 2024

Prepared by:

 Digitally signed by Mark Scott
DN: cn=Mark Scott, o=Umgeni
Water, ou=Planning Services,
email=mark.scott@umgeni.co.za,
c=ZA
Date: 2024.06.25 11:22:14 +02'00'

Mark Scott PrTechEng

Planning Engineer

 Digitally signed by
Mlungisi Shabalala
Date: 2024.06.25
12:53:32 +02'00'

Mlungisi Shabalala PrSciNat


Hydrologist

Approved by:

 Digitally signed by
Kevin Meier
Date: 2024.06.25
15:46:23 +02'00'

Kevin Meier PrEng

Manager: Planning Services

 Digitally signed by Alan Kockott
DN: cn=Alan Kockott, o=Umgeni-
uThukela Water, ou=Engineering
Services,
email=alan.kockott@umgeni.co.za, c=ZA
Date: 2024.06.27 08:29:22 +02'00'

Alan Kockott PrEng

Acting Executive: Infrastructure Development

PREFACE

This Infrastructure Master Plan 2024 describes:

- uMngeni-uThukela Water's infrastructure plans for the financial period 2024/2025 – 2054/2055, and
- Infrastructure master plans for other areas outside of uMngeni-uThukela Water's Operating Area but within KwaZulu-Natal.

It is a comprehensive technical report that provides information on current infrastructure and on future infrastructure development plans. This report replaces the last comprehensive Infrastructure Master Plan that was compiled in 2023.

The report is divided into **ten** volumes as per the organogram below.


Volume 1 includes the following sections and a description of each is provided below:

- **Section 2** describes the most recent changes and trends within the primary environmental dictates that influence development plans within the province.
- **Section 3** relates only to the uMngeni-uThukela Water Operational Areas and provides a review of historic water sales against past projections, as well as uMngeni-uThukela Water's most recent water demand projections, compiled at the end of 2023.
- **Section 4** describes Water Demand Management initiatives that are being undertaken by the utility and the status of Water Demand Management Issues in KwaZulu-Natal.
- **Section 5**, which also relates to uMngeni-uThukela Water's Operational Area, contains a high level review of the energy consumption used to produce the water volumes analysed in Section 3.
- **Section 6** provides an overview of the water resource regions and systems supplied within these regions.

The next eight volumes describe the current water resource situation and water supply infrastructure of the various systems in KwaZulu-Natal, including:

- **Volume 2 Section 7** uMngeni System.
- **Volume 3 Section 8** uMkhomazi System
- **Section 9** uMzimkhulu System
- **Section 10** Mzintlava System
- **Volume 4 Section 11** South Coast System
- **Volume 5 Section 12** North Coast System
- **Volume 6 Section 13** Upper uThukela System
- **Volume 7 Section 14** Buffalo System
- **Volume 8 Section 15** Middle uThukela System
- **Section 16** Mhlathuze System
- **Volume 9 Section 17** Umfolozi System
- **Section 18** uMkhuze / uPhongolo / Lake Sibiya System

Volume 10, Section 19 describes the wastewater works currently operated by uMngeni-uThukela Water (shown in pale brown in the adjacent figure) and provides plans for development of additional wastewater treatment facilities. The status of wastewater treatment in WSA's that are not supplied by uMngeni-uThukela Water are also described in this section.

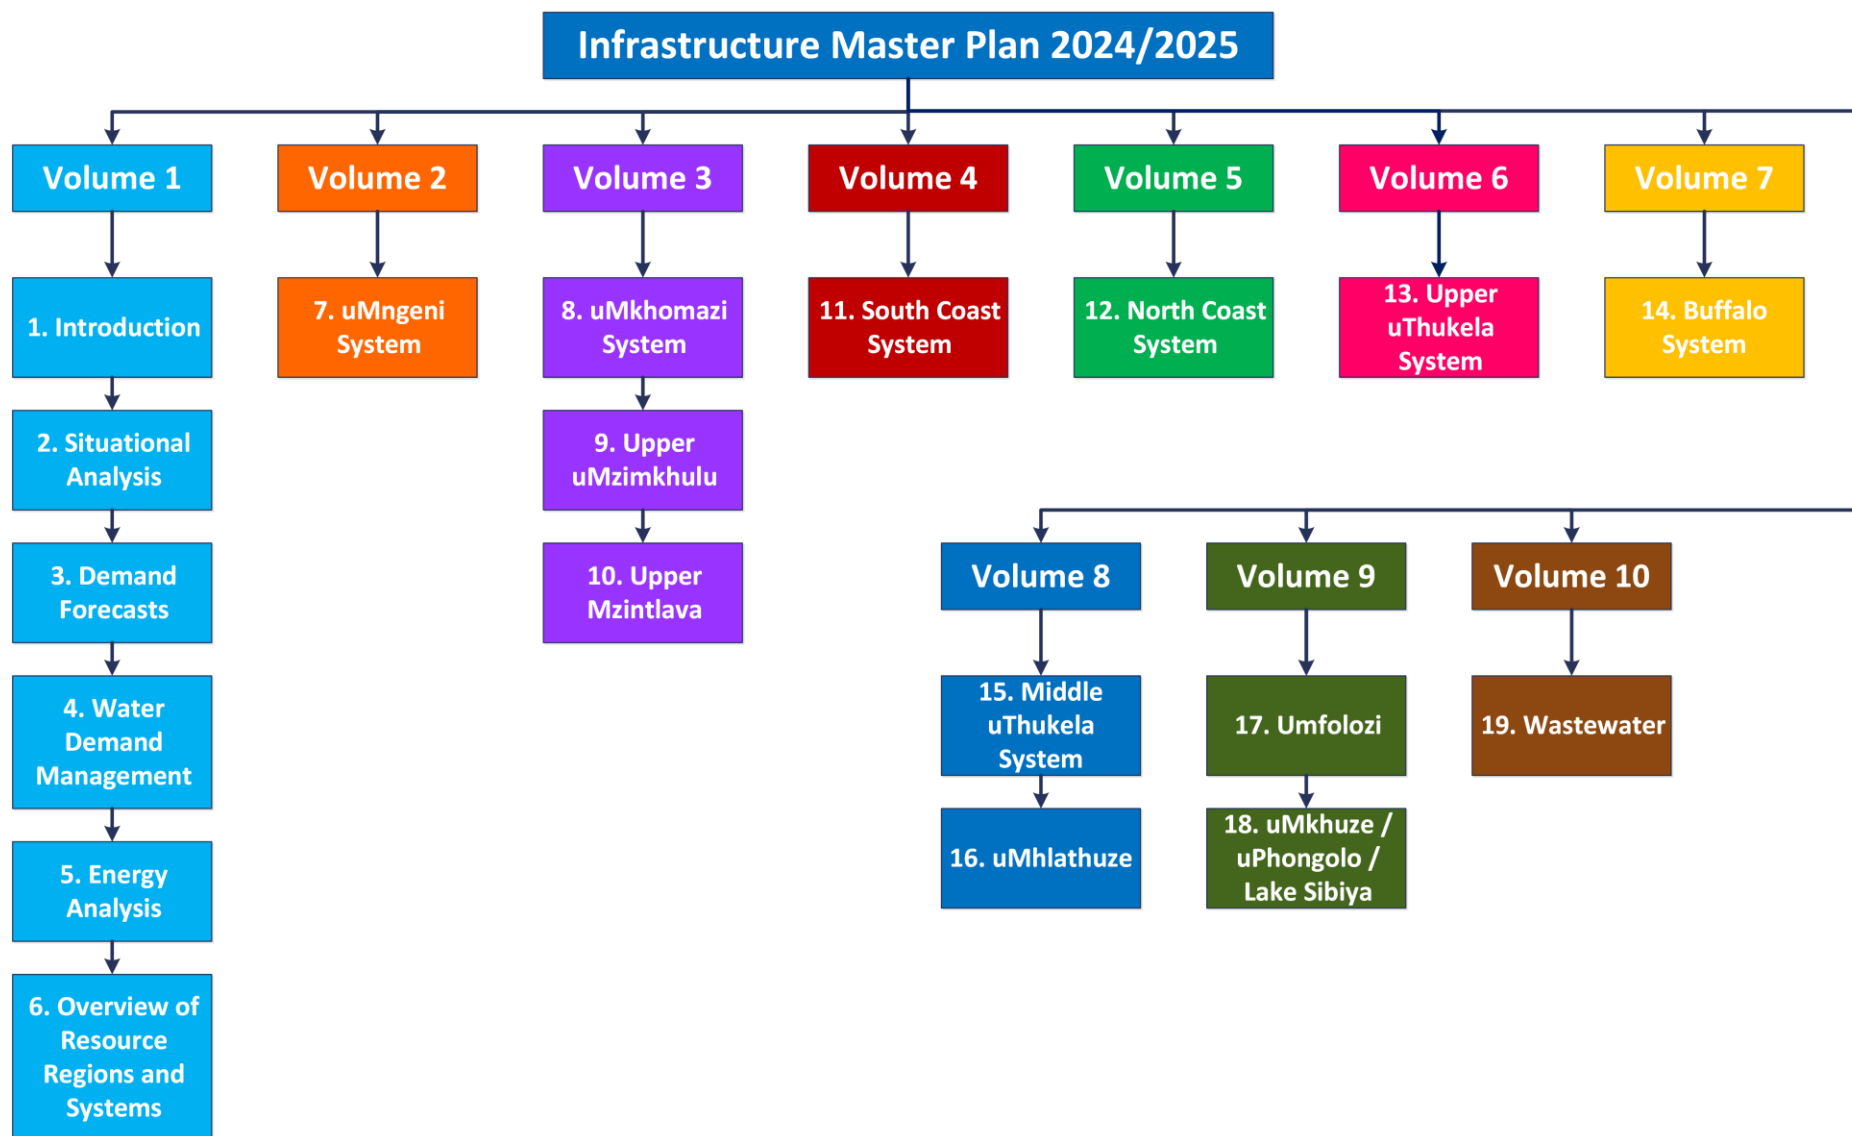

It is important to note that information presented in this report is in a summarised form and it is recommended that the reader refer to relevant planning reports if more detail is sought. Since the primary focus of this Infrastructure Master Plan is on bulk supply networks, the water resource infrastructure development plans are not discussed at length. The Department of Water and Sanitation (DWS), as the responsible authority, has undertaken the regional water resource development investigations. All of these investigations have been conducted in close collaboration with uMngeni-uThukela Water and other major stakeholders in order to ensure that integrated planning occurs. Details on these projects can be obtained directly from DWS, Directorate: Options Analysis (East).

The Infrastructure Master Plan is a dynamic and evolving document. Outputs from current planning studies, and comments received on this document will therefore be taken into account in the preparation of the next update.

TABLE OF CONTENTS

Preface	i
Table of Contents.....	iv
List of Figures	vi
List of Tables	viii
List of Acronyms.....	xi
List of Units	xiv
17. Mfolozi System	15
17.1 Synopsis of the uMfolozi System.....	15
17.2 Water Resources of the uMfolozi System	18
17.2.1 Description of the uMfolozi System Water Resource Region.....	18
17.2.2 Reserve	25
17.2.3 Existing Water Resource Infrastructure and Yields.....	26
17.2.4 Operating Rules	34
17.3 Supply Systems	39
17.3.1 Description of the uMfolozi System.....	39
17.3.2 Status Quo and Limitations of the uMfolozi System.....	75
17.4 Water Balance/Availability.....	77
17.5 Recommendations for the uMfolozi System.....	78
17.5.1 System Components	78
18. uMkhuze / uPhongolo / Lake Sibaya System.....	85
18.1 Synopsis	85
18.1.1 Water Resources.....	85
18.1.2 Reserve.....	104
18.1.3 Existing Water Resource Infrastructure and Yields	106
18.1.4 Operating Rules	112
18.2 Supply Systems	116
18.2.1 Description of the uMkhuze, Uphongolo and Lake Sibaya Water Supply Systems	116
18.2.2 uMkhuze Water Supply Supply	116
18.2.3 Hlobane/Coronation Water Supply System.....	121
18.2.4 Description of the uPhongolo System.....	126
18.2.5 Simdlangentsha Central Regional Bulk Water Supply Scheme (Belgrade BWSS)	138
18.2.6 Simdlangentsha East Regional Bulk Water Supply Scheme (Spekboom BWSS, uPhongolo BWSS).....	143
18.2.7 Mjindi Water Treatment Supply System (0.35 Ml/day)	154
18.2.8 Nondebuya Water Treatment Supply System.....	158
18.2.9 Othobothini Water Treatment Supply System.....	162
18.2.10 Jozini Water Treatment Supply System (Old & New).....	167
18.2.11 Shemula Water Treatment Supply System	174
18.3 Status Quo and Limitations	180
18.3.1 Hlobane/Coronation Supply System	180
18.3.2 uMkhuze Supply System	180
18.3.3 Simdlangentsha West RBWSS	181
18.3.4 Simdlangentsha Central RBWSS.....	182
18.3.5 Simdlangentsha East RBWSS.....	182
18.4 Water Balance/Availability.....	184
18.4.1 uMkhuze Water Supply System	184
18.4.2 uPhongolo Water Supply System.....	185
18.4.3 Lake Sibaya Water Supply Area.....	186

18.5	Recommendations.....	187
18.5.1	Simdlangentsha West Regional Bulk Water Supply Scheme (Frischgewaagd BWSS, Edumbe BWSS).....	187
18.5.2	Simdlangentsha Central Regional Bulk Water Supply Scheme (Belgrade BWSS)	187
18.5.3	Simdlangentsha East Regional Bulk Water Supply Scheme (Spekboom and Phongola WTP's Supply Systems)	188
18.5.4	Lake Sibaya and Mkhuze System.....	188
	References	190
	Acknowledgements.....	I

LIST OF FIGURES

Figure 17.1	General layout of the uMfolozi System (MDB 2020, UUW IMP 2024).	17
Figure 17.2	General layout of the uMfolozi region (DEFF 2020, MDB 2020, uMngeni-uThukela Water 2024, WR2012).	21
Figure 17.3	Groundwater potential in the uMfolozi Region (MDB 2020, uMngeni-uThukela Water 2024, after DWAF 1997 and WR2012).	24
Figure 17.4	Klipfontein Dam (https://vryheidherald.co.za)	28
Figure 17.5	Bloemveld Dam (Northern Natal News 2013: website)	29
Figure 17.6	Grootgewacht Dam (DWA, 2015)	30
Figure 17.7	Ulundi Balancing Weir (Google Earth 2020)	31
Figure 17.8	Vuna Dam (The Siyasiza Trust Facebook Photo upload: 2015)	32
Figure 17.9	Vokwana Dam (Google Earth 2020).	33
Figure 17.10	Mvunyana Dam (Google Earth 2020)	34
Figure 17.11	Drought operating rule for Grootgewacht & Bloemveld sub-system (Vryheid supply) – May decision month (DWS, 2013).	36
Figure 17.12	Drought operating rule for Klipfontein Dam (Vryheid supply) – May decision month (DWS, 2022)	37
Figure 17.13	Drought operating rule for Mvunyane Dam–May decision month (DWS, 2022).	38
Figure 17.14	Drought operating rule for Vokwana Dam–May decision month (DWS, 2013)	39
Figure 17.15	Local Municipalities in Zululand District	40
Figure 17.16	Aerial view of the weir and Ulundi Water Treatment Plant.	41
Figure 17.17	Aerial view of the Nkonjeni Dam and Nkonjeni Water Treatment Plant	44
Figure 17.18	Schematic layout of the Ulundi WTP Supply System	45
Figure 17.19	An Aerial view of the Mpungamhlope WTP (Google Earth 2020: website).	49
Figure 17.20	Schematic of the Mpungamhlope Supply System	51
Figure 17.21	An Aerial view of the Usuthu WTP (Google Earth 2020: website).	53
Figure 17.22	Schematic of the Usuthu Supply System	55
Figure 17.23	An Aerial view of the Vuna WTP and the Vuna Dam (Google Earth 2020: website).	59
Figure 17.24	An Aerial view of the Embile WTP and the Embile Dam (Google Earth 2020: website).	60
Figure 17.25	Schematic of the Vuna/Embile Supply System	62
Figure 17.26	An Aerial view of the Bloemveld WTP (Google Earth 2020: website).	65
Figure 17.27	An Aerial view of the Klipfontein WTP (Google Earth 2020: website).	66
Figure 17.28	Schematic of the Vryheid Supply System	68
Figure 17.29	An Aerial view of the Mondlo WTP (Google Earth 2020: website).	71
Figure 17.30	Schematic of the eMondlo Supply System	73
Figure 17.31	General layout of the uPhongolo System (MDB 2020).	87
Figure 17.32	General layout of the uMkhuze System (MDB 2020).	88
Figure 17.33	General Layout of the uMkhuze Region (DEFF 2020, MDB 2020, Umgeni Water 2022, WR2012).	92
Figure 17.34	General Layout of the uPhongolo Region (DEFF 2020, MDB 2020, Umgeni Water 2022, WR2012).	93
Figure 17.35	General layout of Lake Sibayi System (DEFF 2020, MDB 2020, Umgeni Water 2022, WR2012).	94
Figure 17.36	Groundwater potential in the uMkhuze Region (MDB 2020, Umgeni Water 2021, after DWAF 1997 and WR2012).	101
Figure 17.37	Groundwater potential in the Phongola Water Resource Region (MDB 2020, Umgeni Water 2022, after DWAF 1997 and WR2012).	102

Figure 17.38	Groundwater potential in the Lake Sibaya Water Resource Region (MDB 2020, Umgeni Water 2022, after DWAF 1997 and WR2012).	103
Figure 17.39	Hluhluwe Dam (DWS, 2016)	107
Figure 17.40	Bivane Dam - Source (http://www.bestfishingspots.co.za/dam).....	109
Figure 17.41	Pongolapoort Dam (https://www.royaljozini.com/pongolapoort-dam-some-history/)	110
Figure 17.42	Lake Sibayi (https://infrastructurenews.co.za)	112
Figure 17.43	Hluhluwe Dam Drought Operating Rules (DWS, 2022).	113
Figure 17.44	Restriction Rule for Domestic supply from the Pongolapoort Dam (DWS, 2021).	114
Figure 17.45	uMkhuze WTP ((Google Earth 2020: website).....	117
Figure 17.46	Layout of uMkhuze WTP Supply System	119
Figure 17.47	Aerial View of the Hlobane WTP (Google Earth 2020: website).	122
Figure 17.48	Hlobane WTP (Google Earth 2020: website).	122
Figure 17.49	Aerial view of Coronation WTP (Google Earth 2020: website).....	123
Figure 17.50	Schematic of the Hlobane/Coronation Supply System.....	124
Figure 17.51	Local Municipalities in Zululand District (unknown source).	127
Figure 17.52	Aerial view of Edumbe Water Treatment Plant (Google Earth 2020: website).	128
Figure 17.53	Schematic of the Edumbe Supply System.....	130
Figure 17.54	Aerial view of Frischgewaagd Water Treatment Plant (Google Earth 2020: website).	133
Figure 17.55	Schematic of Frischgewaagd WTP Supply System.....	135
Figure 17.56	Aerial view of Belgrade Water Treatment Plant (Google Earth 2020: website).....	138
Figure 17.57	Schematic of Belgrade WTP Supply System	140
Figure 17.58	Aerial view of Spekboom Water Treatment Plant (Google Earth 2020: website).....	143
Figure 17.59	Schematic of Spekboom WTP Supply System.....	145
Figure 17.60	Aerial view of Phongola Water Treatment Plant	148
Figure 17.61	Schematic of Phongola WTP Supply System.....	150
Figure 17.62	Aerial view of Mjindi Water Treatment Plant (Unknown source).	154
Figure 17.63	Schematic of Mjindi WTP Supply System	156
Figure 17.64	Aerial view of Nondebuya Water Treatment Plant & Nondabuya Reservoirs (unknown source).	158
Figure 17.65	Schematic of Nondebuya WTP Supply System	160
Figure 17.66	shows an aerial view of the Othobothini WTP (unknown source).	162
Figure 17.67	Schematic of Othobothini WTP Supply System	164
Figure 17.68	Aerial view of Jozini Old Water Treatment Plant (Google Earth 2020: website).....	167
Figure 17.69	Aerial view of Jozini New Water Treatment Plant (unknown source).....	168
Figure 17.70	Aerial view of Jozini Reservoir (unknown source).	168
Figure 17.71	Schematic of Jozini WTP Supply System	171
Figure 17.72	Schematic of Jozini WTP Supply System	172
Figure 17.73	Aerial view of the Shemula (Old) WTP (unknown source).	174
Figure 17.74	Aerial view of Shemula New Water Treatment Plant (Google Earth 2020: website)..	175
Figure 17.75	Schematic showing the Shemula Supply System.....	177
Figure 17.76	Construction of new 15 Mℓ /day WTP at Frischgewaagd along the Phongola River (Google Earth 2020: website).	181
Figure 17.77	Aerial view of Regional Water Treatment Plant (NEW) (unknown source).	183

LIST OF TABLES

Table 17.1	Hydrological characteristics of the uMfolozi Region (WR2012: Usutu-Mhlathuze Quat Info WMA 6 7Jul2015 spreadsheet).....	20
Table 17.2	The yield of major dams in the White uMfolozi catchment (DWS, 2022).	27
Table 17.3	Characteristics of Klipfontein Dam (DWS 2018: Hydrographic Surveys Dams Database, DWS 2019: List of Registered Dams Database, WR2012).....	28
Table 17.4	Bloemveld Dam (DWS 2018: Hydrographic Surveys Dams Database, DWS 2019: List of Registered Dams Database, WR2012)	29
Table 17.5	Grootgewacht Dam (DWS 2019: List of Registered Dams Database, WR2012)	30
Table 17.6	Ulundi Weir (DWS 2019: List of Registered Dams Database, WR2012)	31
Table 17.7	Vuna Dam (DWS 2019: List of Registered Dams Database, WR2012)	32
Table 17.8	Vokwana Dam (DWS 2019: List of Registered Dams Database, WR2012).	33
Table 17.9	Characteristics of the Ulundi/Nkonjeni WTP's.	43
Table 17.10	Pump details: Ulundi/Nkonjeni Supply System	46
Table 17.11	Reservoir details: Ulundi/Nkonjeni RBWSS.	47
Table 17.12	Pipeline details: Ulundi/Nkonjeni RBWSS.....	48
Table 17.13	Characteristics of the Mpungamhlope WTP.....	50
Table 17.14	Pump details: Mpungamhlope Supply System	52
Table 17.15	Reservoir details: Mpungamhlope BWSS.	52
Table 17.16	Pipeline details: Mpungamhlope BWSS.....	52
Table 17.17	Characteristics of the Usuthu/Enyonkeni WTP's.	54
Table 17.18	Pump details: Usuthu Supply System	56
Table 17.19	Reservoir details: Usuthu BWSS.	57
Table 17.20	Pipeline details: Usuthu BWSS.....	58
Table 17.21	Characteristics of the Vuna/EmBILE WTP's.	61
Table 17.22	Pump details: Vuna/EmBILE Supply System	63
Table 17.23	Reservoir details: Vuna/EmBILE BWSS.	63
Table 17.24	Pipeline details: Vuna/EmBILE BWSS.....	64
Table 17.25	Characteristics of the Bloemveld/Klipfontein WTP's.....	67
Table 17.26	Pump details: Vryheid Supply System	69
Table 17.27	Reservoir details: Vryheid BWSS.....	69
Table 17.28	Pipeline details: Vryheid BWSS.	70
Table 17.29	Characteristics of the eMondlo WTP.	72
Table 17.30	Pump details: eMondlo Supply System	74
Table 17.31	Reservoir details: eMondlo BWSS.	74
Table 17.32	Pipeline details: eMondlo BWSS.....	74
Table 17.33	Water balance - Water availability in the uMfolozi System for year 2000 (Zululand DM WSDP, 2004).	77
Table 17.34	Proposed Regional Water Schemes in the Zululand District Municipality	79
Table 17.35	Hydrological characteristics of the uMkhuze Region (WR2012: Usutu-Mhlathuze Quat Info WMA 6 7Jul2015 spreadsheet).....	95
Table 17.36	Hydrological characteristics of uPhongolo Region (WR2012: Usutu-Mhlathuze Quat Info WMA 6 7Jul2015 spreadsheet).....	95
Table 17.37	Lake Sibaya Hydrological Characteristics (WR2012: Usutu-Mhlathuze Quat Info WMA 6 7Jul2015 spreadsheet).....	95
Table 17.38	Hluhluwe Dam (DWS 2018: Hydrographic Surveys Dams Database, DWS 2019: List of Registered Dams Database, WR2012).	107
Table 17.39	Hluhluwe Dam Yields (DWS, 2022).	108
Table 17.40	Characteristics of Bivane Dam	109

Table 17.41	Characteristics of Pongolapoort Dam.....	111
Table 17.42	Pongolapoort Dam Short term yields (DWS, 2018).	114
Table 17.43	Lake Sibayi water levels	115
Table 17.44	Characteristics of the uMkhuze WTP.....	118
Table 17.45	Pump Details.....	120
Table 17.46	Pipeline Details	120
Table 17.47	Reservoir Details.....	121
Table 17.48	Characteristics of the Hlobane/Coronation WTP's.....	124
Table 17.49	Pump Details.....	125
Table 17.50	Pipeline Details	125
Table 17.51	Reservoir Details.....	126
Table 17.52	Characteristics of the Edumbe WTP.	129
Table 17.53	Pump details: Edumbe Supply System.....	131
Table 17.54	Reservoir details: Edumbe BWSS.....	131
Table 17.55	Pipeline details: Edumbe BWSS.	132
Table 17.56	Characteristics of the Frischgewaagd WTP.....	134
Table 17.57	Pump details: Frischgewaagd Supply System	136
Table 17.58	Reservoir details: Frischgewaagd BWSS.	136
Table 17.59	Pipeline details: Frischgewaagd BWSS.	137
Table 17.60	Characteristics of the Belgrade WTP.	139
Table 17.61	Pump details: Belgrade Supply System.....	141
Table 17.62	Reservoir details: Belgrade BWSS.....	141
Table 17.63	Pipeline details: Belgrade BWSS.	142
Table 17.64	Characteristics of the Spekboom WTP.	144
Table 17.65	Pump details: Spekboom Supply System.....	146
Table 17.66	Reservoir details: Spekboom BWSS.	146
Table 17.67	Pipeline details: Spekboom BWSS.	147
Table 17.68	Characteristics of the Phongola WTP.	149
Table 17.69	Pump details: Phongola Supply System.....	151
Table 17.70	Reservoir details: Phongola BWSS.....	152
Table 17.71	Pipeline details: Phongola BWSS.	153
Table 17.72	Characteristics of the Mjindi WTP.	155
Table 17.73	Mjindi Pump Details.....	157
Table 17.74	Mjindi Pipeline Details	157
Table 17.75	Mjindi Reservoir Details.....	157
Table 17.76	Characteristics of the Nondebuya WTP.....	159
Table 17.77	Nondebuya Pipeline Details.....	161
Table 17.78	Nondebuya Reservoir Details	161
Table 17.79	Characteristics of the Othobothini WTP.....	163
Table 17.80	Othobothini Pump Details	165
Table 17.81	Othobothini Pipeline Details.....	165
Table 17.82	Othobothini Reservoir Details	166
Table 17.83	Characteristics of the Jozini OLD WTP.	169
Table 17.84	Characteristics of the Jozini NEW WTP.....	170
Table 17.85	Jozini Pump Details	173
Table 17.86	Jozini Pipeline Details.....	173
Table 17.87	Jozini Reservoir Details	173
Table 17.88	Characteristics of the Shemula NEW WTP.....	176
Table 17.89	Shemula Pump Details	178
Table 17.90	Shemula Pipeline Details	178
Table 17.91	Shemula Reservoir Details	179

Table 17.92	Water Balance – Water availability in UMkhuze System for year 2000 (ZDM WSDP,2004)	184
Table 17.93	uMkhuze Catchment Water Balance (Mhlathuze Water, 2016)	185
Table 17.94	Water balance - Water availability in uPhongolo System (ZD WSDP, 2004)	186

LIST OF ACRONYMS

AADD	Annual Average Daily Demand
AC	Asbestos Cement
ADWF	Average Dry Weather Flow
API	Antecedent Precipitation Index
AVGF	Autonomous Valveless Gravity Filter
BID	Background Information Document
BPT	Break Pressure Tank
BWL	Bottom Water Level
BWSP	Bulk Water Services Provider
BWSS	Bulk Water Supply Scheme
CAPEX	Capital Expenditure
CMA	Catchment Management Agency
CoGTA	Department of Co-operative Governance and Traditional Affairs
CWSS	Community Water Supply and Sanitation project
DAEA	Department of Agriculture and Environmental Affairs
DEA	Department of Environmental Affairs
DEFF	Department of Environment, Forestry and Fisheries
DM	District Municipality
DRDLR	Department of Rural Development and Land Reform
DWA	Department of Water Affairs
DWS	Department of Water and Sanitation
DWAF	Department of Water Affairs and Forestry
EFR	Estuarine Flow Requirements
EIA	Environmental Impact Assessment
EKZN Wildlife	Ezemvelo KZN Wildlife
EMP	Environmental Management Plan
EWS	eThekwin Water Services
EXCO	Executive Committee
FC	Fibre Cement
FL	Floor level
FSL	Full Supply level
GCM	General Circulation Model
GDP	Gross Domestic Product
GDPR	Gross Domestic Product of Region
GVA	Gross Value Added
HDI	Human Development Index
IDP	Integrated Development Plan
IFR	In-stream Flow Requirements
IMP	Infrastructure Master Plan
IRP	Integrated Resource Plan

ISP	Internal Strategic Perspective
IWRM	Integrated Water Resources Management
KZN	KwaZulu-Natal
LM	Local Municipality
LUMS	Land Use Management System
MA	Moving Average
MAP	Mean Annual Precipitation
MAR	Mean Annual Runoff
MBR	Membrane Bioreactor
MMTS	Mooi-uMngeni Transfer Scheme
MMTS-1	Mooi-uMngeni Transfer Scheme Phase 1
MMTS-2	Mooi-uMngeni Transfer Scheme Phase 2
mPVC	Modified Polyvinyl Chloride
MTEF	Medium-Term Expenditure Framework
MTSF	Medium-Term Strategic Framework
MWP	Mkomazi Water Project
MWP-1	Mkomazi Water Project Phase 1
NCP-1	North Coast Pipeline I
NCP-2	North Coast Pipeline II
NCSS	North Coast Supply System
NGS	Natal Group Sandstone
NPV	Net Present Value
NRW	Non-Revenue Water
NSDP	National Spatial Development Perspective
NWSP	National Water Sector Plan
OPEX	Operating Expenditure
p.a.	Per annum
PES	Present Ecological Status
PEST	Political, Economical, Sociological and Technological
PGDS	Provincial Growth and Development Strategy
PPDC	Provincial Planning and Development Commission (KZN's)
PSEDS	Provincial Spatial Economic Development Strategy
PWSP	Provincial Water Sector Plan
RDP	Reconstruction and Development Programme
RO	Reverse Osmosis
ROD	Record of Decision
RQO	Resource Quality Objective
SCA	South Coast Augmentation
SCP	South Coast Pipeline
SCP-1	South Coast Pipeline Phase 1
SCP-2a	South Coast Pipeline Phase 2a
SCP-2b	South Coast Pipeline Phase 2b

SDF	Spatial Development Framework
SHR	St Helen's Rock (near Port Shepstone)
STEEPLE	Social/demographic, Technological, Economic, Environmental (Natural), Political, Legal and Ethical
SWRO	Seawater Reverse Osmosis
TEC	Target Ecological Category
TWL	Top Water Level
uPVC	Unplasticised Polyvinyl Chloride
UUW	uMngeni-uThukela Water
WA	Western Aqueduct
WC	Water Conservation
WDM	Water Demand Management
WMA	Water Management Area
WRC	Water Research Commission
WSA	Water Services Authority
WSDP	Water Services Development Plan
WSNIS	Water Services National Information System
WSP	Water Services Provider
WTP	Water Treatment Plant
WWW	Wastewater Works

Spellings of toponyms have been obtained from the Department of Arts and Culture (DAC). DAC provides the official spelling of place names and the spellings, together with the relevant gazette numbers, can be accessed at <http://www.dac.gov.za/content/toponymic-guidelines-map-and-other-editors>.

When using any part of this report as a reference, please cite as follows:

uMngeni-uThukela Water, 2024. uMngeni-uThukela Water Infrastructure Master Plan 2024/2025 – 2054/55, Vol 1 - 10. Prepared by Planning Services, June 2024.

LIST OF UNITS

Length/Distance:	mm	millimetre
	m	metre
	km	kilometre
Area:	m ²	square metres
	ha	hectare
	km ²	square kilometres
Level/Altitude:	mASL	metres above sea-level
Time:	s	second
	min	minute
	hr	hour
Volume:	m ³	cubic metres
	Mℓ	megalitre
	million m ³	million cubic metres
	mcm	million cubic metres
Water Use/Consumption/Treatment/Yield:	ℓ/c/day	litre per capita per day
	kℓ/day	kilolitre per day
	Mℓ/day	megalitre per day
	million m ³ /annum	million cubic metres per annum
	kg/hr	kilograms per hour
Flow velocity/speed:	m/s	metres per second
Flow:	m ³ /s	cubic metres per second
	ℓ/hr	litres per hour
	m ³ /hr	cubic metres per hour

17. MFOLOZI SYSTEM

17.1 Synopsis of the uMfolozi System

The uMfolozi Water Resource Region (Secondary Catchment W2) comprises of the White (Tertiary Catchment W21) and the Black uMfolozi Rivers (Tertiary Catchment W22), as well as the uMfolozi River (Tertiary Catchment W23) following the confluence of the Black and White uMfolozi Rivers on the south-eastern boundary of the Hluhluwe-Umfolozi Park. From the confluence, the uMfolozi River meanders in a south-easterly direction towards Mtubatuba, from where it flows north-east towards the St Lucia estuary and the Indian Ocean. Significant towns in the catchment include Vryheid, Mondlo, Ulundi, Babanango, Nongoma and Mtubatuba (**Figure 17.1**).

The uMfolozi River covers the Zululand and uMkhanyakude District Municipalities. These DMs play both the role of Water Services Providers and Water Services Authorities in their respective areas of jurisdiction. This region remains one of the most under-serviced areas in the KwaZulu-Natal (KZN) province, with a significant portion of the population still lacking adequate water supply (UUW, 2021). Major water resources infrastructure in the uMfolozi System include:

- The Klipfontein Dam (18.1 million m³), which is the largest water resource infrastructure in this river system, situated in the upper reaches of the White uMfolozi River. The dam was constructed to supply water to the town of Vryheid and is also used to increase the water supply to Ulundi if necessary. Over the years, Vryheid's dependence on Klipfontein Dam has increased due to the rising water demands. There is an option to raise the dam wall to ensure that supply from the dam is able to meet the growing water requirements from Vryheid and surrounding areas.
- The Bloemveld Dam (2.27 million m³) and the Grootgewagen Dam (1.14 million m³). Although these dams were developed for industrial purposes, they are also used to supplement domestic water supply to Vryheid and surrounding areas.
- The Mvunyane Dam, in the Mvunyane River near Mondlo, which supplies water to Mondlo and surrounding areas. However, the Mvunyane Dam is significantly silted and requires the implementation of efficient operating rules to avoid total supply failure (UUW, 2021).
- The Ulundi abstraction weir in the White uMfolozi River, south of Ulundi, which supplies water to Ulundi town and surrounding areas. The weir is gated and the gate is opened during high flows- (summer) and closed during low flows (winter).
- The Vuna Dam on the Vuna River, east of Nongoma town, which supplies water to Nongoma and surrounding areas.
- Water transfer from the lower uMfolozi into the Mhlathuze system for industrial supply, mainly Richards Bay Minerals, just before the uMfolozi River flows into the Indian Ocean.

The water resources of the Black uMfolozi catchments are not secured and do not have an assured yield since the catchment is mostly undeveloped and underutilised. The annual estimates on water resources and the water requirements obscure the seasonal distribution. The run-of-river yield is completely different in the summer months when compared with the winter months for the same level of assurance of supply. Irrigation requirements can also have a strong seasonal variation, as does the environmental reserve. A reconciliation strategy study that includes the Usuthu Water Scheme, with estimated water requirements of 2.5 million m³/annum, indicates that there is a deficit in the

lower Black uMfolozi during the winter months owing to large-scale irrigation development near the mouth of the uMfolozi River and abstractions for transfer to the Mhlathuze catchment. This deficit can be managed through the development of an off channel storage dam to store the excess water available during summer (Zululand DM ZD-WSDP, 2004).

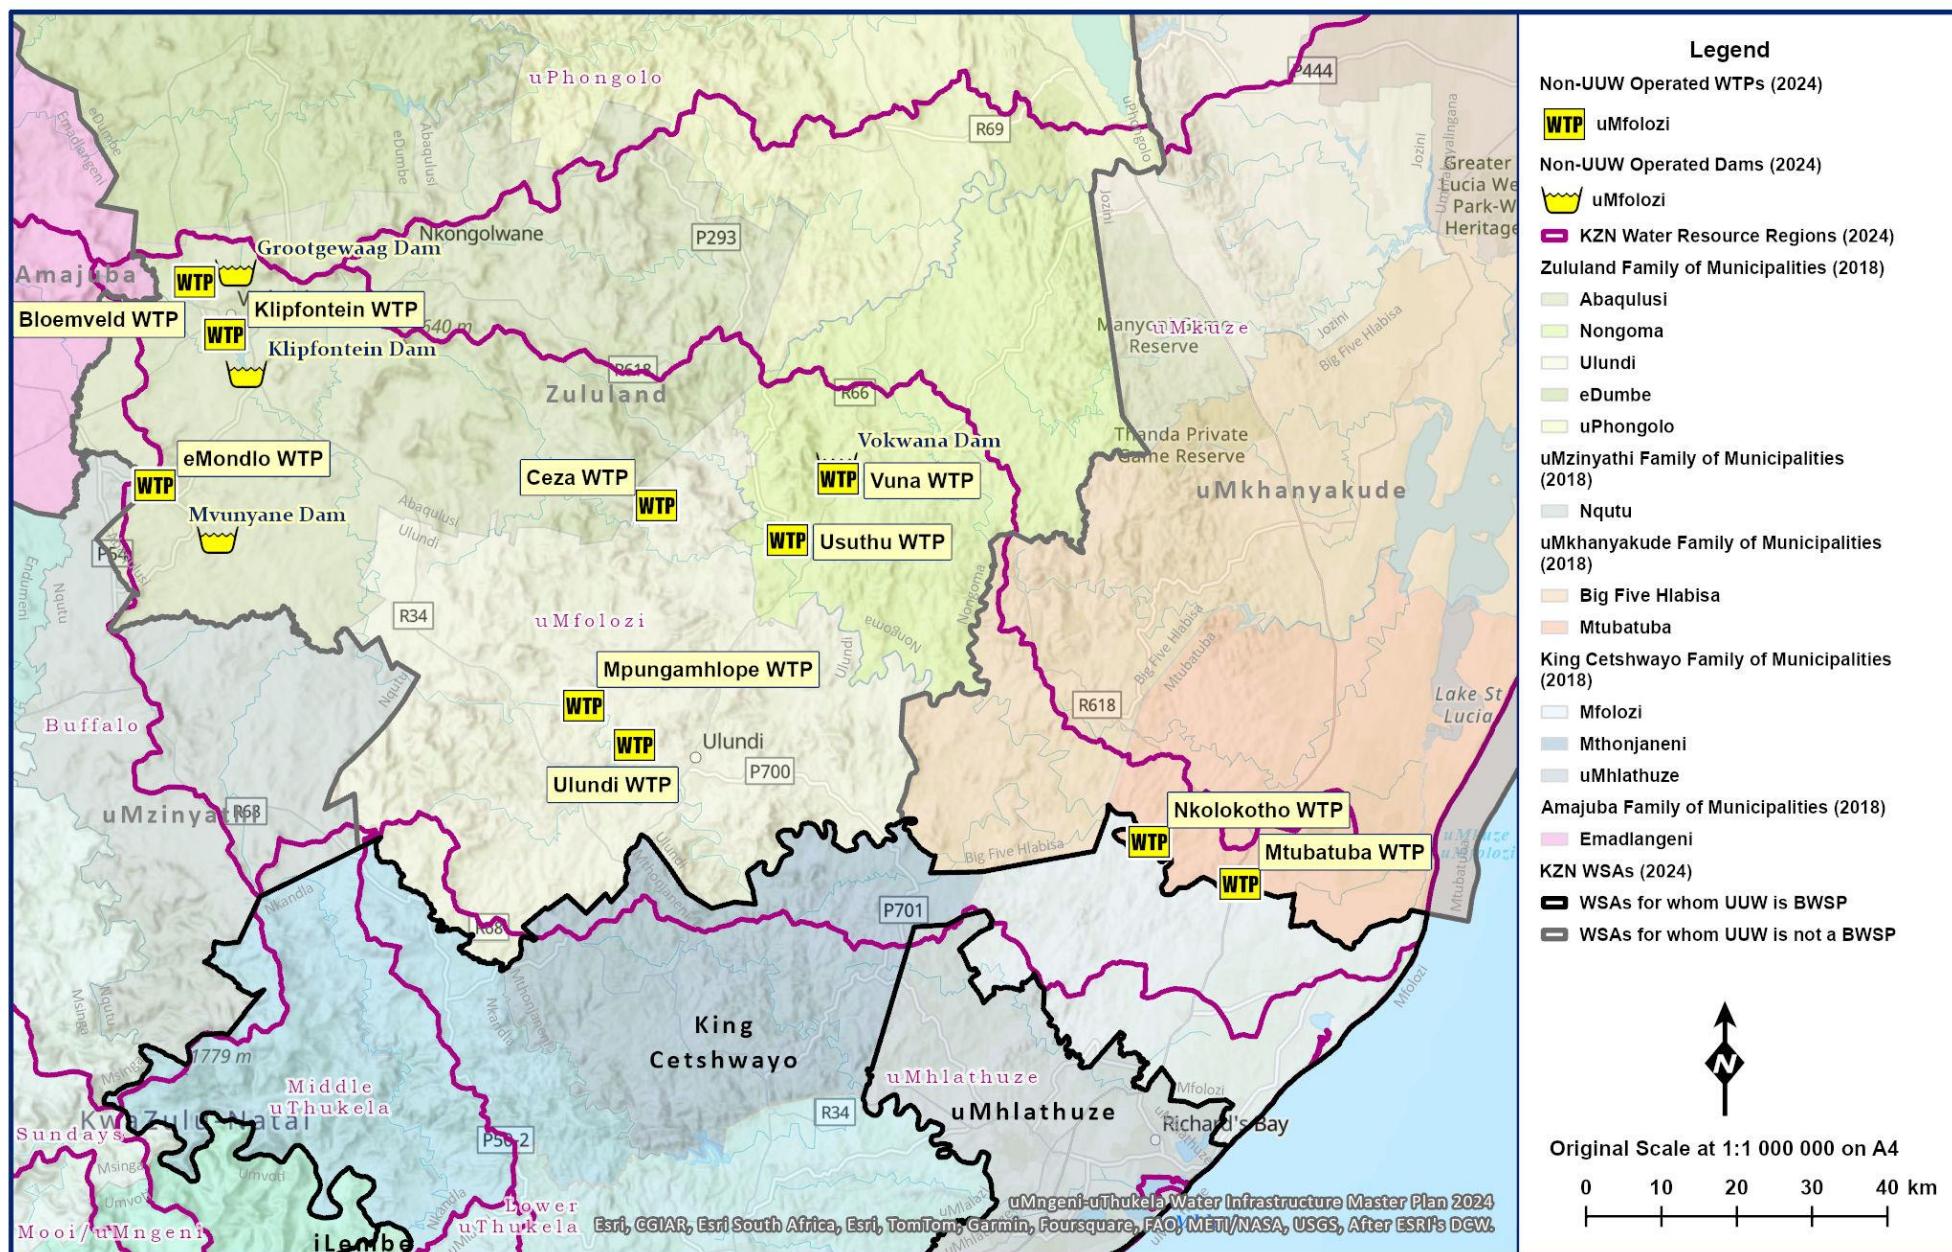


Figure 17.1 General layout of the uMfolozi System (MDB 2020, UUW IMP 2024).

17.2 Water Resources of the uMfolozi System

17.2.1 Description of the uMfolozi System Water Resource Region

(a) Mfolozi region

(i) Overview

The uMfolozi River is the main river flowing along the south eastern boundary of the Hluhluwe-Mfolozi Game Reserve in the King Cetshwayo District Municipality (KCDM). The uMfolozi River flows south east into the Indian Ocean just north of Richards Bay. The Black and White uMfolozi Rivers are tributaries of the uMfolozi River and are part of the main rivers supplying water to Zululand District Municipality, with others being the uPhongolo and uMkhuze Rivers. The uMfolozi System is located in the secondary catchments W21, W22 and W23, covering a total area of approximately 10 000 km².

The White uMfolozi River (W21) catchment sources its water from the north-west to north-east of the town of Vryheid (QC W21A). To the east, the headwaters of the river are highly developed with several small land uses such as commercial forestry and commercial farmlands dominating this zone. Commercial forest plantations cover approximately 120 km², while alien vegetation covers about 30 km² of upper reaches of the uMfolozi River catchment (Zululand DM ZD-WSDP, 2004). In terms of water resources infrastructure, QC W21A is significantly developed with major dams, i.e. the Grootgewaag and Bloemveld Dams, being situated in the upper reaches of the White uMfolozi River. The Klipfontein Dam (**Figure 17.2**), located about 5 km south of Vryheid (outlet of W21A), is the largest water resource infrastructure in the Upper uMfolozi catchment. This zone is also dominated by several small farm dams.

From the Klipfontein Dam, the White uMfolozi River flows in a south-easterly direction for about 12 km (as the crow flies) before its confluence with the Shoba River. The Shoba River meanders in a south-westerly direction from its headwaters in QC W21B near Emandleni Primary School, passing through the Golden Valley Farm and crossing the R34 just before its confluence with the White uMfolozi River (27.936° S; 30.904° E). The White uMfolozi River continues to meander in a south-easterly direction before its confluence with the Lenjane River near Lenjane Drift (27.941° S; 30.960° E). Following the Lenjane River confluence, the White uMfolozi River meanders in a south-west direction, passing through Brakfontein, before its confluence with the Sandspruit River (28.209° S; 30.949° E), which flows through QC W21C.

The White uMfolozi then meanders in a southerly direction, through QC W21F, to its confluence with the Mvunyane River near Kromellenboog. The Mvunyane River (W21D) sources its water from the western part of the Zululand District Municipality near Trig Beacon 36 (1531.3 mASL) where it forms the Umzinyathi-Zululand boundary. The town of eMondlo and surrounding residential areas such as Kwa Mabona, Nkandle and Machanca are located in the headwaters of the Mvunyane River. The largest water resource infrastructure in the Mvunyane River is the Mvunyane Dam, 7 km SE eMondlo town (as the crow flies). The major tributary of the Mvunyane River is the Jojosi River (south-west) which sources its water near the Saint Pauls residential area (~1200 mASL). The Jojosi River flows south-easterly through its mountaneous catchment, forming the Zululand-Mzinyathi boundary. The Mangongoloza River flows in a north-easterly direction from the eNqutu town in the Mzinyathi DM areas such as Mathutshana, Mphondi and Madudula, before it joins the Jojosi River near Esigodini. From its confluence with the Mangongoloza River, the Jojosi River meanders to the north-east (with contributions from the Bhubopho, Khoca and Mbondla streams from

the south), forming the Zululand-Mzinyathi boundary, to its confluence with the Mvunyane River near Sofaya. From its confluence with the Jojosi River, the Mvunyane River continues to form the Zululand-Mzinyathi boundary, meandering in a southerly direction before its confluence with the Nondweni River (near Mhlungwane), which joins the Mvunyane River from the south-west. From its confluence with the Nondweni River, the Mvunyane River flows south-easterly into W21F, through Witklip and Kromellenboog farms, before meandering north, then eastwards where it joins the White uMfolozi, near Witpoort farm.

The White uMfolozi River then meanders in a south-westerly direction, through W21G, where it follows the Zululand-Mzinyathi boundary, with the Ntinini River joining it from the south-west. Following the Ntinini River confluence, the White uMfolozi flows north-easterly before it is joined by the Nsubeni (from south) and Obombo Rivers (from northeast) near Obombo. The White uMfolozi River then meanders in a south-easterly direction, passing through the Leopard's Rock Nature Reserve into W21H, before flowing southwards to its confluence with the Nhlebela River (from the south-west) near Vlakhoek. The White uMfolozi River then meanders northwards towards its confluence with the Mvutshini River (from north-west) before flowing eastwards towards its confluence with the Tholeni River (from north), following which it flows into the uMfolozi LM (King Cetshwayo DM).

The White uMfolozi River continues to flow in an easterly direction towards Mthinzima village, where it then meanders in a south-westerly direction, passing through the Matshitsholo Nature Reserve before its confluence with the Mpambeni River (from south-west) near KwaMbambo. From this confluence, the White uMfolozi River continues meandering in a south-easterly direction towards the Battle of Gqokli Hill, before flowing north-easterly through the uMfolozi Camp Festival, towards Ulundi. The Ulundi raw water abstraction weir is located south-west of the Ulundi town on the White uMfolozi River, at the outlet of QC U21J. This is a gate-controlled weir, where raw water is abstracted for supply into Ulundi town and surrounding areas. From the Ulundi abstraction weir, the river meanders in a south-easterly direction towards the Ophathe Game Reserve. Thereafter, the White uMfolozi River meanders in a north-easterly direction towards its confluence with the Nhlungwane River at the outlet of W21K.

The White uMfolozi River then flows in a south-easterly direction, forming the KCDM-Mkhanyakude DM boundary, towards its confluence with the Mhlunywana River at the south-west corner of the Mkhanyakude DM. Thereafter, the White uMfolozi River meanders in a north-easterly direction through the Hluhluwe-Mfolozi Park towards the Mndindini Trails camp site. Thereafter, the White uMfolozi River flows southerly towards Makhamisa, from which it meanders north-easterly to its confluence with the Black uMfolozi River at the outlet of QC W21L.

The Black uMfolozi River sources its water from about 25 km east of Vryheid (W22A), near Trig Beacon 6 (1 628.3 mASL) in Hlobane. Major tributaries at the headwaters include the KwaMbizankulu and the Hlangebende Rivers, which flow in a north-easterly direction through QC W22B. From its confluence with the KwaMbizankulu and Hlangebende Rivers, the Black uMfolozi River meanders in a south-easterly direction towards its confluence with the Ithaka River (which flows from the south-west through W22D) near Chinso. The Black uMfolozi River then meanders eastwards towards its confluence with the Sikwebezi River near Mhambuma. The Black uMfolozi River then meanders southerly, towards its confluence with the Vuna River, which flows southwards through W22G. The Vuna River is an important source of water for Nongoma. Following its confluence with the Vuna River, the Black uMfolozi River meanders in a south-easterly direction through the Hluhluwe-Umfolozi Park in the Umkhanyakude DM, towards its confluence with the White uMfolozi River at the outlet of QC W22L. From the confluence, the uMfolozi River meanders in a south-easterly direction towards Mtubatuba, from which it flows north-east towards the St Lucia Estuary in the Indian Ocean.

(ii) Surface Water

Both the Black and White uMfolozi Rivers flow through predominately rural areas, characterised by natural grasslands and subsistence farming. Following the confluence of these two rivers, the uMfolozi River then flows into more developed urban areas, where commercial forest plantations and sugarcane are the main economic activities in the water source areas. The hydrological characteristics for this region are shown in **Table 17.1**.

Table 17.1 Hydrological characteristics of the uMfolozi Region (WR2012: Usutu-Mhlatuze Quat Info WMA 6 7Jul2015 spreadsheet).

Region	River (Catchment)	Area (km ²)	Annual Average			
			Evaporation (mm)	Rainfall (mm)	Natural Runoff (million m ³)	Natural Runoff (mm)
Mfolozi	W21 (White uMfolozi)	5274	1462	763	393.8	74.7
	W22 (Black uMfolozi)	3566	1202	808	277.1	77.7
	W23 (Mfolozi)	1168	1368	972	153.9	131.9

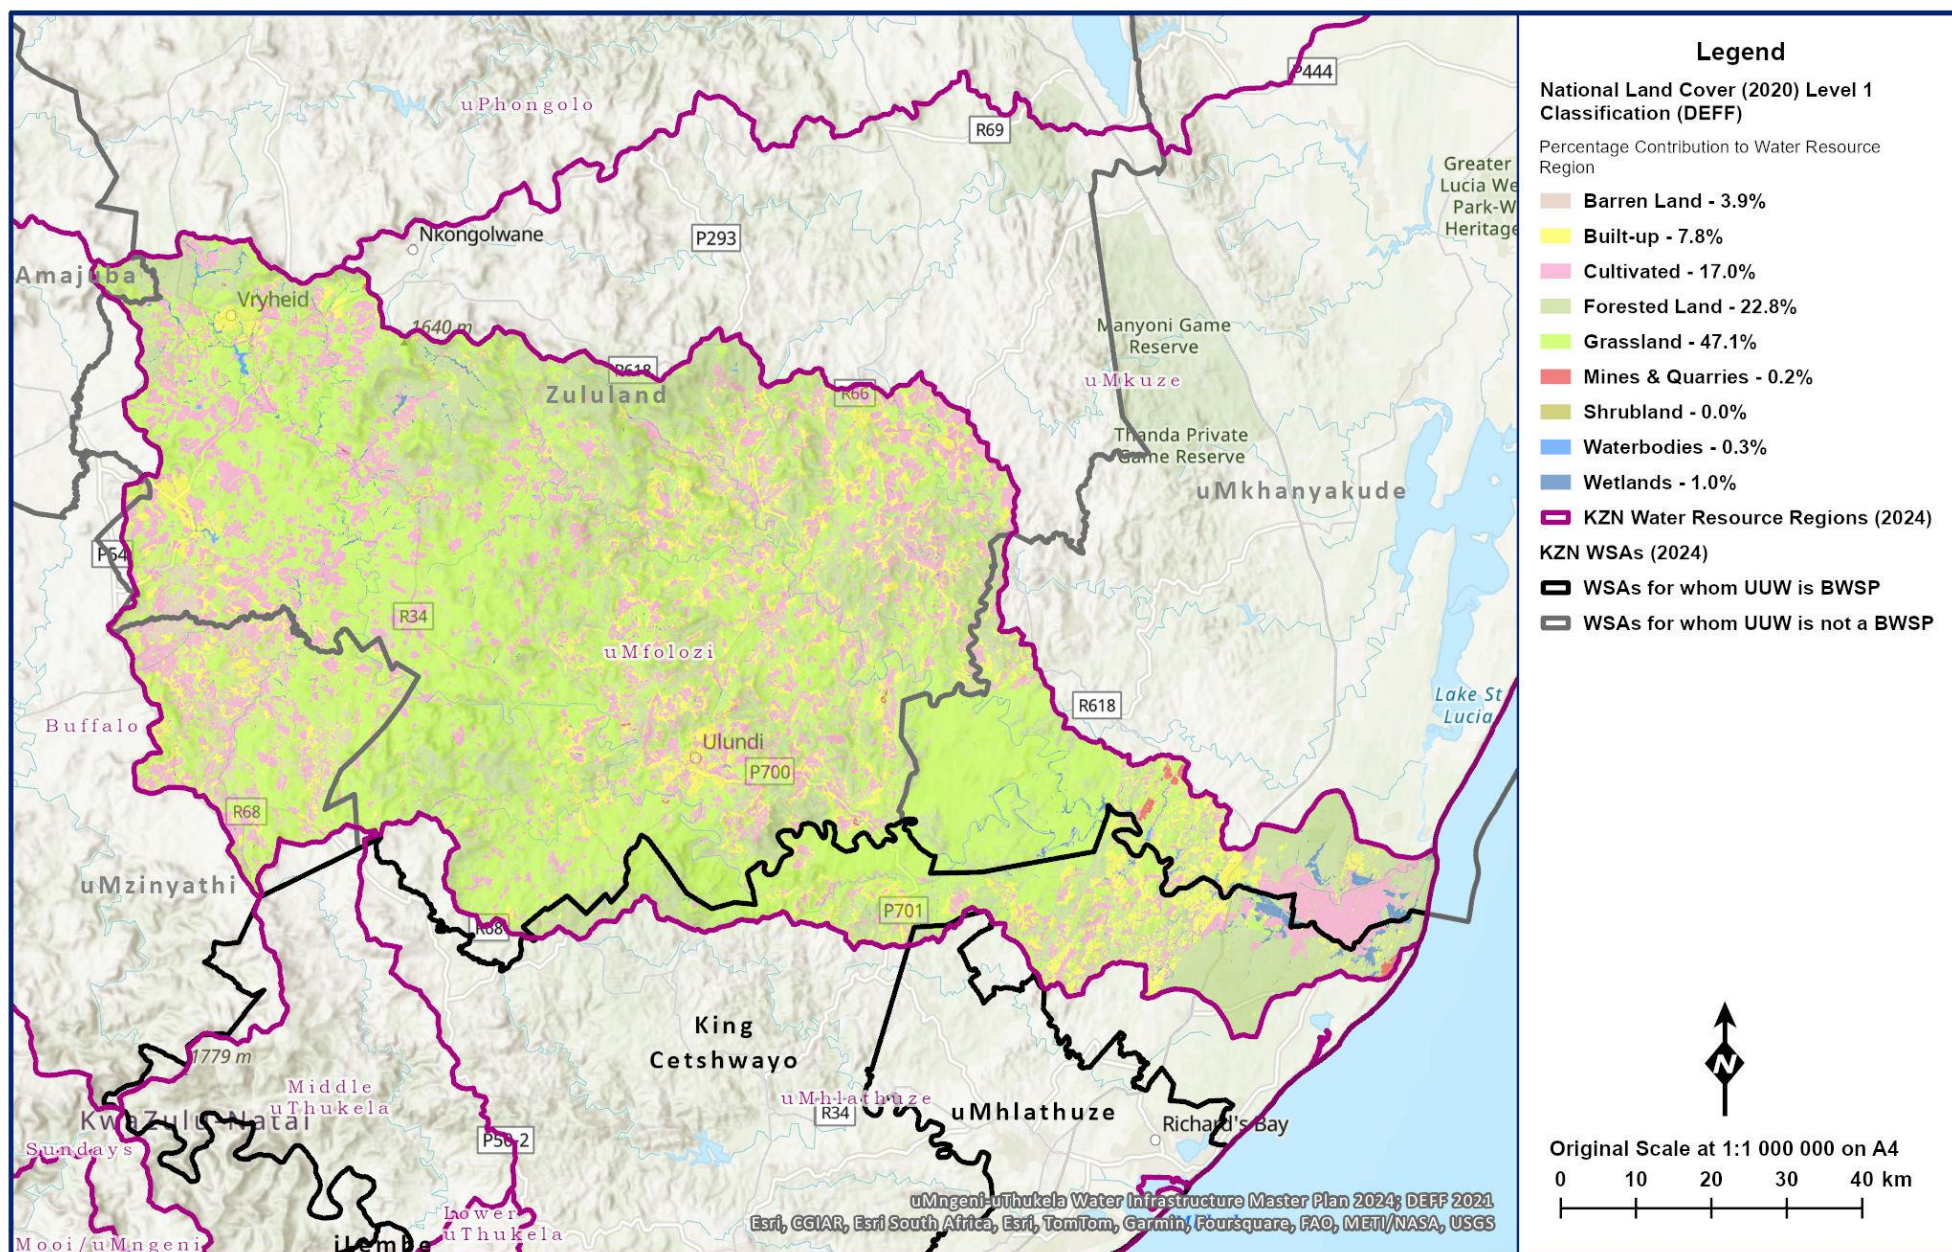


Figure 17.2 General layout of the uMfolozi region (DEFF 2020, MDB 2020, uMngeni-uThukela Water 2024, WR2012).

(iii) Groundwater

The uMfolozi region is located in three hydrogeological regions (**Figure 17.3**); the North Western Middleveld, North Eastern Middleveld and Southern Lebombo (DWAF, 2008).

• Hydrogeological Units

The Bumbeni Complex consists of a variable suite of sedimentary and volcanic rocks that include rhyolite, lavas, tuffs and basalt. With a few exceptions, virtually all the mountains, the flat-topped spurs and plateaux in the area are capped by dolerite sills.

The Vryheid Formation conformably overlies the Pietermaritzburg Formation. The Pietermaritzburg Formation is found resting conformably on the Dwyka Formation and unconformably on older basement rocks in the absence of the tillite.

The Natal Group overlies, unconformably, on the basement rocks. The Natal Group varies in thickness from a minimum of 15 m to about 500 m near Eshowe. To the north, its thickness decreases to about 150 m near Hlabisa.

The Tugela Group is present in four sub-horizontal thrust sheets made up of gneiss, amphibolitic hornblende schist formations and granitoid-gneiss formations.

• Geohydrology

The basalts occupy the flat and rolling hills immediately west of the Lebombo Mountains extending south as far as Empangeni. Virtually everywhere, the basalt is weathered to a depth of 10 to 15 m and forms very few outcrops.

Geophysical borehole logging has shown that the first water is generally struck at the base of the weathering zone.

Being more resistant to weathering than basalt rocks, the rhyolite rocks give rise to hills and ridges with very little soil cover or weathered overburden. Accordingly, all exploitable groundwater resources in these rock formations occur in saturated discontinuities such as fractures, joints and faults.

The intrusive dolerite sheets and dykes play an important role in influencing the movement and storage of groundwater. They are often jointed and fractured themselves, especially the sheet intrusions, but drilling results are more erratic when it penetrates the dolerite itself.

A great variety of sedimentary rocks comprising sandstone, shale, mudstone and Tillite underlie the study area. The largest volume of water utilised in the area is obtained from these rock types.

• Groundwater Potential

The lithology with the highest yielding boreholes is the Natal Group Sandstone with average yields of 5.0 ℓ/s. Second highest yielding is the basement granite at 1.2 ℓ/s. This is followed by the Pongola Supergroup with yields of 1.1 ℓ/s. The raining lithologies in the area, namely Dwyka, Pietermaritzburg Formation, Vryheid Formation and Karoo Dolerite yield < 1 ℓ/s.

Although the yield of boreholes drilled directly into Dolerite are low, the impact of dolerite intrusions on other lithologies is significant. The dolerite intrusion disturbs the surrounding country rock increasing permeability and storativity of the contact zones due to fracturing and jointing and make them prime targets in the Karoo sediments for the drilling of boreholes.

Borehole yields are on average moderate having blow yields of $> 0.5 - 3.0 \text{ l/s}$ but only 38% have yields $> 1 \text{ l/s}$. Yields are poor in the east, around Nqutu and in areas where dolerite forms capping's on mountains. In the flatter, undulating areas south of Vryheid, where the dolerite is often deeply weathered, yields are moderate.

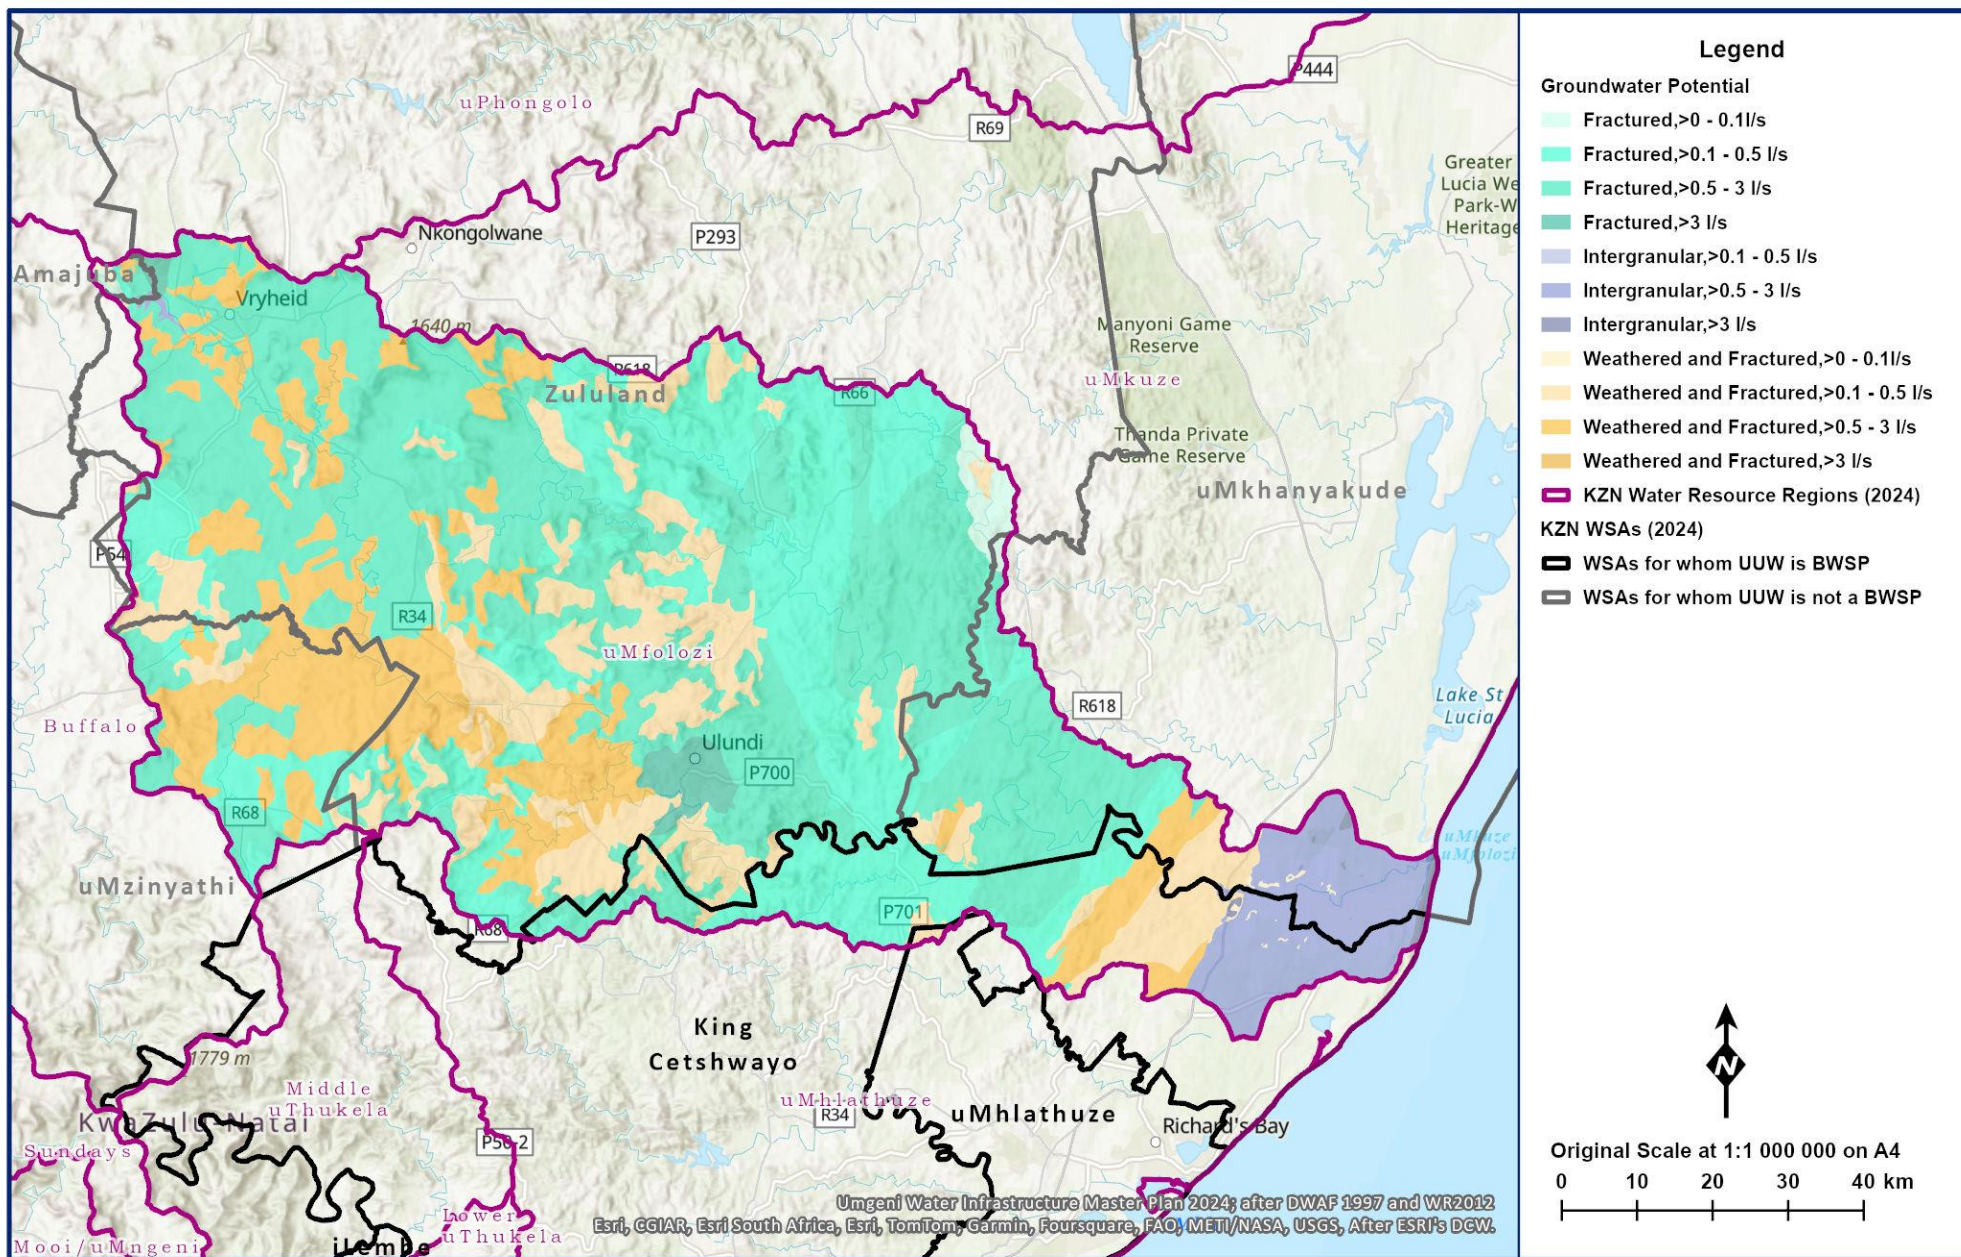


Figure 17.3 Groundwater potential in the uMfolozi Region (MDB 2020, uMngeni-uThukela Water 2024, after DWAF 1997 and WR2012).

(iv) Water Quality

- Surface Water

The water quality of uMfolozi headwaters is affected by coalfields around Vryheid. This places considerable pressure on the ecological and hydrological functioning of this water source area. Agriculture is the largest water user in this catchment, predominantly sugarcane and commercial forestry. The main threat to the water quality of the uMfolozi River is land degradation due to land use practices and coal mining. The uMfolozi River carries over a million tonnes of suspended sediment annually to the ocean and this has led to costly dredging operations in the estuary mouth which have proved ineffective.

- Groundwater

The chemical composition of natural groundwater is affected by the soluble products of rock weathering. The chemical characteristics of groundwater are reflected in many aspects of groundwater occurrence, recharge, movement and pollution.

The chloride content, as a percentage of the total dissolved solids, is generally very high in the area. However, it is effectively washed away in sections where the Mean Annual Rainfall (MAR) is high. In the central sections, surrounding Hlabisa, where the MAR is in excess of 1000 mm/annum, the chloride content in borehole water is lowest. Generally, the chloride content and electrical conductivity (EC) decreases as the distance from the Indian Ocean increases. This probably plays a role in the elevated salinity in some of the study area.

17.2.2 Reserve

(a) uMfolozi Region

In December 2021, DWS commissioned a study entitled ***Classification of Significant Water Resources and Determination of Resource Quality Objectives (RQOs) for Water Resources in the Usutu to Mhlathuze Catchments*** in order to reassess the present ecological status of water resources in the region. The study will also make recommendations for the targeted ecological status of the different parts of this Water Resource Region. The study is expected to be completed in July 2024; however, some components of the study have been finalised – including the RQOs for rivers, wetlands and estuaries. Key findings from the study are summarised below. It is important to note that these findings are yet to be officially Gazetted by DWS and any changes included in the final Gazette will be included in the 2025 Infrastructure Master Plan.

(i) Groundwater

The total groundwater component of the Reserve in the uMfolozi catchment is 383.43 million m³/annum. There is minimal groundwater use in the catchment and, as such, the Present State Category of the groundwater component of the Reserve is Category A.

(ii) uMfolozi River

The PES of the White uMfolozi is generally B/C and the TEC is B/C. There are some areas where the PES could be improved; however, that is deemed difficult, as non-flow mitigation measures are required. The Ecological Water Requirements (EWR) for the White uMfolozi River can be summarised as follows:

- The total annual flow should at least be 89.31 million m³ (40.1% of the natural MAR);

- The total annual requirement for low flows is 54.74 million m³ (24.6% of the natural MAR);
- A flow rate of 1.98 m³/s should be exceeded 60% of the time during February (i.e. high flow);
- A flow rate of 0.77 m³/s should be exceeded 90% of the time during September (i.e. low flow).

The PES of the Black uMfolozi is generally B/C and the TEC is B/C. The Ecological Water Requirements (EWR) for the Black uMfolozi River can be summarised as follows:

- The total annual flow should at least be 43.6 million m³ (26.1% of the natural MAR);
- The total annual requirement for low flows is 18.38 million m³ (11% of the natural MAR);
- A flow rate of 0.70 m³/s should be exceeded 60% of the time during February (i.e. high flow);
- A flow rate of 0.20 m³/s should be exceeded 90% of the time during July (i.e. low flow).

17.2.3 Existing Water Resource Infrastructure and Yields

(a) Mfolozi Region

The major dams of the White uMfolozi River are shown in **Table 17.2**. These include the Klipfontein Dam (**Figure 17.4, Table 17.3**), the Bloemveld Dam (**Figure 17.5, Table 17.4**), the Grootgewacht Dam (**Figure 17.6, Table 17.5**), the Ulundi Weir (**Figure 17.7, Table 17.6**), the Vuna Dam (**Figure 17.8, Table 17.7**), the Vokwana Dam (**Figure 17.9, Table 17.8**) and the Mvunyana Dam (**Figure 17.10**).

The largest water resources development in the catchment is the Klipfontein Dam (capacity 18.09 million m³/annum), which is positioned in the upper reaches of the White uMfolozi River. The dam was built to supply water to Vryheid town and is also used to increase water supply to Ulundi. There is insufficient water storage infrastructure in the region, which results in low yields and increases the region's susceptibility to water shortages during drought events (uMngeni-uThukela Water 2019: 34).

According to the Universal Access Plan (UAP) (UUW, 2021), ~23% of the Abaqulusi water supply scheme (which includes Vryheid, eMondlo and surrounding areas) lacks access to reliable water supply. In addition, the yield of available water resources is not sufficient to meet present day and future water demand. The 2018/2019 WSDP Water Resource Modelling results further demonstrates the water supply deficiencies in existing water resources in the upper uMfolozi System. For example, results from this modelling exercise indicate that the yield from the Mvunyane Dam is insufficient to meet the requirements at the desired levels of assurance and requires augmentation to avoid the need to implement restrictions. Similarly, the study concluded that the yield from Klipfontein Dam would be insufficient to meet the water requirements of Vryheid, Ulundi and eMondlo beyond 2021.

Based on the 2019 uMkhanyakude DM UAP Phase III report, the domestic allocations on the uMfolozi are for the Mpukonyoni and Mtubatuba schemes, and each scheme has an allocation of 3.65 million m³/annum (10 Mℓ/day). The available yield at the Mpukonyoni abstraction site is not known, but regular operational issues (as a result of low river levels) indicate that there is limited resource availability. The Mpukonyoni Scheme shares the water resources of the uMfolozi River with the Mtubatuba Supply area.

The yield of the uMfolozi at the point of abstraction for Mtubatuba is one of the most important parts of the uMfolozi River for the uMkhanyakude DM. In particular, the low flow runoff is most significant in terms of reliability of supply throughout the year. The low flow runoff of the uMfolozi River with a 1:50 year recurrence interval being available at the Mtubatuba abstraction works will be

approximately 5.26 million m³ and 8.09 million m³ for the 1 month and 3 month durations, respectively. This translates to approximately 7.39 million m³/annum (20.2 Mℓ/day). However, because of the sandy nature of the uMfolozi River, only 50% (3.7 million m³/annum) (10.1 Mℓ/day) of this low flow is available over the whole year.

The Department of Water and Sanitation recently (2022) completed a Drought Operating Rules study for the White uMfolozi System. It is important to note that the mean annual runoff (MAR) estimated in this study is significantly lower than compared to previous studies. Similarly, the full supply storage volume of key water resources infrastructure, i.e. Klipfontein Dam and Ulundi Weir, has declined. As a result, water resources modelling results suggest lower yield estimates when compared with previous studies. The historical firm yield, as well as the long-term stochastic yield at 98% assurance of supply level (i.e. 1:50) for the different dams are shown in **Table 17.2** below.

Table 17.2 The yield of major dams in the White uMfolozi catchment (DWS, 2022).

Dam	Year Built	FSC million m ³	Quat	MAR million m ³ /annum	Histoical Firm Yield Million m ³ /annum	1:50 Yield Million m ³ /annum
Grootgewacht	1948	1.1	W21A	2.2	0.4	-
Bloemveld	1969	2.7	W21A	6.6	1.1	-
Klipfontein (system)	1983	17.8	W21A	42.6	12.0	12.0
Mvunyana	1970	2.9	W21D	6.6	2.2	2.5
Ulundi Weir (system)*	1995	0.2	W21H	219.8	15.3	19.0

*The yield of the Ulundi Weir assumes support from the Klipfontein Dam.

Due to the geographic and geological characteristics of the White uMfolozi River catchment, as well as land use practices and management thereof, water resources are highly susceptible to sedimentation. The Ulundi weir, specifically, experiences high siltation rates and requires occasional flushing. However, the flushing does not compensate for the loss in storage. Hence, support from the Klipfontein Dam is critical for the Ulundi water supply scheme. Similarly, the Mvunyana Dam is highly silted and requires augmentation in order to meet present day water demand. DWS (2013) proposed construction of a pipeline to transfer water from the Klipfontein Dam to Mvunyana Dam in order to improve the assurance of supply for the Mvunyana Dam. However, this augmentation has not been implemented. It is recommended that any proposed storage or abstraction infrastructure in the White uMfolozi River should consider the impacts of, as well as strategies to minimise sedimentation.

In order to address the water resource challenges facing the White uMfolozi System, the UAP Phase III report recommends raising the Klipfontein Dam as an attainable option. This intervention was also proposed in the First Order Reconciliation Strategies. Another potential option is the construction of an off-channel storage dam on the KwaNkweme River with a run-of-river scheme on the upper Black uMfolozi River could supply a target abstraction of 18.6 Mℓ/day (the projected water requirement for the proposed scheme in 2025). The annual risk of failure of this development would be approximately 64%. This risk is above the accepted levels (assurance of supply) of the system (UUW, 2020).



Figure 17.4 Klipfontein Dam (<https://vryheidherald.co.za>)

Table 17.3 Characteristics of Klipfontein Dam (DWS 2018: Hydrographic Surveys Dams Database, DWS 2019: List of Registered Dams Database, WR2012).

Catchment Details	
Incremental Catchment Area:	340 km ² ^a
Total Catchment Area:	340 km ² ^a
Mean Annual Precipitation:	879 mm ^b
Mean Annual Runoff:	35.11 million m ³ ^b
Annual Evaporation:	1045 mm ^b
Dam Characteristics	
Gauge Plate Zero:	1071.1 mASL ^c
Full Supply Level:	1090 mASL ^c
Net Full Supply Capacity:	17.811 million m ³ ^c
Spillway Height:	28 m ^c
Dead Storage:	1.181 million m ³ ^c
Total Capacity:	17.811 million m ³ ^c
Original Measured Dam Capacity:	18.992 million m ³ (1983) ^d
Second Measured Dam Capacity:	18.970 million m ³ (1984) ^d
Third Measured Dam Capacity:	18.088 million m ³ (2000) ^d
Fourth Measured Dam Capacity:	17.811 million m ³ (2016) ^d
Surface Area of Dam at Full Supply Level:	2.959 km ² ^c
Dam Type:	Earth-fill ^c
Material Content of Dam Wall:	Earth Fill ^c
Crest Length:	Crest length: 970 m ^e Spillway Section: 12 m ^e Non-Spillway Section: 958 m ^e
Type of Spillway:	Earth Fill ^c
Capacity of Spillway:	1250 ^f
Date of Completion:	1983 ^c
Date of Last Area Capacity Survey:	2016 ^d
Date of Next Area Capacity Survey:	2031 ^d

^a Catchment delineated using 20m DEM and Spatial Analyst.
^b WR2012.
^c DWS List of Registered Dams Database (April 2019).
^d DWS Hydrographic Surveys Dams Database (2018).
^e Measured on Google Earth.
^f SANCOLD



Figure 17.5 Bloemveld Dam (Northern Natal News 2013: website)

Table 17.4 Bloemveld Dam (DWS 2018: Hydrographic Surveys Dams Database, DWS 2019: List of Registered Dams Database, WR2012)

Catchment Details	
Incremental Catchment Area:	59 km ² ^a
Total Catchment Area:	59 km ² ^a
Mean Annual Precipitation:	879 mm ^b
Mean Annual Runoff:	10.37 million m ³ ^b
Annual Evaporation:	1450 mm ^b
Dam Characteristics	
Gauge Plate Zero:	1232.5 mASL ^g
Full Supply Level:	1250.5 mASL ^g
Net Full Supply Capacity:	2.27 million m ³ ^c
Spillway Height:	18 m ^c
Dead Storage:	N/A
Total Capacity:	2.27 million m ³ ^e
Original Measured Dam Capacity:	2.27 million m ³ (1971) ^d
Surface Area of Dam at Full Supply Level:	0.64 km ² ^c
Dam Type:	Earth-fill ^c
Material Content of Dam Wall:	Earth-fill ^c
Crest Length:	Crest length: 424 m ^d Spillway Section: 8 m ^d Non-Spillway Section: 416 m ^d
Type of Spillway:	Side Channel And Uncontrolled Ogee ^c
Capacity of Spillway:	275 ^f
Date of Completion:	1969 ^c
Date of Last Area Capacity Survey:	1971 ^d
Date of Next Area Capacity Survey:	2006 (Overdue) ^d

^a Catchment delineated using 20m DEM and Spatial Analyst.

^b WR2012.

^c DWS List of Registered Dams Database (April 2019).

^d DWS Hydrographic Surveys Dams Database (2018).

^f SANCOLD

^g 0.5 m contour from DEM



Figure 17.6 Grootgewacht Dam (DWA, 2015)

Table 17.5 Grootgewacht Dam (DWS 2019: List of Registered Dams Database, WR2012)

Catchment Details	
Incremental Catchment Area:	16.3 km ² ^a
Total Catchment Area:	16 3 km ² ^a
Mean Annual Precipitation:	879 mm ^b
Mean Annual Runoff:	2.87 million m ³ ^b
Annual Evaporation:	1450 mm ^b
Dam Characteristics	
Gauge Plate Zero:	1300.3 mASL
Full Supply Level:	1312.5 mASL
Net Full Supply Capacity:	1.136 million m ³ ^c
Spillway Height:	12.19 m ^c
Dead Storage:	N/A
Total Capacity:	1.136 million m ³ ^c
Original Measured Dam Capacity:	1.136 million m ³ ^c
Surface Area of Dam at Full Supply Level:	0.30 km ² ^c
Dam Type:	Gravity ^c
Material Content of Dam Wall:	Unknown at this stage
Crest Length:	Crest length: 132 m ^d Spillway Section: 30 m ^d Non-Spillway Section: 102 m ^d
Type of Spillway:	Uncontrolled Ogee And Side Channel ^c
Capacity of Spillway:	N/A
Date of Completion:	1948 ^c
Date of Last Area Capacity Survey:	2008 ^c
Date of Next Area Capacity Survey:	N/A

^a Catchment delineated using 20m DEM and Spatial Analyst.
^b WR2012.
^c DWS List of Registered Dams Database (April 2019).
^d Measured on Google Earth.
^e 0.5 m from DEM



Figure 17.7 Ulundi Balancing Weir (Google Earth 2020)

Table 17.6 Ulundi Weir (DWS 2019: List of Registered Dams Database, WR2012)

Catchment Details	
Incremental Catchment Area:	407 km ² ^a
Total Catchment Area:	407 km ² ^a
Mean Annual Precipitation:	780 mm ^b
Mean Annual Runoff:	32.64 million m ³ ^b
Annual Evaporation:	1500 mm ^b
Weir Characteristics	
Net Full Supply Capacity:	0.24 million m ³ ^c
Spillway Height:	11 m ^c
Total Capacity:	0.24 million m ³ ^c
Original Measured Dam Capacity:	0.24 million m ³ ^c
Surface Area of Dam at Full Supply Level:	0.18 km ² ^c
Dam Type:	Gravity ^c
Material Content of Dam Wall:	Gravity ^c
Crest Length:	Crest length: 147 m ^c Spillway Section: 37 m ^d Non-Spillway Section: 110 m ^d
Type of Spillway:	Ogee Spillway ^c
Capacity of Spillway:	N/A
Date of Completion:	1995 ^c
Date of Last Area Capacity Survey:	2005
Date of Next Area Capacity Survey:	N/A

^a Catchment delineated using 20m DEM and Spatial Analyst.
^b WR2012.
^c DWS List of Registered Dams Database (April 2019).
^d Measured on Google Earth.



Figure 17.8 Vuna Dam (The Siyasiza Trust Facebook Photo upload: 2015)

Table 17.7 Vuna Dam (DWS 2019: List of Registered Dams Database, WR2012)

Catchment Details	
Incremental Catchment Area:	116.8 km ² ^d
Total Catchment Area:	116.8 km ² ^d
Mean Annual Precipitation:	774 mm ^a
Mean Annual Runoff:	17.9million m ³ ^a
Annual Evaporation:	1500 mm ^a
Dam Characteristics	
Gauge Plate Zero:	365 mASL ^c
Full Supply Level:	376 mASL ^c
Spillway Height:	11 m ^b
Net Full Supply Capacity:	0.9 million m ³ ^b
Dead Storage:	N/A
Total Capacity:	0.9 million m ³ ^b
Surface Area of Dam at Full Supply Level:	0.36 km ²
Original Measured Dam Capacity	0.9 million m ³ ^b
Dam Type:	Earth-fill ^b
Crest Length:	Crest Length: 378 m ^c Spillway Section: 122 m ^c Non-Spillway Section: 256 m ^c
Type of Spillway:	Uncontrolled
Capacity of Spillway:	N/A
Date of Completion:	1986 ^b
Date of Area Capacity Survey:	1996 ^b
Date of next Area Capacity Survey:	N/A

^a WR2012 Database of Quaternary Catchment Information.

^b DWS List of Registered Dams Database (April 2019).

^c Measured on Google Earth.

^d DWA, 2013.



Figure 17.9 Vokwana Dam (Google Earth 2020)

Table 17.8 Vokwana Dam (DWS 2019: List of Registered Dams Database, WR2012).

Catchment Details	
Incremental Catchment Area:	16.1 km ² ^d
Total Catchment Area:	16.1 km ² ^d
Mean Annual Precipitation:	774 mm ^a
Mean Annual Runoff:	2.4 million m ³ ^a
Annual Evaporation:	1500 mm ^a
Dam Characteristics	
Gauge Plate Zero:	373 mASL ^c
Full Supply Level:	398 mASL ^c
Spillway Height:	25 m ^b
Net Full Supply Capacity:	1.45 million m ³ ^b
Dead Storage:	0.26million m ³ ^b
Total Capacity:	1.71 million m ³ ^b
Surface Area of Dam at Full Supply Level:	0.23 km ² ^b
Original Measured Dam Capacity	1.71 million m ³ ^b
Dam Type:	Earth-fill ^b
Crest Length:	Crest Length: 350 m ^b
Type of Spillway:	Uncontrolled Ogee ^b
Capacity of Spillway:	N/A
Date of Completion:	2000 ^b
Date of Area Capacity Survey:	2000 ^b
Date of next Area Capacity Survey:	N/A

^a WR2012 Database of Quaternary Catchment Information.

^b DWS List of Registered Dams Database (April 2019).

^c Measured on Google Earth.

^d DWA, 2013.

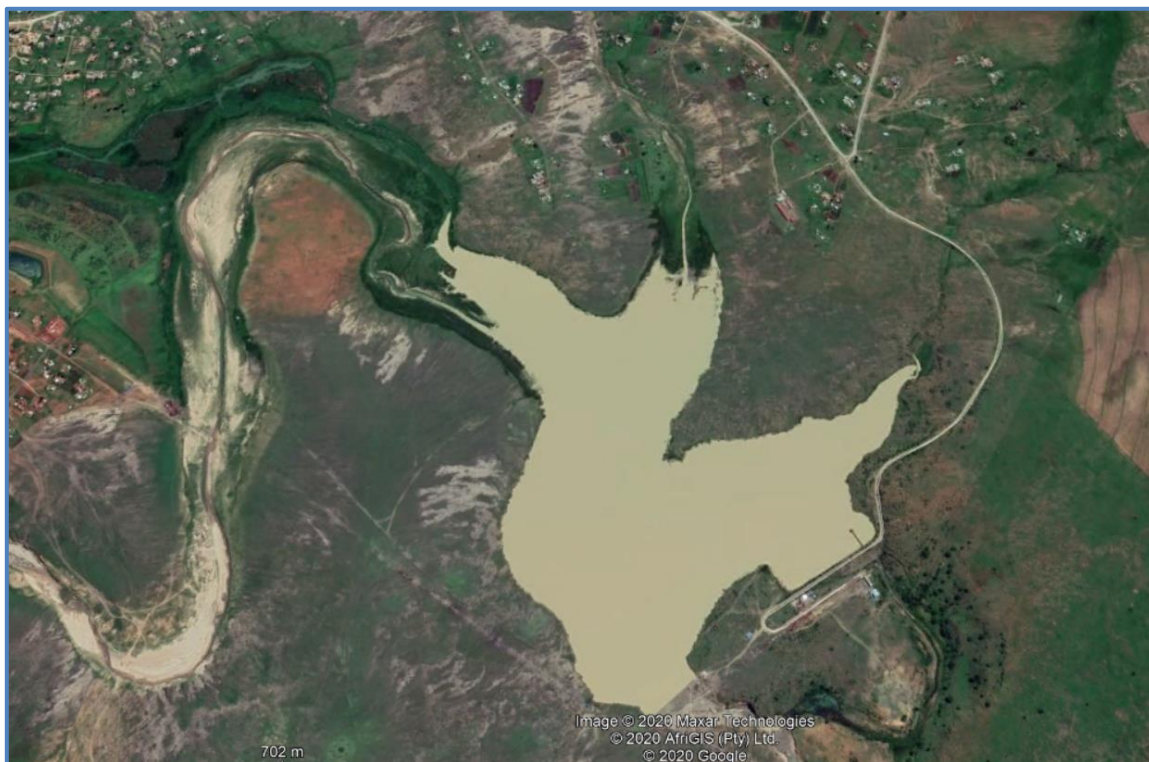


Figure 17.10 Mvunyana Dam (Google Earth 2020)

17.2.4 Operating Rules

(a) Mfolozi Region

Vryheid receives water supply from the Klipfontein (16 MI/d) and Bloemveld (7.5 MI/d) Dams. Ulundi sources its water from the Ulundi abstraction weir on the White uMfolozi River. This weir consists of gates that are closed in winter to capture low flows and opened in summer to avoid weir siltation. The yield of the river is supplemented with releases from Klipfontein Dam during low flows.

In May 2013, the Department of Water and Sanitation undertook a study titled “*The development of Water supply and Drought Operating Rules for Stand-Alone Dams and Schemes*”. This study concluded that the White uMfolozi system was being operated at an unacceptable assurance of supply level (DWS, 2013). In 2022, DWS updated this study to incorporate changes in the demand from the system.

The following water supply schemes were considered in the study:

- The Vryheid Regional Water Supply Scheme (WSS);
- The eMondlo Water Supply Scheme;
- The Ulundi Water Supply Scheme; and
- The Mpungamhlope Water Supply Scheme.

Operating rules results for the above-mentioned Water Supply Schemes are described below.

Upper uMfolozi Water Supply Operating Rule

The analyses were based on the 2022 development level and the order/priority of water supply from the different resources to the various WSS was developed by DWS (2013). Similarly, the operating rules developed by DWS (2013) were maintained in the DWS (2022) update. These are briefly summarised below:

- The Vryheid WSS uses water from Grootgewacht and Bloemveld dams first up to the limit of the infrastructure and the balance of the water requirements are then abstracted from the Klipfontein Dam;
- The Bloemveld Dam should be supported by the Grootgewacht Dam;
- The eMondlo WSS abstracts water from the Mvunyana Dam. A transfer from Klipfontein Dam was planned to be constructed by 2019/2020 to improve the reliability of water supply to eMondlo. When the transfer is complete, eMondlo shall abstract water from Mvunyana Dam first and then from Klipfontein Dam (to be tested and confirmed). This may require the raising of the Klipfontein Dam Wall.
- The Mpungamhlope WSS abstracts water from the White uMfolozi River just upstream of the Ulundi balancing weir. This abstraction is supported by releases from the Klipfontein Dam when there is insufficient flow in the river.
- The Ulundi WSS is supplied from the Ulundi balancing weir, which is supported by releases from the Klipfontein Dam. Water should only be released from the Klipfontein Dam when the incremental flows are not sufficient to support the abstraction to the Ulundi WTP.

Upper White uMfolozi Drought Operating Rule

A drought operating rule was also developed using the above-mentioned supply sequence from the available resources. This estimated the volume of water that can be allocated to users based on storage levels in the dams. This allocation is based on the volume of water that can reliably be drawn from the system without increasing the risk of failure. The drought operating rules for the White uMfolozi River are as follows:

- **Grootgewacht & Bloemveld Dam sub-system:** These two dams were not included in the DWS (2022) update of the 2013 Drought Operating Rules study. Therefore, the 2013 drought operating rule is maintained. According to this assessment, the maximum volume of water that can be reliably supplied from this system, without dam failure, is in the order of 2 million m³/annum. Thereafter, the balance of the Vryheid WSS's water requirement should be supplied from the Klipfontein Dam (**Figure 17.11**).

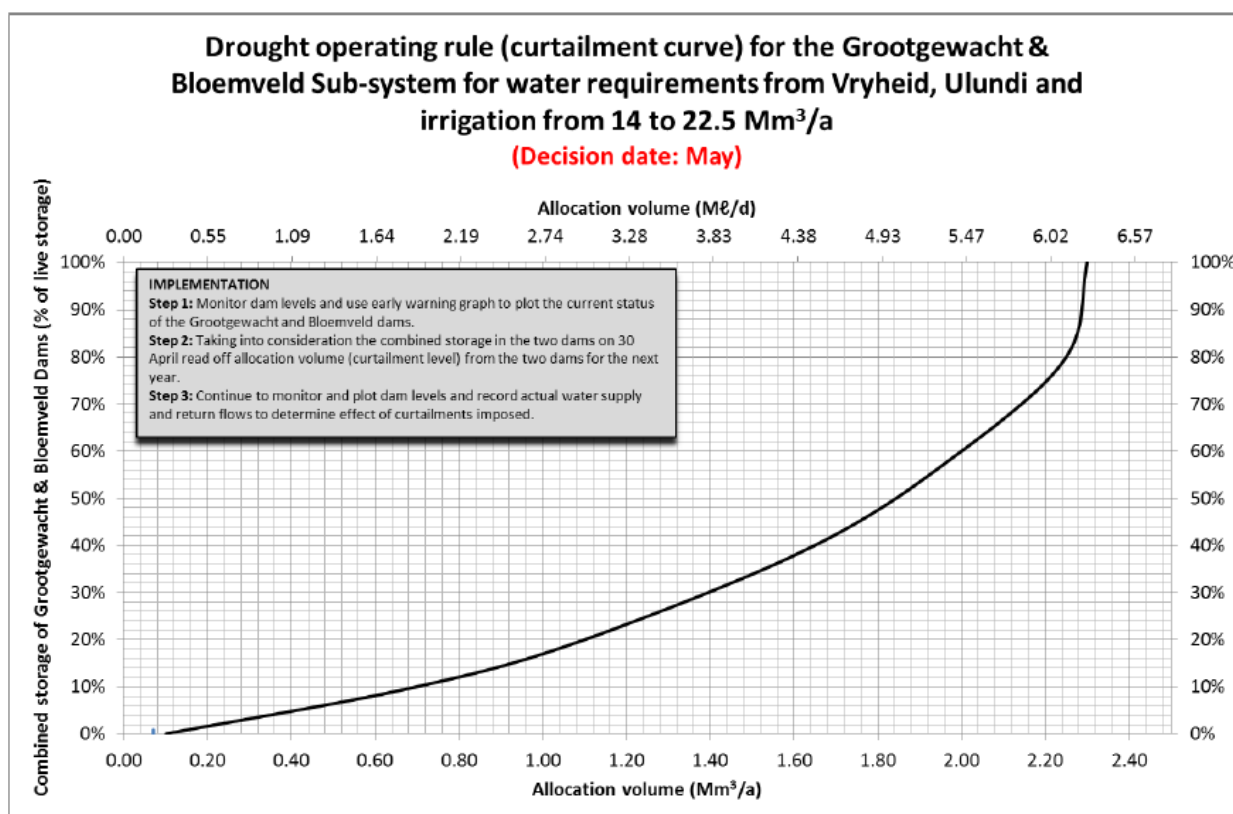


Figure 17.11 Drought operating rule for Grootgewacht & Bloemveld sub-system (Vryheid supply) – May decision month (DWS, 2013)

- Klipfontein Dam sub-system:** The level of restrictions in the Klipfontein Dam depends largely on the water requirement imposed on the dam (combined requirement of the Vryheid WSS, Ulundi WSS, Mpungamhlope WSS as well as the irrigation between Klipfontein Dam and the Ulundi balancing weir). The updated drought operating rule for the dam recommends that restrictions for domestic supply be implemented as soon as the dam reaches 50% of Full Supply Capacity (FSC). On the other hand, irrigators should be restricted as soon as the dam level reaches 70% FSC. The simplified drought operating rule for the Klipfontein Dam is shown in **Figure 17.12** below.

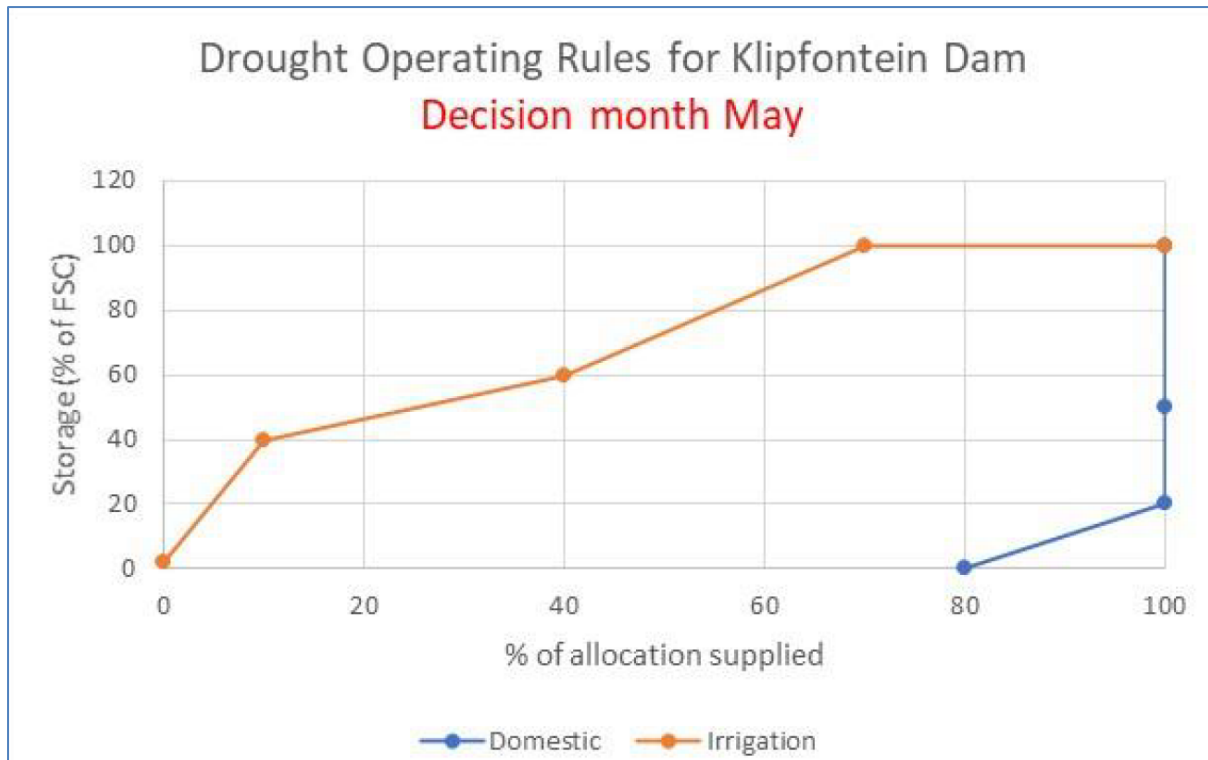


Figure 17.12 Drought operating rule for Klipfontein Dam (Vryheid supply) – May decision month (DWS, 2022)

- Mvunyane Dam sub-system:** The Mvunyane Dam is significantly stressed and should be restricted to supply only 80% of the allocated volume when the dam is full. The restriction level should be increased to 50% of the allocated volume when the dam storage volume reaches 50% FSC. When the dam level drops to 30% of FSC, the restriction level should be increased to 70% of the allocated volume (Figure 17.13).

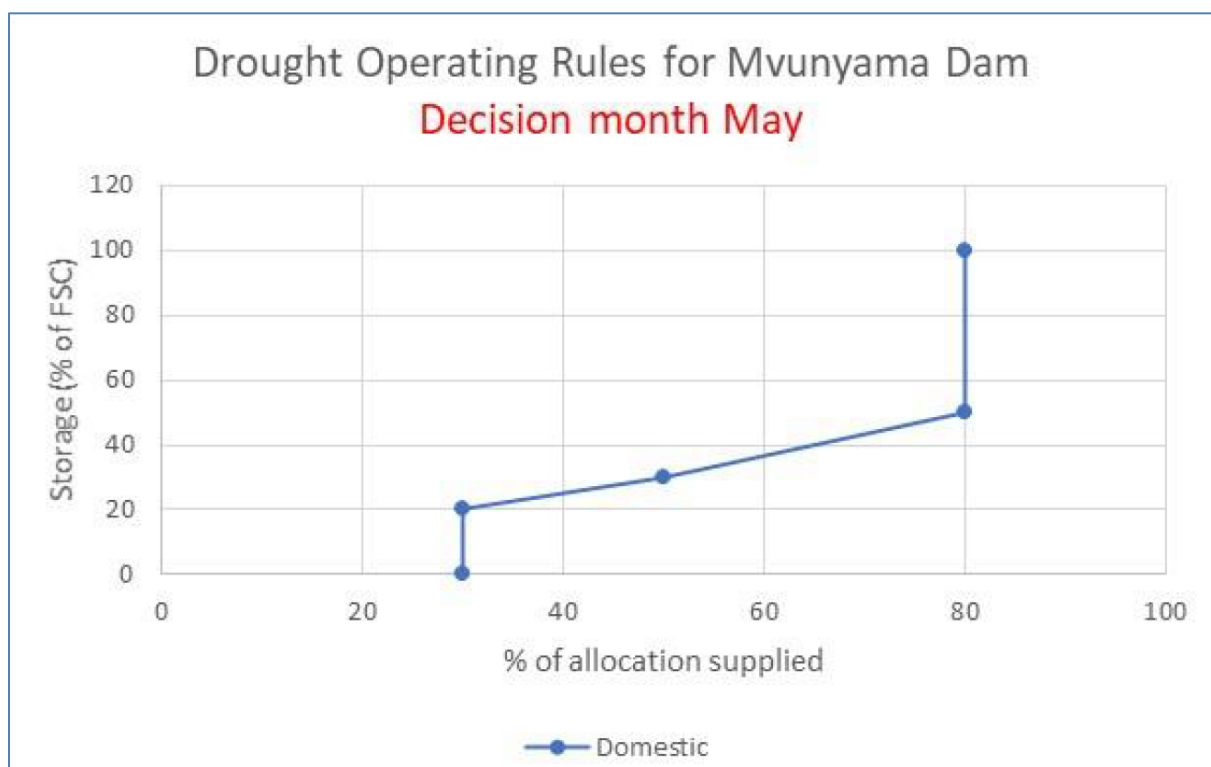


Figure 17.13 Drought operating rule for Mvunyane Dam–May decision month (DWS, 2022)

Drought operating rules and the levels at which curtailment of water supply should be initiated in the White uMfolozi River catchment depend on the water abstractions and return flows within the system. As such, water abstractions and water levels in the dams have to be monitored and recorded in order to successfully implement the developed drought operating rules.

The drought operating rules relate to water levels in the dams at the beginning of May, the decision month, and these allocate water via a simplified curve. A number of curves were developed to account for expected changes in water requirements and the expected return flows. These curves were developed for a five year period following from the year 2022. Actual water requirements and dam levels have to be used to determine the correct curve to use at the time of making a decision.

Black uMfolozi Water Supply Operating Rule

The Nongoma WSS sources its water from the Vuna Dam, which is situated in the Vuna River (a tributary of the Black uMfolozi River) and the Vokwana Dam, situated in the Vokwana River - a tributary of the Vuna River. The storage capacity of the Vokwana Dam is 1.7 million m³.

The estimated historical yield of Vuna Dam is about 2.09 million m³/annum, assuming a 50% live storage. With the current water requirements estimated to be 8.30 Mℓ/d, the availability of a reliable water supply from the Vuna System is a limiting factor to meeting the current and future water requirements of the Nongoma WSS.

Another source of surface water supply is abstraction from a weir in the Mbila River. Water from this weir is supplied to the Embile Water Treatment Plant (WTP). This scheme supplements the water supply from the Vuna WTP and supplies the communities to the east of Nongoma town. The yield available is very limited and cannot meet the water requirements of the demand centre to the east of the Nongoma WSS.

The third source of surface water supply is the run-of-river abstraction from the Nkunzinkulu River, a tributary of the Kwanhlekiswa River. This supplies the Osingisingini WTP, which has a design capacity of 60 kℓ/d (DWS, 2015).

Nongoma Water Supply System drought operating rules

The operating rules specify that abstraction should first be from the Vuna Dam as it has the smaller storage capacity. This would occur mainly during the wet periods in order to take advantage of the large MAR from the Vuna River. When the flow in the Vuna River exceeds the abstraction capacity to the WTP, water is pumped into the Vokwana Dam, which acts as a pumped storage system. The historical firm yield of the system is 2.09 million m³/annum (5.73 Mℓ/day).

If the demand at the WTP exceeds the available flows in the Vuna River and the volume available in the Vuna Dam, then water is abstracted from Vokwana Dam. This is normally during dry periods and in these instances, the Vuna and Vukwana Dams are likely to only supply a maximum of 5.5 Mℓ/day. The full 8.3 Mℓ/day WTP demand would then have to be curtailed to ensure that the dams do not deplete to dead storage. Without some form of water resource augmentation, the system will have to be placed on near-permanent curtailments (based on the current demands) (DWS, 2015).

DWS (2015) recommends the implementation of water conservation and water demand management (WCWDM) measures to reduce water losses. Such interventions could potentially save approximately 1.1 Mℓ/d (DWS, 2015). Additional water supply from the Black uMfolozi River could also be investigated using the Vokwana Dam as an off-channel storage dam. In this scenario, the raising of the Vokwana Dam should also be investigated.

Drought operating rules presented as curtailment curves related to various states of Vokwana Dam on the 1st of May are shown in **Figure 17.14**. It can be seen that the maximum target draft that can be allowed under the curtailment rules is 2.5 million m³/annum (6.8 Mℓ/day). The level of restrictions associated with each target draft, i.e. the volume allocated, are also shown. It is shown that as the storage level for the 2.5 million m³/annum target draft drops below 64%, the users are curtailed. The full target demand of 2.5 million m³/annum is only supplied for a very short period. If the target draft is 2.2 million m³/annum (6.0 Mℓ/day), curtailments are only implemented below 50% FSC, i.e. 0.86 million m³ storage in the Vokwana Dam.

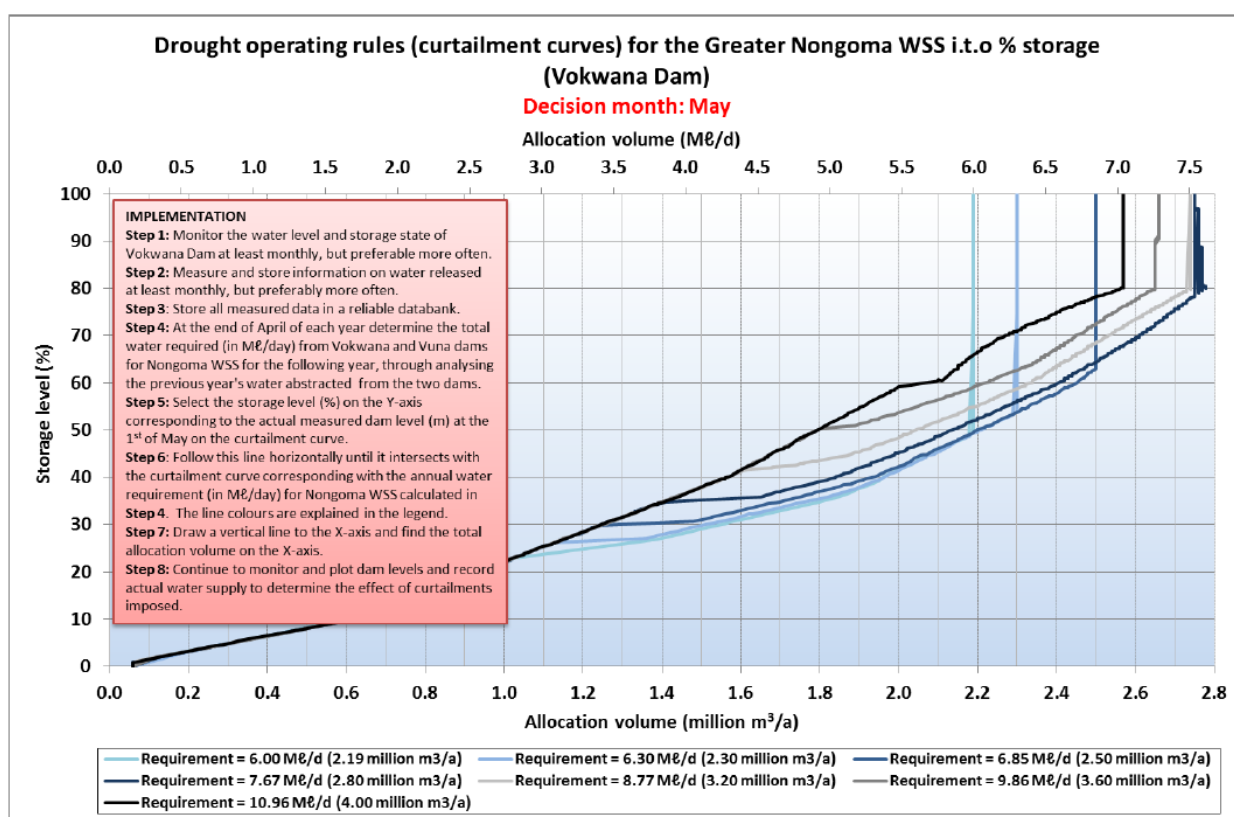


Figure 17.14 Drought operating rule for Vokwana Dam–May decision month (DWS, 2013)

17.3 Supply Systems

17.3.1 Description of the uMfolozi System

(a) Overview of the uMfolozi System

The Zululand DM is one of the 14 Water Services Authorities in the KwaZulu-Natal Province. The Zululand DM is located on the northern regions of the KwaZulu-Natal Province and covers an area of approximately 14 810 km², is bounded by Swaziland and Mpumalanga Province on the north, Amajuba DM to the west, Umkhanyakude DM to the east and Umzinyathi and King Cetshwayo

DMs to the south. Approximately half of the area is under the jurisdiction of traditional authorities while the remainder is divided between commercially owned farms and conservation areas. The District comprises the following five local municipalities as depicted in **Figure 17.15**:

- eDumbe (KZ 261)
- uPhongolo (KZ 262)
- Abaqulusi (KZ 263)
- Nongoma (KZ 265)
- Ulundi (KZ 266)

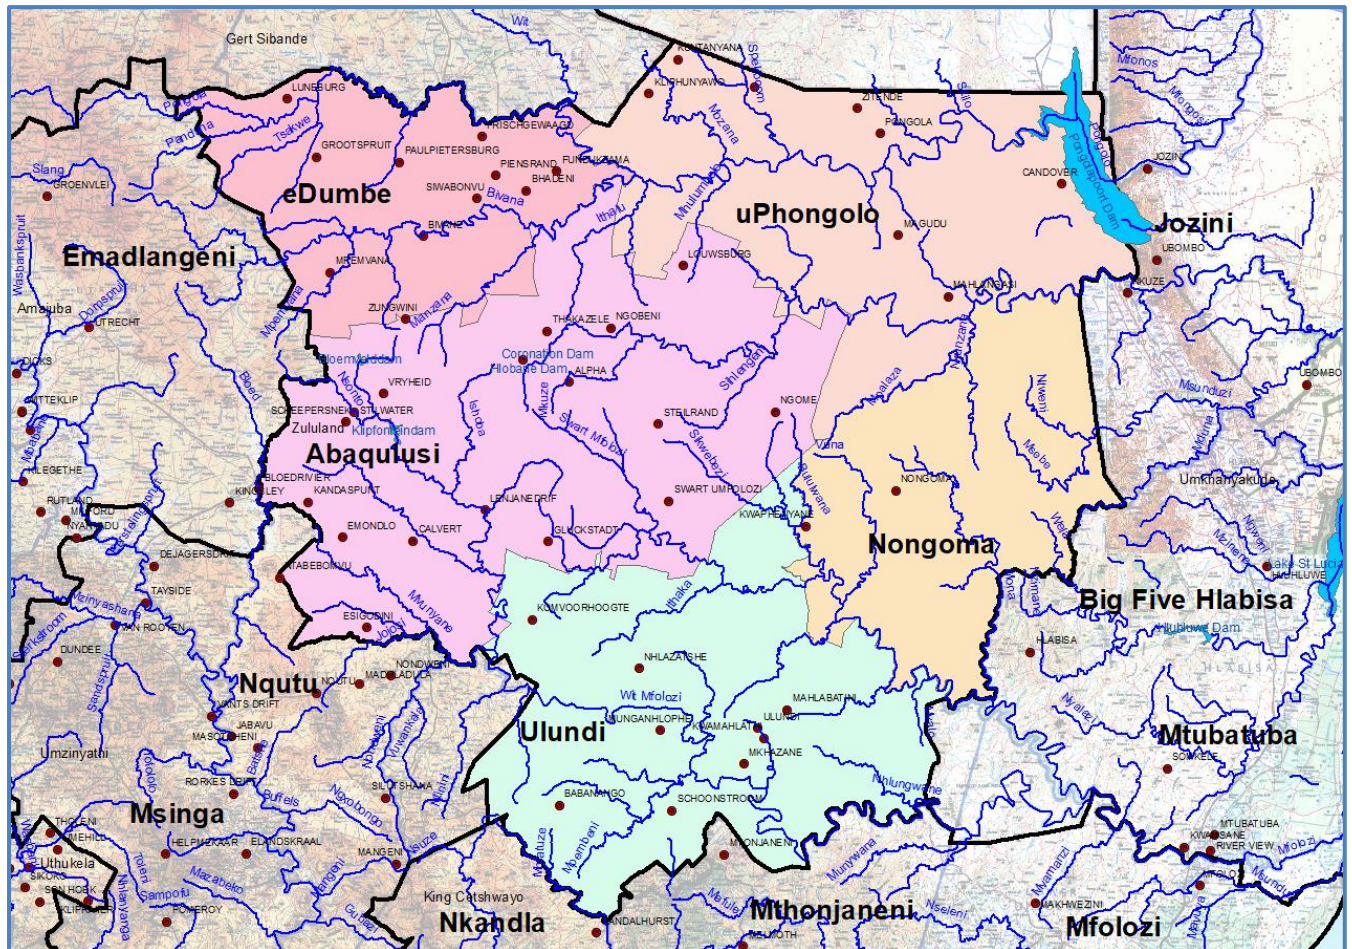


Figure 17.15 Local Municipalities in Zululand District

According to the Zululand DM WSDP 2014, the municipality falls within the uMfolozi, Mkuze and Pongola secondary catchments of the Usuthu/Mhlathuze Water Management Area (WMA). The aerial extent of the municipality occupies approximately 22% of this WMA.

This chapter will only describe the water supply systems, fed by the uMfolozi WMA and specifically water supply systems where the WTP is greater than or equal to 2 Mℓ/day. The uMfolozi Catchment consists of the White uMfolozi and the Black uMfolozi catchments. These catchments consist mostly of Traditional Authority land, with the main activity being cattle farming.

The three Local Municipalities, within the Zululand DM, that are being supplied from the White and Black uMfolozi WMA are, Abaqulusi (KZ 263), a portion of Nongoma (KZ 265) and Ulundi (KZ 266).

The uMfolozi WMA serves as a raw water resource for the following Bulk Water Supply Systems:

- Ulundi BWSS and Nkonjeni BWSS
- Vuna and Embile BWSS
- Mpugamhlophe BWSS
- Vryheid BWSS
- Usuthu/Enyonkeni BWSS
- Mondlo BWSS

(b) Nkonjeni Regional Bulk Water Supply Scheme (Ulundi, Mpungamhlophe and Nkonjeni Water Treatment Plants)

The Ulundi WTP, Mpungamhlophe WTP and the Nkonjeni WTP are combined and known as the Nkonjeni Regional Bulk Water Supply Scheme (RBWSS).

The Nkonjeni RBWSS draws raw water from a weir on the White uMfolozi River (**Figure 17.16**), which is augmented from the Klipfontein Dam, situated in the White uMfolozi River. Water is directed from the river into a canal where it is further directed to a holding chamber. The water is then pumped (**Table 17.10**) up to the WTP (**Table 17.9**). The potable water is distributed via pipelines (**Table 17.12**) to two distribution reservoirs (**Table 17.11**), namely, Reservoir 1 and Reservoir 2. Potable water is then pumped via two booster pump stations to the Mashona Reservoir in the Nkonjeni area. From there, the potable water is supplied to the Nkonjeni Reservoir and the Mahlabathini Reservoir.

Potable water from Reservoir 2 is supplied to the terminal reservoirs, namely, Site Reservoir 1, Site Reservoir 2 and Site Reservoir 4.



Figure 17.16 Aerial view of the weir and Ulundi Water Treatment Plant.

Ulundi WTP has a design capacity of 27 Mℓ/day and currently operates at an average of 22 Mℓ/day.

The characteristics of the Ulundi and Nkonjeni WTP's are shown in **Table 17.9**.

Table 17.9 Characteristics of the Ulundi/Nkonjeni WTP's.

WTP Name:	Ulundi WTP	Nkonjeni WTP
System:	Mfolozi Supply System	Mfolozi Supply System
Maximum Design Capacity:	27 Mℓ/day	300 kl/day Package Plant
Current Utilisation:	20 Mℓ/day	300 kℓ/day
Raw Water Storage Capacity:	0 Mℓ	0 MI
Raw Water Supply Capacity:	20 Mℓ/day	300 kℓ/day
Pre-Oxidation Type:	None	None
Primary Water Pre-Treatment Chemical:	Polymeric Coagulant	Polymeric Coagulant
Total Coagulant Dosing Capacity:	13 ℓ/hour (running at 50%)	13 l/hour (running at 50%)
Rapid Mixing Method:	Conventional Paddle Flash Mixer	Conventional Paddle Flash Mixer
Clarifier Type:	Sedimentation tanks	Dortmund manual clarifiers
Number of Sedimentation Tanks:	5	2
Total Area of all Clarifiers:	1225 m ²	6.28 m ²
Total Capacity of Clarifiers:	12.5 Mℓ/day	300 kℓ/day
Filter Type:	Constant Rate Rapid Gravity Filters	Pressure filter
Number of Filters:	6 (2 Old and 6 New)	1
Filter Floor Type	Laterals with Nozzles	Laterals with Nozzles
Total Filtration Area of all Filters	573.61m ²	25 m ²
Total Filtration Design Capacity of all Filters:	12.5 Mℓ/day	300 kl/day
Total Capacity of Backwash Water Tanks:	0m ³	0m ³
Total Capacity of Sludge Treatment Plant:	None	None
Capacity of Used Washwater System:	0 Mℓ/day	0 MI/day
Primary Post Disinfection Type:	Chlorine gas	Sodium Hypochlorite
Disinfection Dosing Capacity:	10 kg/hr Chlorinator	5 l NaOCl/hr
Disinfectant Storage Capacity:		
Total Treated Water Storage Capacity:	27 Mℓ	0.28 MI

The Nkonjeni WTP draws raw water from a nearby stream originating from the Nkonjeni Dam. A submersible pump located in the stream pumps the raw water to the WTP. Potable water is then pumped to the Nkonjeni Reservoir.

The Nkonjeni WTP is a 300 kl/day package plant, which was initially installed to supply the Nkonjeni hospital. The Nkonjeni area is mainly dependent on supply from the Ulundi WTP as described above.

Figure 17.17 shows an aerial view of the Nkonjeni Dam and package plant.



Figure 17.17 Aerial view of the Nkonjeni Dam and Nkonjeni Water Treatment Plant

Figure 17.18 shows a schematic layout of the Ulundi WTP Supply System.

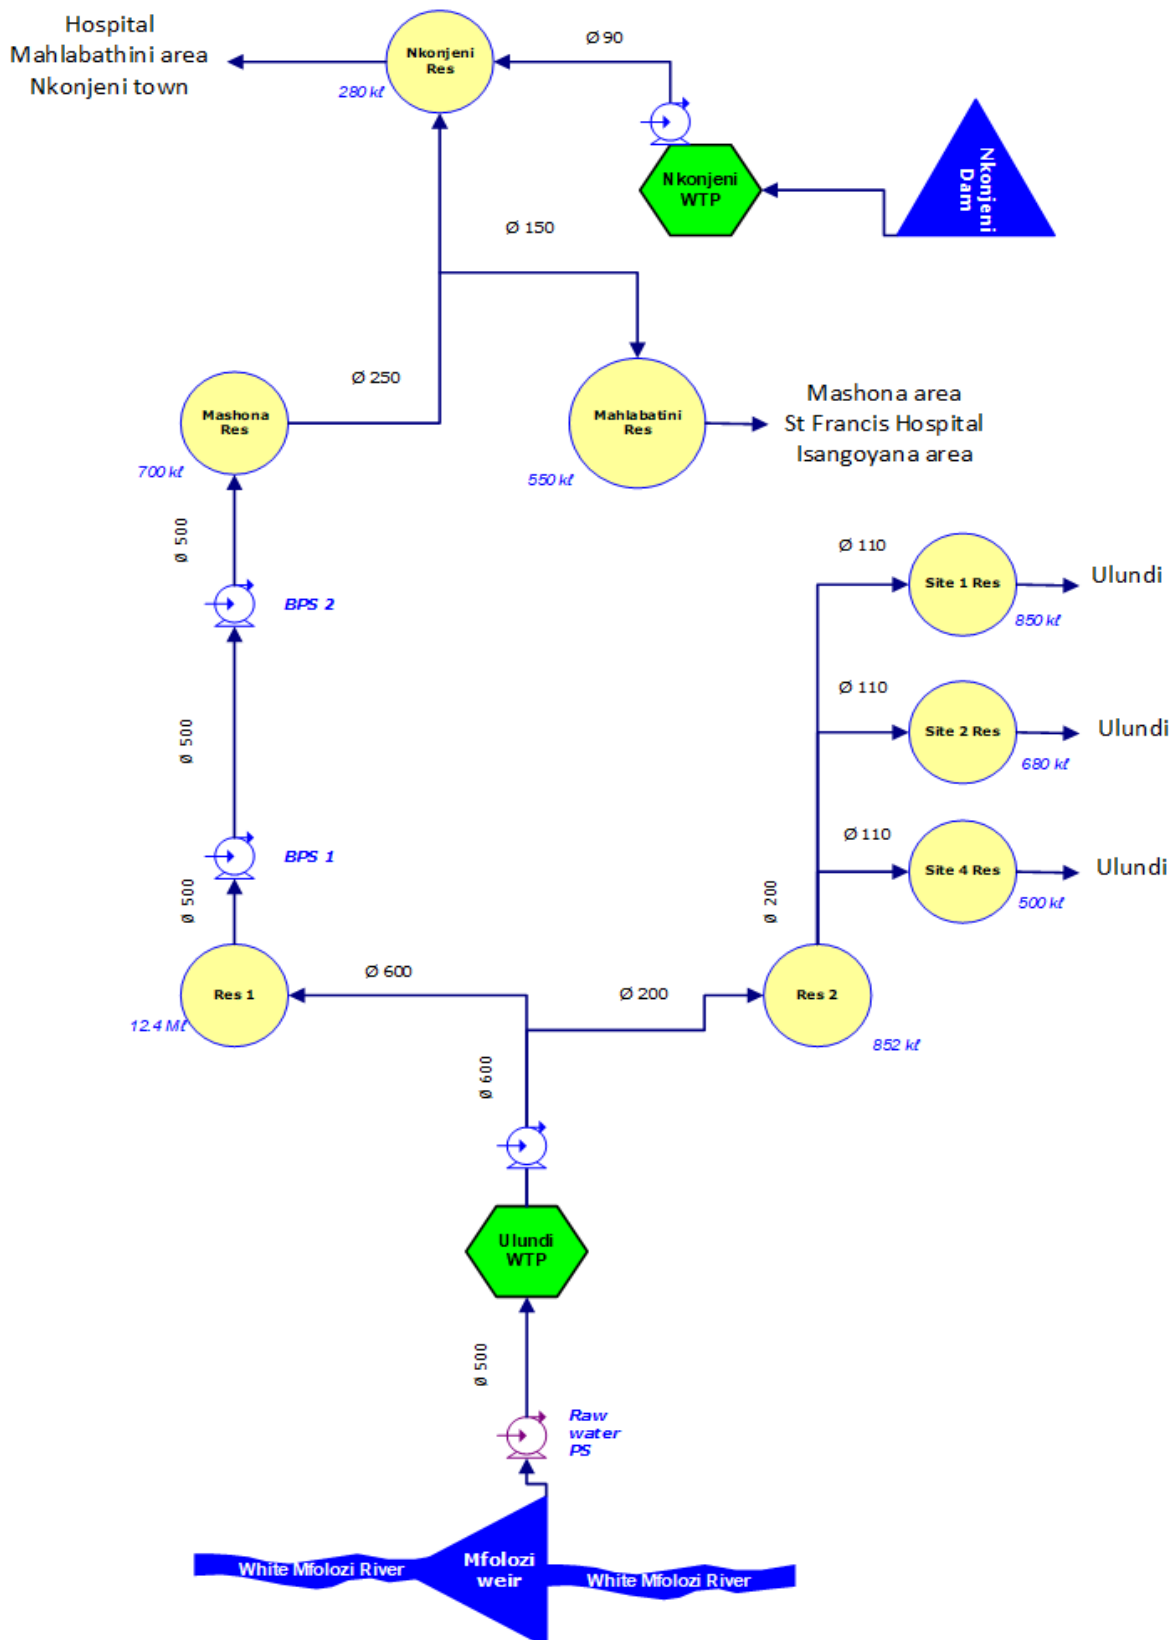


Figure 17.18 Schematic layout of the Ulundi WTP Supply System

Table 17.10 Pump details: Ulundi/Nkonjeni Supply System

System	Pump Station Name	Number of Pumps		Pump Description	Supply From	Supply To	Static Head (m)	Duty Head (m)	Duty Capacity (ML/day)
		Number of Duty Pumps	Number of Standby Pumps						
	Raw water PS	3	1	SALWEIR : SDC 125-150	Raw water channel	Ulundi WTP	23	25**	9
Ulundi/Nkonjeni	Ulundi PS	1	1	KSB MTC A 125/2-10.2 10.167	Ulundi WTP	Res 1	195	230**	6.6
Ulundi/Nkonjeni	Ulundi PS	1	1	SULZER : HZ-151-7401	Ulundi WTP	Res 2	185	210	6.7
Ulundi/Nkonjeni	BPS 1	3	1	KSB WkLn 80/3	Res 1	BPS 2	154	160**	6.6
Ulundi/Nkonjeni	BPS 2	3	1	KSB WkLn 80/3	BPS 2	Mashona Res	146	155**	6.6
Ulundi/Nkonjeni	Nkonjeni PS	1	1	Ebara MD40-125/2.2	Nkonjeni WTP	Nkonjeni Res	105	110**	0.32

- ** These figures are based on calculated head loss

Table 17.11 Reservoir details: Ulundi/Nkonjeni RBWSS.

System	Reservoir Site	Reservoir Name	Capacity (Mℓ)	Function	TWL (aMSL)	FL (aMSL)
Ulundi/Nkonjeni	Ulundi/Nkonjeni	Res 1	6.6	Distribution	731	727*
Ulundi/Nkonjeni	Ulundi/Nkonjeni	Res 2	0.684	Distribution	684	679*
Ulundi/Nkonjeni	Ulundi/Nkonjeni	Mashona Res	0.700	Terminal	1031	1026*
Ulundi/Nkonjeni	Ulundi/Nkonjeni	Site Res 1	0.850	Terminal	1014	1011
Ulundi/Nkonjeni	Ulundi/Nkonjeni	Site Res 2	0.680	Terminal	820	817
Ulundi/Nkonjeni	Ulundi/Nkonjeni	Site Res 4	0.250	Terminal	511	506*
Ulundi/Nkonjeni	Ulundi/Nkonjeni	Nkonjeni Res	0.280	Terminal	976	972*
Ulundi/Nkonjeni	Ulundi/Nkonjeni	Mahlabathini Res	0.550	Terminal	845	841*

*These figures are estimates and must be verified.

Table 17.12 Pipeline details: Ulundi/Nkonjeni RBWSS.

System	Pipeline Name	From	To	Length (km)	Nominal Diameter (mm)	Material	Capacity (Ml/day)	Age (years)
Ulundi/Nkonjeni	Raw water pipeline	Raw Water PS	Ulundi WTP	0.234	500	Steel	25.446**	43#
Ulundi/Nkonjeni	Potable water pipeline	Ulundi WTP	Res 1	1.758	600	Steel	36.6**	43
Ulundi/Nkonjeni	Potable water pipeline	Ulundi WTP	Res 2	4.461	600/200	Steel/uPVC	4.07**	43
Ulundi/Nkonjeni	Potable water pipeline	Res 1	BPS 2	4.37	500	Steel	25.446**	43
Ulundi/Nkonjeni	Potable water pipeline	BPS 2	Mashona Res	2.097	500	Steel	25.446**	43
Ulundi/Nkonjeni	Potable water pipeline	Res 2	Site Res 1	6.234	110	uPVC	1.6*	43
Ulundi/Nkonjeni	Potable water pipeline	Res 2	Site Res 2	1.384	110	uPVC	1.6*	43
Ulundi/Nkonjeni	Potable water pipeline	Res 2	Site Res 4	6.682	110	uPVC	1.6*	43
Ulundi/Nkonjeni	Potable water pipeline	Mashona Res	Nkonjeni Res	6.552	90	uPVC	0.82*	43
Ulundi/Nkonjeni	Potable water pipeline	Mashona Res	Mahlabathini Res	13.037	150	uPVC	3.05*	43

* Based on a velocity of 2 m/s

** Based on a velocity of 1.5 m/s # Age need to be verified

The Mpungamhlophe WTP (**Figure 17.19, Table 17.13**), a package plant with a design capacity of 1.9 Mℓ/day, draws raw water from the White uMfolozi River which is adjacent to the treatment works. A submersible pump abstracts raw water from the river and pumps this into a raw water storage chamber via a flow meter.

From the WTP, potable water is pumped (**Table 17.14**) through a rising main (**Table 17.16**) to two Command Reservoirs (**Table 17.15**) from where it is distributed to the community (**Figure 17.20**).

Figure 17.19 shows an aerial view of the Mpungamhlophe Package Plant



Figure 17.19 An Aerial view of the Mpungamhlophe WTP (Google Earth 2020: website).

Table 17.13 Characteristics of the Mpungamhlope WTP

WTP Name:	Mpungamhlope WTP
System:	Mfolozi Supply System
Maximum Design Capacity:	1.9 Mℓ/day
Current Utilisation:	1.9 Mℓ/day
Raw Water Storage Capacity:	0 Mℓ
Raw Water Supply Capacity:	1.9 Mℓ/day
Pre-Oxidation Type:	None
Primary Water Pre-Treatment Chemical:	Polymeric Coagulant
Total Coagulant Dosing Capacity:	2 ℓ/hour
Rapid Mixing Method:	Conventional Paddle Flash Mixer
Clarifier Type:	Manual Clarifiers
Number of Clarifiers:	6
Total Area of all Clarifiers:	63.61 m ²
Total Capacity of Clarifiers:	1.9 Mℓ/day
Filter Type:	Pressure filters
Number of Filters:	3
Filter Floor Type	
Total Filtration Area of all Filters	5.3 m ²
Total Filtration Design Capacity of all Filters:	1.9 Mℓ/day
Total Capacity of Backwash Water Tanks:	0m ³
Total Capacity of Sludge Treatment Plant:	None
Capacity of Used Washwater System:	0 Mℓ/day
Primary Post Disinfection Type:	Chlorine gas
Disinfection Dosing Capacity:	10 kg/hr Chlorinator
Disinfectant Storage Capacity:	
Total Treated Water Storage Capacity:	2 Mℓ

Figure 17.20 shows schematic of the Mpungamhlope Supply System.

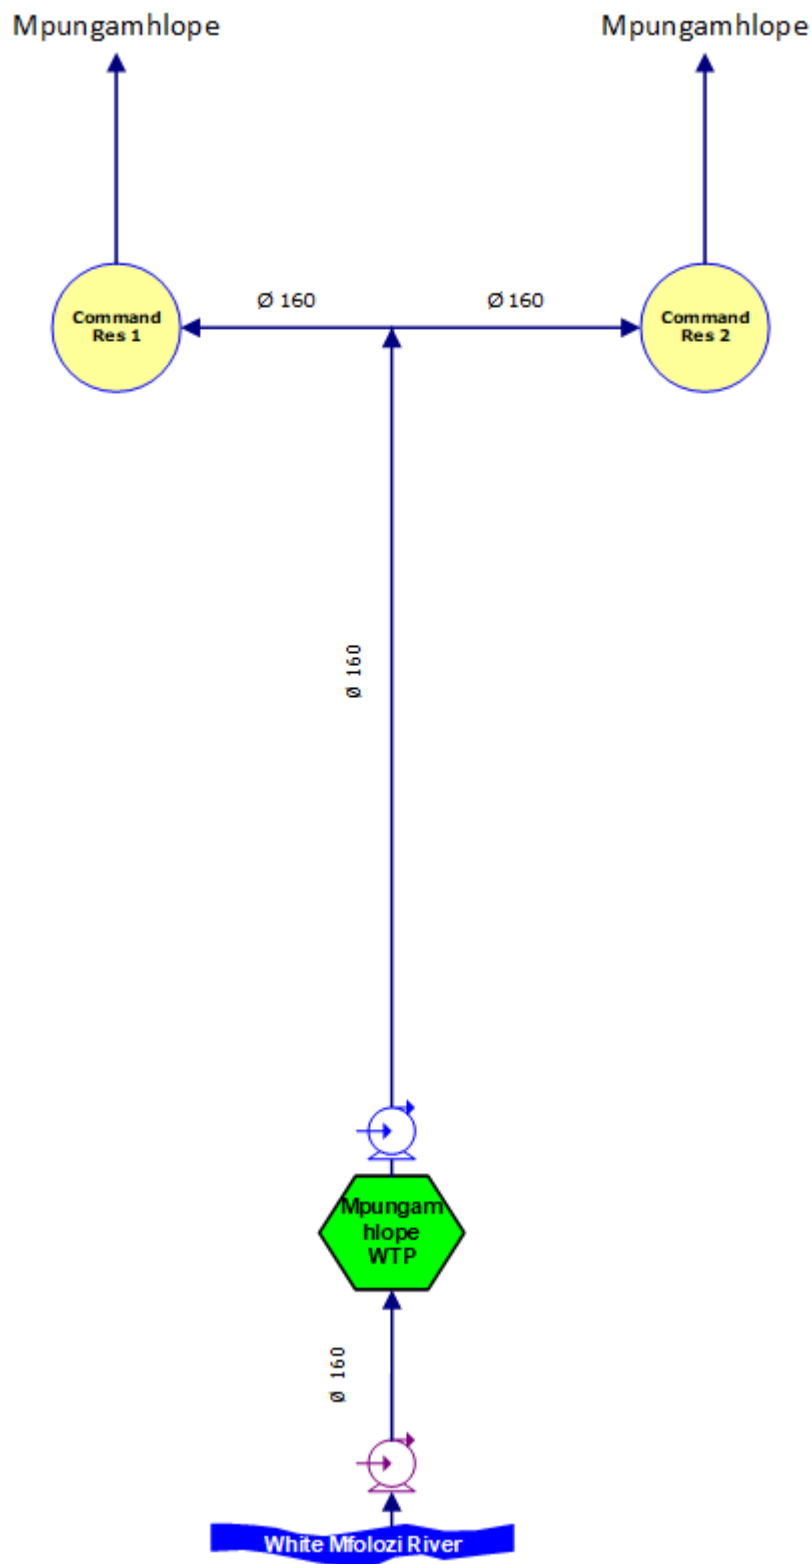


Figure 17.20 Schematic of the Mpungamhlope Supply System

Table 17.14 Pump details: Mpungamhlope Supply System

System	Pump Station Name	Number of Pumps		Pump Description	Supply From	Supply To	Static Head (m)	Duty Head (m)	Duty Capacity (Mℓ/day)
		Number of Duty Pumps	Number of Standby Pumps						
Mpungamhlope	Raw water PS	1	0	Xylem 7.5hp	Raw water channel	Mpungamhlope WTP	8	15**	1
Mpungamhlope	Vuna PS	2	2	Franklin -Mono HD 115H Mk2	Mpungamhlope WTP	Command Res 1 & 2	154	170**	1

- ** These figures are based on calculated head loss

Table 17.15 Reservoir details: Mpungamhlope BWSS.

System	Reservoir Site	Reservoir Name	Capacity (Mℓ)	Function	TWL (aMSL)	FL (aMSL)
Mpungamhlope	Mpungamhlope	Command Res 1	1.0	Distribution	764	761*
Mpungamhlope	Mpungamhlope	Command Res 2	0.2	Distribution	764	761*

*These figures are estimates and must be verified

Table 17.16 Pipeline details: Mpungamhlope BWSS.

System	Pipeline Name	From	To	Length (km)	Nominal Diameter (mm)	Material	Capacity (Mℓ/day)	Age (years)
Mpungamhlope	Raw water pipeline	Raw Water PS	Mpungamhlope WTP	0.070	160	uPVC	2.6**	42#
Mpungamhlope	Raw water pipeline	Mpungamhlope WTP	Command Res 1	3.074	160	uPVC	2.6**	42#
Mpungamhlope	Potable water pipeline	Mpungamhlope WTP	Command Res 2	3.074	160	uPVC	2.6**	42#

Based on a velocity of 2 m/s ** Based on a velocity of 1.5 m/s # Age need to be verified

(c) Usuthu Regional Bulk Water Supply Scheme (RBWSS)

The Usuthu RBWSS is the largest water supply scheme in the Zululand District and supplies almost the entire Nongoma LM and also represents the biggest portion of the backlogs.

The Usuthu RBWSS is a combination of three bigger (>2MI/day) water treatment plants and two smaller (<2MI/day) WTP's namely:

- Vuna WTP (4.5 MI/day)
- Usuthu WTP (20 MI/day)
- Ceza WTP (3 MI/day)
- Thulasizwe WTP (0.16 MI/day)
- Osingisingini WTP (0.04 MI/day)

This section will only consider the first three WTP's.

The Usuthu WTP (**Figure 17.21, Table 17.17**), a package plant with a design capacity of 4.0 Ml/day and upgraded in 2016 to 20 MI/day, draws raw water from a weir on the Black uMfolozi River adjacent to the treatment works. A submersible pump abstracts raw water from the river and pumps this to a raw water storage chamber.

From the WTP, potable water is pumped (**Table 17.18**) through a rising main (**Table 17.20**) to the Mjeni Balancing Tank (**Table 17.19**) from where it is distributed to the community (**Figure 17.22**).

Figure 17.21 shows an aerial view of the Usuthu WTP.

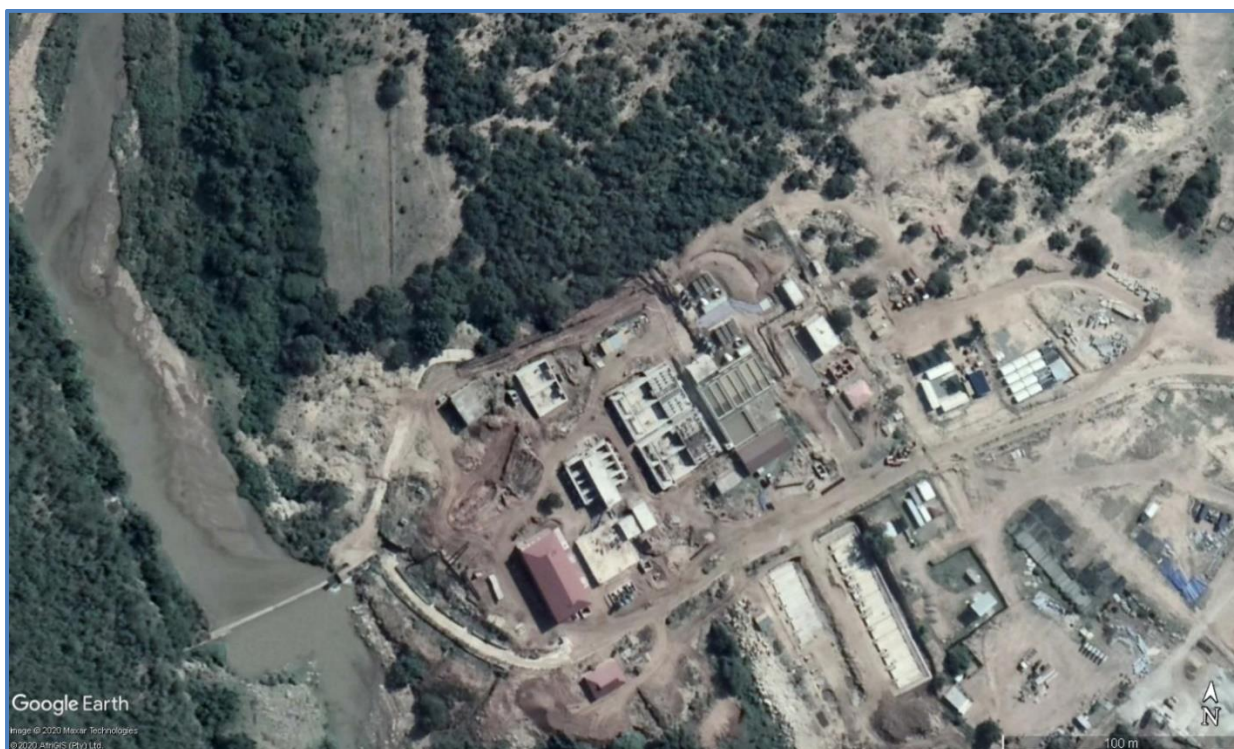


Figure 17.21 An Aerial view of the Usuthu WTP (Google Earth 2020: website).

Table 17.17 Characteristics of the Usuthu/Enyonkeni WTP's.

WTP Name:	Usuthu WTP	Enyonkeni WTP
System:	Mfolozi Supply System	Mfolozi Supply System
Maximum Design Capacity:	20 Mℓ/day	300 kℓ/day
Current Utilisation:	18 Mℓ/day	300 kℓ/day
Raw Water Storage Capacity:	0 Mℓ	0 MI
Raw Water Supply Capacity:	20 Mℓ/day	300 kℓ/day
Pre-Oxidation Type:	None	None
Primary Water Pre-Treatment Chemical:	Polymeric Coagulant	Polymeric Coagulant
Total Coagulant Dosing Capacity:	5 ℓ/hour	3 ℓ/hour
Rapid Mixing Method:	Conventional Paddle Flash Mixer	Conventional Paddle Flash Mixer
Clarifier Type:	Manual Clarifiers	Manual Clarifiers
Number of Sedimentation Tanks:	8	2
Total Area of all Clarifiers:	66 m ²	12.48 m ²
Total Capacity of Clarifiers:	20 Mℓ/day	300 kℓ/day
Filter Type:	Pressure Filters	Pressure Filters
Number of Filters:	8	4
Filter Floor Type	Laterals with Nozzles	Laterals with Nozzles
Total Filtration Area of all Filters	28 m ²	4.56 m ²
Total Filtration Design Capacity of all Filters:	20 Mℓ/day	300 kℓ/day
Total Capacity of Backwash Water Tanks:	0m ³	0m ³
Total Capacity of Sludge Treatment Plant:	None	None
Capacity of Used Washwater System:	0 Mℓ/day	0 Mℓ/day
Primary Post Disinfection Type:	Chlorine gas	Sodium Hypochlorite
Disinfection Dosing Capacity:	10 kg/hr Chlorinator	5 l NaOCl/hr
Disinfectant Storage Capacity:		
Total Treated Water Storage Capacity:	12 Mℓ	0.28 MI

Figure 17.22 shows schematic of the Usuthu Supply System

Table 17.18 Pump details: Usuthu Supply System

System	Pump Station Name	Number of Pumps		Pump Description	Supply From	Supply To	Static Head (m)	Duty Head (m)	Duty Capacity (ML/day)
		Number of Duty Pumps	Number of Standby Pumps						
Usuthu	Raw water PS	2	1	KSB LCC 150-500.3	Raw water channel	Usuthu WTP	11	15**	8
Usuthu	Nongoma HL PS	2	1	KSB WKLn 150/6	Usuthu WTP	Mahlombe PS	220	280**	6.912
Usuthu	Mahlombe PS	2	4	KSB WKLn 150/5	Nongoma HL PS	Vuna WTP	202	230**	6.912
Usuthu BWSS	Mjeni HL PS	3	1	KSB WKLn 65/4	Usuthu WTP	Mjeni PS	146	165	1.56
Usuthu	Mjeni PS	3	1	KSB WKLn 65/4	Mjeni HL PS	Mjeni Reservior	162	180**	2.04
Usuthu BWSS	Mahhashini PS1	2	1	KSB WKLn 65/4	Mjeni Reservior	Mahhashini PS2	150	180	1.5

- ** These figures are based on calculated head loss

Table 17.19 Reservoir details: Usuthu BWSS.

System	Reservoir Site	Reservoir Name	Capacity (Mℓ)	Function	TWL (aMSL)	FL (aMSL)
Usuthu	Usuthu	Mjeni Res	2.0	Balancing	401	397*
Usuthu	Usuthu	Res A	2.0	Distribution	536	532*
Usuthu	Usuthu	Res B1	0.5	Terminal	534	531*
Usuthu	Usuthu	Res B2	0.2	Terminal	515	512*
Usuthu	Usuthu	Res B3	0.3	Terminal	497	494*
Usuthu	Usuthu	Res B4	0.3	Terminal	467	464*
Usuthu	Usuthu	Res B5	1.5	Distribution	494	491*
Usuthu	Usuthu	Res B6	0.1	Terminal	498	495*

*These figures are estimates and must be verified

Table 17.20 Pipeline details: Usuthu BWSS.

System	Pipeline Name	From	To	Length (km)	Nominal Diameter (mm)	Material	Capacity (Ml/day)	Age (years)
Usuthu	Raw water pipeline	Raw Water PS	Usuthu WTP	0.070	350	Steel	12.46**	43
Usuthu	Raw water pipeline	Usuthu WTP	Mjeni Balancing Tank	2.486	250	Steel	6.36**	43
Usuthu	Potable water pipeline	Mjeni Balancing Tank	Res A and B1	0.876	200	Steel	6.36**	43
Usuthu	Potable water pipeline	Res A	Res B2	2.291	200	Steel	6.36	43
Usuthu	Potable water pipeline	Res A	Res B3	8.171	200/110	mPVC	1.64*	43
Usuthu	Potable water pipeline	Res A	1Res B4	8.144	200/110	mPVC	1.64*	43
Usuthu	Potable water pipeline	Res A	Res B5	10.544	200/110	mPVC	1.64*	43
Usuthu	Raw water pipeline	Raw water PS	Enyonkeni WTP	1.5	90	uPVC	0.082**	43
Usuthu	Potable water pipeline	Enyonkeni WTP	Res B5 and the Palace	0.057	90	uPVC	0.082**	43

Based on a velocity of 2 m/s

** Based on a velocity of 1.5 m/s # Age need to be verified

Vuna WTP (**Table 17.21**) is located approximately 12 km southwest of the town of Nongoma and supplies potable water to Nongoma and the neighbouring rural settlements in Vuna. Vuna WTP, with a capacity of 5 Mℓ/day, obtains its raw water from the Vuna and Vokwane Dams where it is treated at the WTP. From the WTP, potable water is pumped (**Table 17.22**) via a rising main (**Table 17.24**) to the Holinyoka BPS and then to the Lindizwe BPS and further boosted to the FM Tower Reservoir (**Table 17.23**). From there, it is gravity fed to the White City Reservoir and Canaan Pump Station and finally to the Elevated Reservoir where it supplies different parts of Nongoma (**Figure 17.25**).

The capacity of the system is supplemented by the Embile WTP (**Figure 17.24**), which obtains its raw water from the Embile Dam.

Figure 17.23 shows an aerial view of the Vuna WTP and the Vuna Dam.

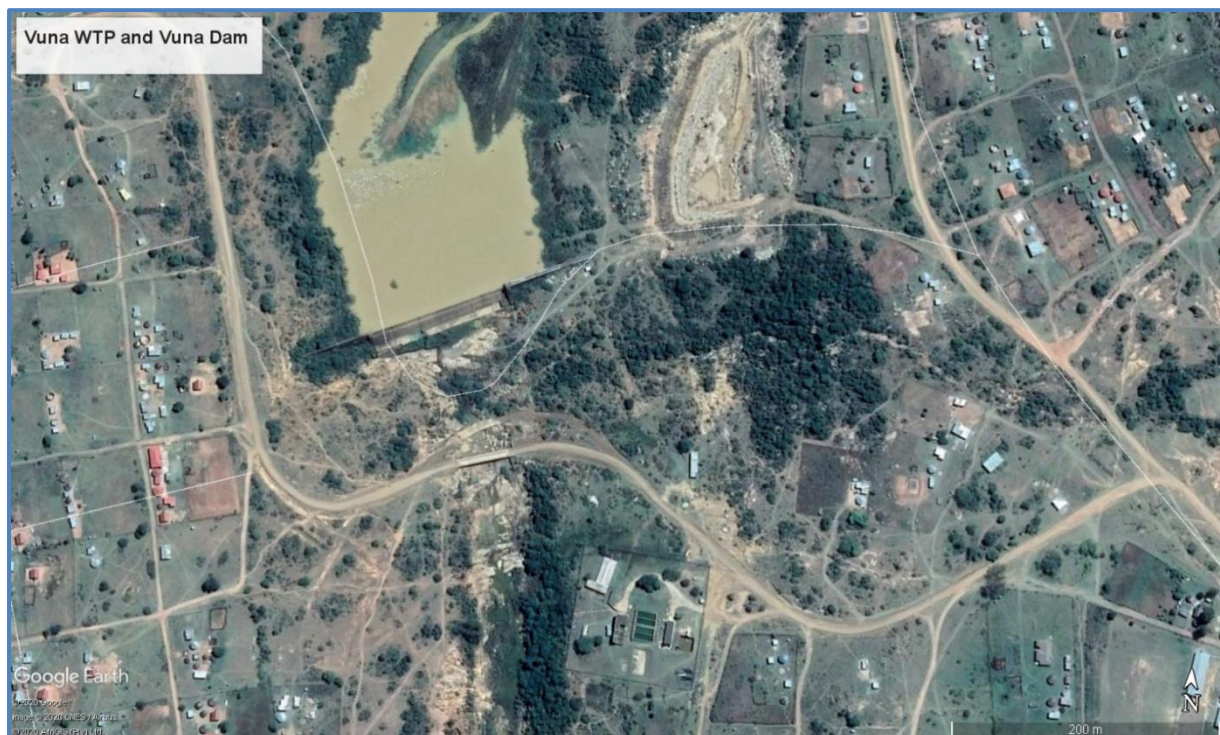


Figure 17.23 An Aerial view of the Vuna WTP and the Vuna Dam (Google Earth 2020: website).

Figure 17.24 shows an aerial view of the Embile WTP and the Embile Dam.



Figure 17.24 An Aerial view of the Embile WTP and the Embile Dam (Google Earth 2020: website).

Table 17.21 Characteristics of the Vuna/Embile WTP's.

WTP Name:	Vuna WTP	Embile WTP
System:	Mfolozi Supply System	Mfolozi Supply System
Maximum Design Capacity:	5 Mℓ/day	500 kℓ/day
Current Utilisation:	4.5 Mℓ/day	500 kℓ/day
Raw Water Storage Capacity:	0 Mℓ	0 MI
Raw Water Supply Capacity:	5 Mℓ/day	300 kl/day
Pre-Oxidation Type:	None	None
Primary Water Pre-Treatment Chemical:	Polymeric Coagulant	Polymeric Coagulant
Total Coagulant Dosing Capacity:	13 ℓ/hour (running at 50%)	13 l/hour (running at 50%)
Rapid Mixing Method:	Conventional Paddle Flash Mixer	Conventional Paddle Flash Mixer
Clarifier Type:	Sedimentation tanks	Sedimentation Tanks
Number of Sedimentation Tanks:	4	2
Total Area of all Clarifiers:	336.36 m ²	35.12 m ²
Total Capacity of Clarifiers:	5 Mℓ/day	300 kl/day
Filter Type:	Constant Rate Rapid Gravity Filters	Pressure filter
Number of Filters:	3	4
Filter Floor Type	Laterals with Nozzles	Laterals with Nozzles
Total Filtration Area of all Filters	51.74 m ²	5.35 m ²
Total Filtration Design Capacity of all Filters:	5 Mℓ/day	500 kℓ/day
Total Capacity of Backwash Water Tanks:	0m ³	0m3
Total Capacity of Sludge Treatment Plant:	None	None
Capacity of Used Washwater System:	0 Mℓ/day	0 MI/day
Primary Post Disinfection Type:	Chlorine gas	Sodium Hypochlorite
Disinfection Dosing Capacity:	10 kg/hr Chlorinator	5 l NaOCl/hr
Disinfectant Storage Capacity:		
Total Treated Water Storage Capacity:	27 Mℓ	0.28 MI

Figure 17.25 shows schematic of the Vuna/Embile Supply System.

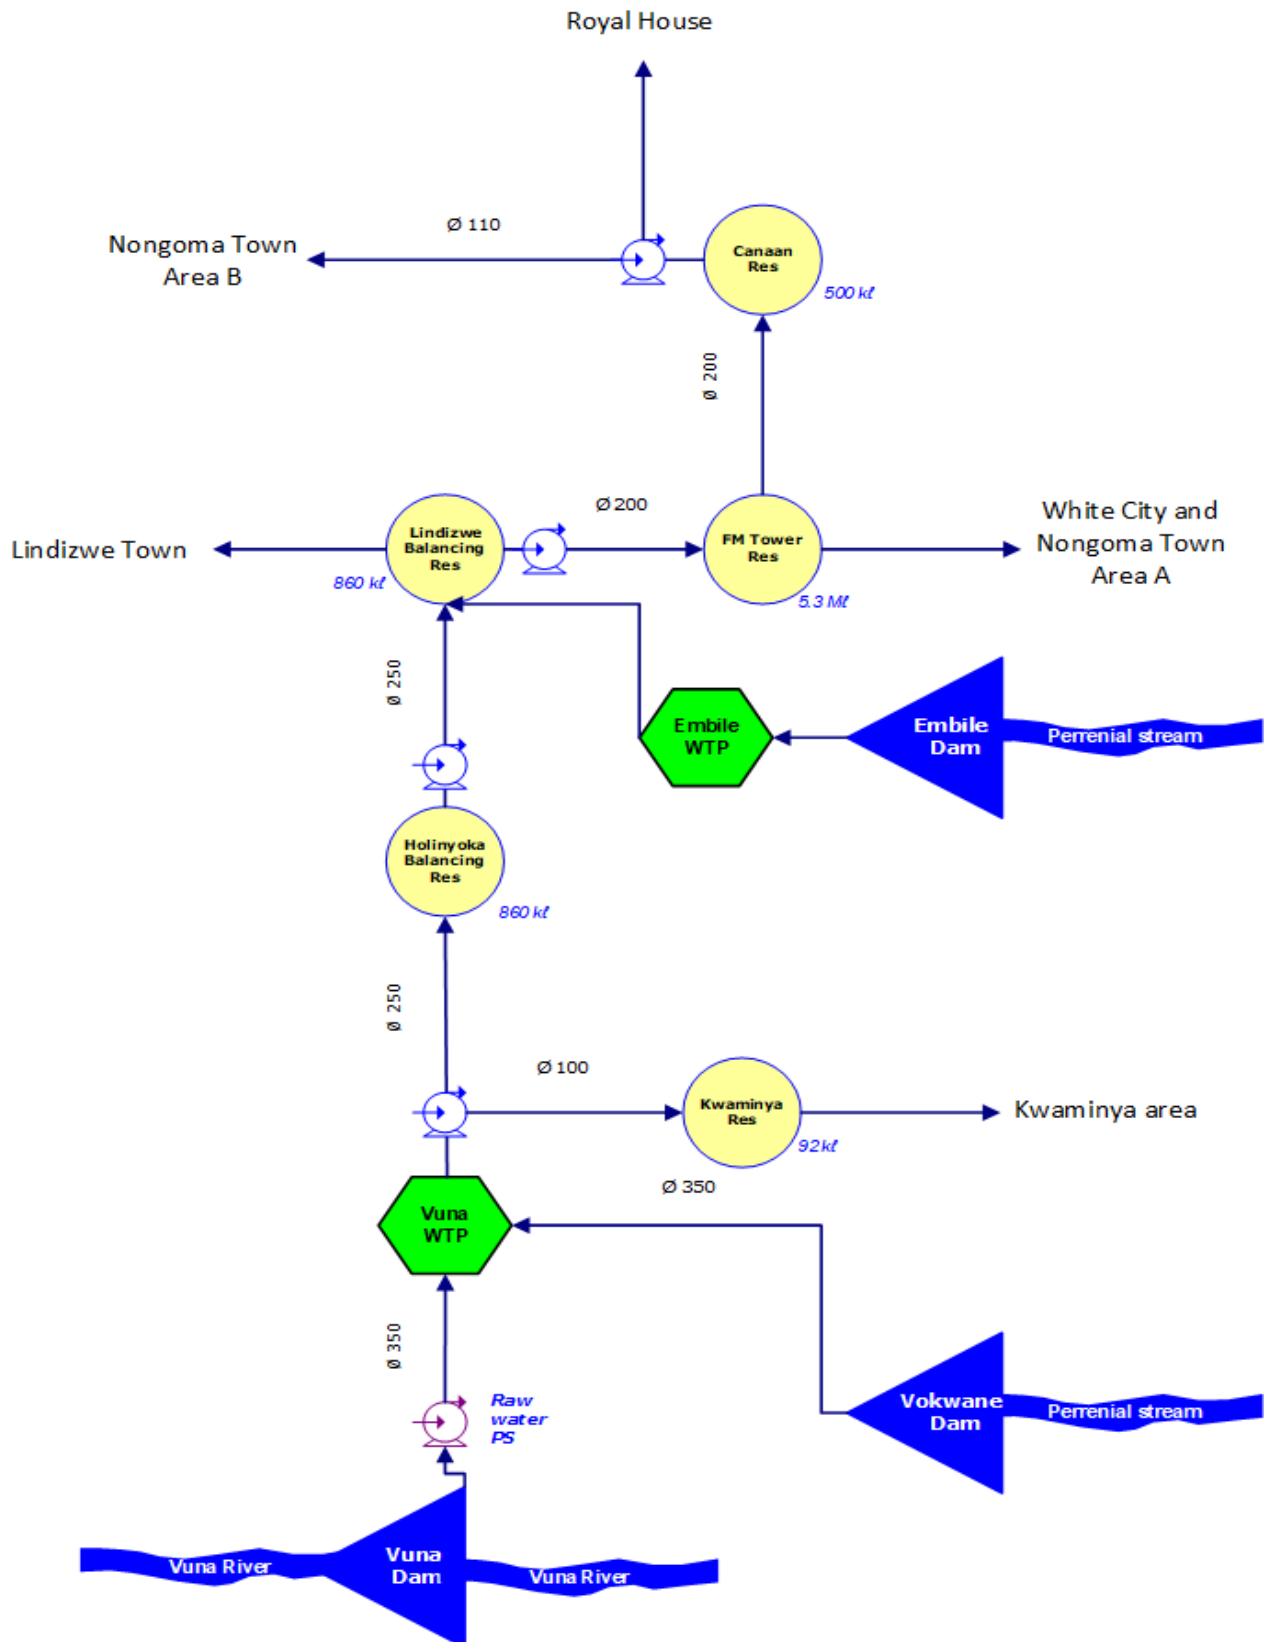


Figure 17.25 Schematic of the Vuna/Embile Supply System

Table 17.22 Pump details: Vuna/Embile Supply System

System	Pump Station Name	Number of Pumps		Pump Description	Supply From	Supply To	Static Head (m)	Duty Head (m)	Duty Capacity (Mℓ/day)
		Number of Duty Pumps	Number of Standby Pumps						
Vuna/Embile	Raw water PS	3	1		Raw water channel	VunaWTP	23	25**	9
Vuna/Embile	Vuna HL PS	2	1	SAMCO PUMPS LTF 100-125/9	Vuna WTP	Holinyonka Res	171	180**	9
Vuna/Embile	Holinyonka BPS	2	1	SAMCO PUMPS LTF 100-125/9	Holinyonka Res	Lindizwe Res	154	160**	8
Vuna/Embile	Lindizwe BPS	2	1	SAMCO PUMPS M10 VTLC 11 STAGE	Lindizwe Res	FM Tower Res	146	155**	8
Vuna/Embile	CanaanPS	1	1	Cemo Pumps HP 115& MONO HD155M	FM Tower Res	Nongoma Town and Royal House	105	110**	0.32

- ** These figures are based on calculated head loss

Table 17.23 Reservoir details: Vuna/Embile BWSS.

System	Reservoir Site	Reservoir Name	Capacity (Mℓ)	Function	TWL (aMSL)	FL (aMSL)
Vuna/Embile	Vuna/Embile	Holinyonka Res	1.0	Distribution	731	727*
Vuna/Embile	Vuna/Embile	Lindizwe Res	1.0	Distribution	684	679*
Vuna/Embile	Vuna/Embile	Kwaminy Res	0.092	Terminal	1031	1026*
Vuna/Embile	Vuna/Embile	FM Tower Res	5.3	Distribution	1014	1011
Vuna/Embile	Vuna/Embile	Canaan Res	0.2	Terminal	820	817

*These figures are estimates and must be verified

Table 17.24 Pipeline details: Vuna/Embile BWSS.

System	Pipeline Name	From	To	Length (km)	Nominal Diameter (mm)	Material	Capacity (Mℓ/day)	Age (years)
Vuna/Embile	Raw water pipeline	Raw Water PS	Vuna WTP	0.355	350	Steel	12.46**	43
Vuna/Embile	Raw water pipeline	Vokwane Dam	Vuna WTP	2.038	350	Steel	16.62*	43
Vuna/Embile	Potable water pipeline	Vuna WTP	Holinyonka Res	6.843	250	Steel	6.36**	43
Vuna/Embile	Potable water pipeline	Holinyonka Res	Lindizwe Res	3.687	250	Steel	6.36**	43
Vuna/Embile	Potable water pipeline	Lindizwe Res	FM Tower Res	4.297	200	Steel	4.07**	43
Vuna/Embile	Potable water pipeline	FM Tower Res	Canaan Res	3.175	200	uPVC	5.42*	43
Vuna/Embile	Potable water pipeline	Vuna WTP	Kwaminy Res	5.351	100	Steel	1.01**	43

* Based on a velocity of 2 m/s

** Based on a velocity of 1.5 m/s

Age need to be verified

(d) Hlahlindlela Regional Bulk Water Supply System (RBWSS)

The Hlahlindlela RBWSS supplies water to communities within the AbaQulusi LM. The Hlahlindlela RBWSS consist of two water supply schemes namely:

- Vryheid Water Supply Scheme
- eMondlo Water Supply Scheme

Vryheid BWSS consists of two WTP's (**Figure 17.28**), namely the 7.5 Mℓ/day Bloemveld WTP (**Figure 17.26**) and the 16 Mℓ/day Klipfontein WTP (**Figure 17.27**) (**Table 17.25**). Both these WTP's source raw water from the White uMfolozi River via the Bloemveld Dam and the Klipfontein Dam respectively.

a) Bloemveld WTP

The Bloemveld WTP is located about 15km west of the town of Vryheid and is between Paulpietersburg and Vryheid in Zululand DM.

The Bloemveld WTP receives raw water from the Bloemveld Dam with the aid of abstraction pumps located at the dam. The water treatment process begins as soon as the raw water enters the treatment plant.



Figure 17.26 An Aerial view of the Bloemveld WTP (Google Earth 2020: website).

b) Klipfontein WTP

The Klipfontein WTP is located south of the town of Vryheid in Zululand District DM. The WTP primarily receives raw water that is pumped from the Klipfontein Dam. Raw water is also supplemented from

the Bloemveld Dam when needed. The two dams work hand-in-hand to supply the town of Vryheid and surrounding areas with water through a series of pump stations (**Table 17.26**), pipelines (**Table 17.27**) and reservoirs (**Table 17.28**). Located at each dam is a pump station that pumps the water to the WTP. The water treatment process begins as soon as the raw water enters the treatment plant.



Figure 17.27 An Aerial view of the Klipfontein WTP (Google Earth 2020: website).

Table 17.25 Characteristics of the Bloemveld/Klipfontein WTP's.

WTP Name:	Bloemveld WTP	Klipfontein WTP
System:	Mfolozi Supply System	Mfolozi Supply System
Maximum Design Capacity:	7.5 Mℓ/day	16 Mℓ/day
Current Utilisation:	7.5 Mℓ/day	16 Mℓ/day
Raw Water Storage Capacity:	0 Mℓ	0 MI
Raw Water Supply Capacity:	7.5 Mℓ/day	17 Mℓ/day
Pre-Oxidation Type:	None	None
Primary Water Pre-Treatment Chemical:	Polymeric Coagulant	Polymeric Coagulant
Total Coagulant Dosing Capacity:	13 ℓ/hour	13 ℓ/hour
Rapid Mixing Method:	Conventional Paddle Flash Mixer	Conventional Paddle Flash Mixer
Clarifier Type:	Dortmund Manual Clarifiers	Dortmund Manual Clarifiers
Number of Clarifiers:	5 (3 rectangular and 2 circular)	4 circular bridge clarifiers
Total Area of all Clarifiers:	579.98 m ²	1844.34 m ²
Total Capacity of Clarifiers:	7.5 Mℓ/day	16 Mℓ/day
Filter Type:	Gravity Sand Filters	Gravity Sand Filters
Number of Filters:	11	12
Filter Floor Type	Laterals with Nozzles	Laterals with Nozzles
Total Filtration Area of all Filters	222.21 m ²	499.56 m ²
Total Filtration Design Capacity of all Filters:	7.5 Mℓ/day	16 Mℓ/day
Total Capacity of Backwash Water Tanks:	0m ³	0m ³
Total Capacity of Sludge Treatment Plant:	None	None
Capacity of Used Washwater System:	0 Mℓ/day	0 MI/day
Primary Post Disinfection Type:	Chlorine gas	Chlorine gas
Disinfection Dosing Capacity:	10 kg/hr Chlorinator	10 kg/hr Chlorinator
Disinfectant Storage Capacity:		
Total Treated Water Storage Capacity:	13 Mℓ	13 MI

Figure 17.28 shows a schematic of the integration of the two WTP's and the supply system.

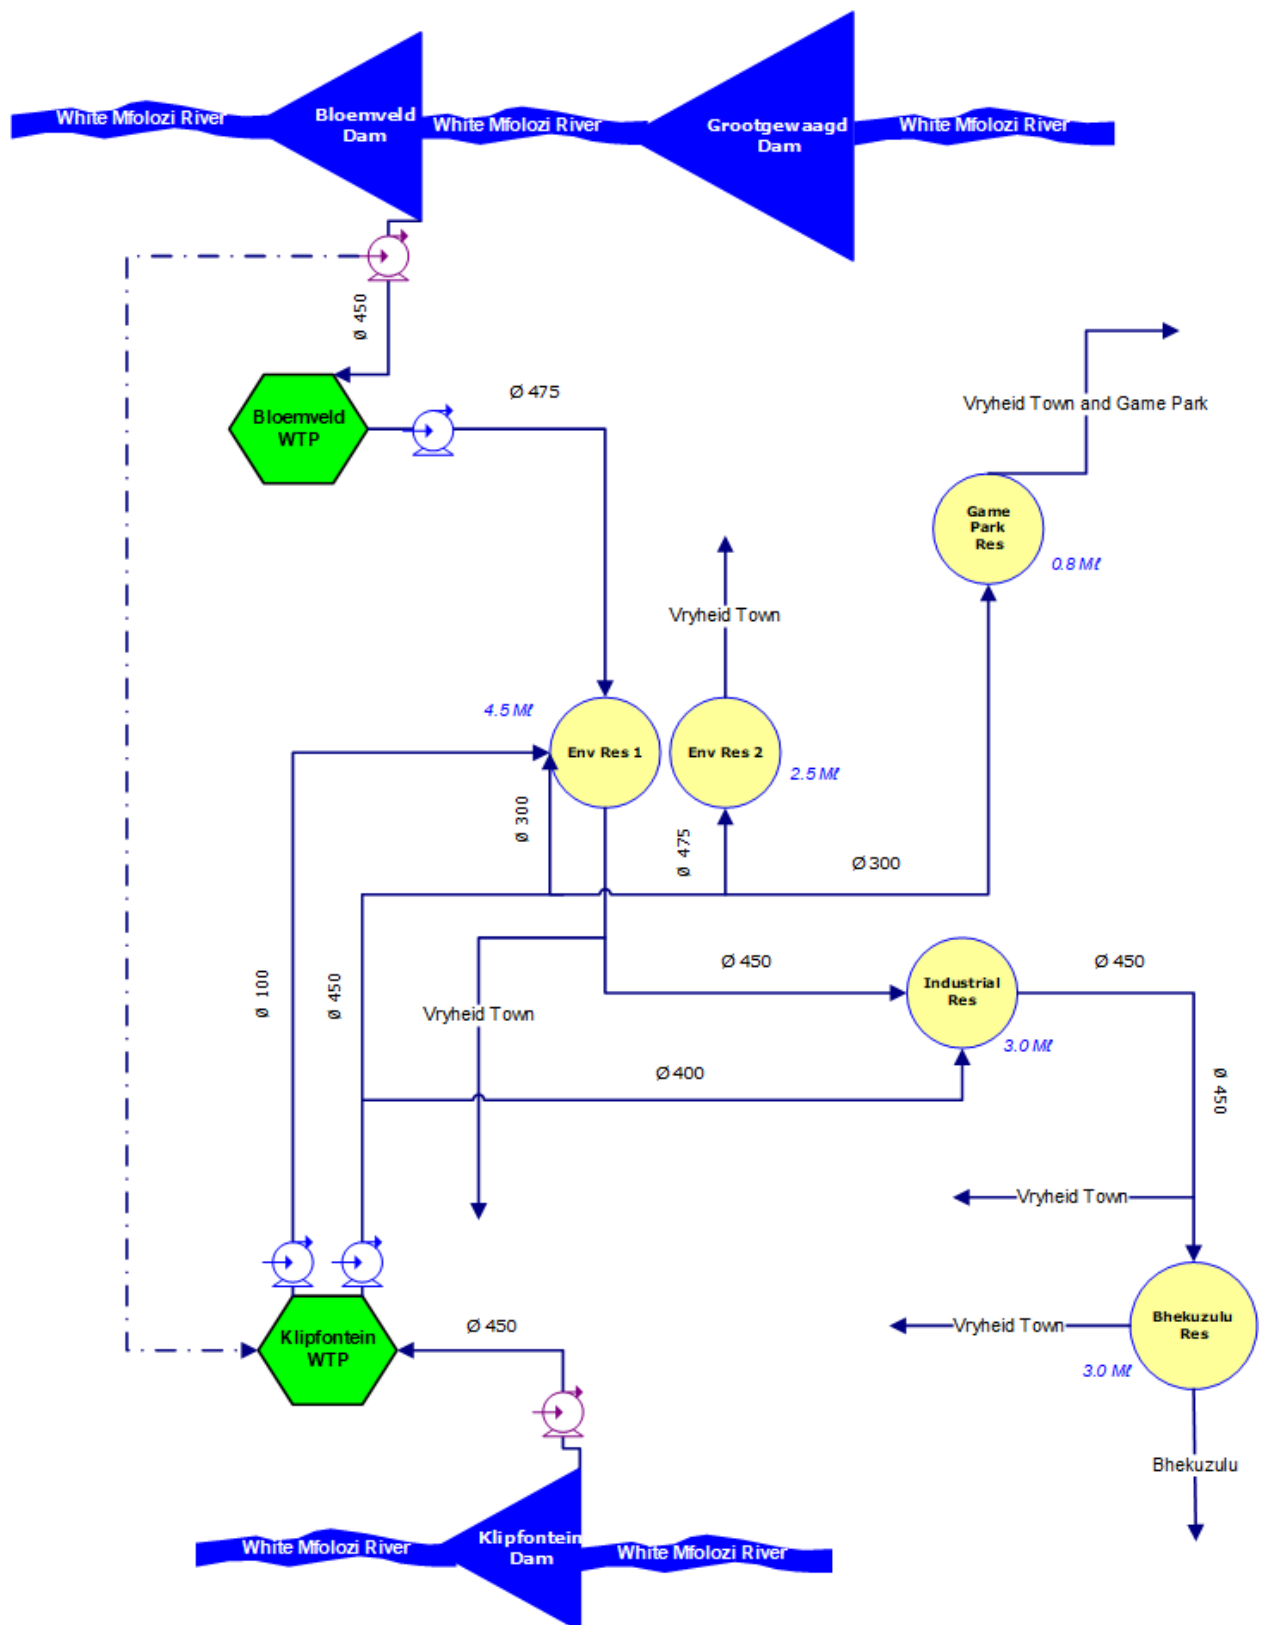


Figure 17.28 Schematic of the Vryheid Supply System

Table 17.26 Pump details: Vryheid Supply System

System	Pump Station Name	Number of Pumps		Pump Description	Supply From	Supply To	Static Head (m)	Duty Head (m)	Duty Capacity (Mℓ/day)
		Number of Duty Pumps	Number of Standby Pumps						
Vryheid	Bloemveld Raw water PS	3	1		Bloemveld Dam	Bloemveld WTP	4	8**	3
Vryheid	Klipfontein Raw Water PS	3	1		Klipfontein Dam	Klipfontein WTP	33	40**	5
Vryheid	Bloemveld PS	3	1		Bloemveld WTP	Environmental Res 1	15	25**	3
Vryheid	Klipfontein PS	3	1		Klipfontein WTP	Game Park Res	142	150**	1.5
Vryheid	Klipfontein PS	3	1		Klipfontein WTP	Environmental Res 2	104	115**	5

- ** These figures are based on calculated head loss

Table 17.27 Reservoir details: Vryheid BWSS.

System	Reservoir Site	Reservoir Name	Capacity (Mℓ)	Function	TWL (aMSL)	FL (aMSL)
Vryheid	Vryheid	Environmental Res 1	5.0	Balancing	1231*	1224*
Vryheid	Vryheid	Environmental Res 2	2.0	Distribution	1231*	1226*
Vryheid	Vryheid	Game Park Res	1.0	Terminal	1269*	1264*
Vryheid	Vryheid	Industrial Res	3.0	Terminal	1225*	1220*
Vryheid	Vryheid	Bhekuzulu Res	3.0	Terminal	1190*	1185*

*These figures are estimates and must be verified

Table 17.28 Pipeline details: Vryheid BWSS.

System	Pipeline Name	From	To	Length (km)	Nominal Diameter (mm)	Material	Capacity (Mℓ/day)	Age (years)
Vryheid	Raw water pipeline	Bloemveld Dam	Bloemveld WTP	0.8	450	Steel	20.6**	43
Vryheid	Raw water pipeline	Bloemveld WTP	Environmental Res 1	8.32	475	AC	20.6**	43
Vryheid	Potable water pipeline	Env Res 1	Industrial Res	2.175	450	AC	27.5*	43
Vryheid	Potable water pipeline	Industrial Res	Bhekuzulu Res	2.0571	450	AC	27.5*	43
Vryheid	Raw water pipeline	Klipfontein Dam	Klipfontein WTP	3.494	450	AC	20.6**	43
Vryheid	Potable water pipeline	Klipfontein WTP	Environmental Res 2	5.284	450	AC	20.6**	43
Vryheid	Potable water pipeline	Klipfontein WTP	Environmental Res 1	5.284	100	AC	1.01**	43
Vryheid	Potable water pipeline	Klipfontein WTP	Industrial Res	6.273	400	AC	16.3**	43
Vryheid	Potable water pipeline	Klipfontein WTP	Game Park Res	6.687	450/300	AC	9.16**	43

Based on a velocity of 2 m/s ** Based on a velocity of 1.5 m/s # Age need to be verified

The eMondlo WTP (**Figure 17.29**, **Table 17.29**) is positioned on high ground on the west of eMondlo Town in the Zululand District of Kwazulu-Natal.

The eMondlo WTP with an upgraded capacity of 12.0 Mℓ/day, receives raw water from the Mvunyana Dam as well as an abstraction from the Mvunyana River, 12km directly south of the plant on the Mvunyane River, a tributary of the White uMfolozi River. Four High lift pumps (**Table 17.30**) located at the eMondlo Raw Water Pump Station pump the raw water to the plant. The raw water is metered at the inlet to the plant and from there it is discharged into a storage pond at the inlet. The current demand on the eMondlo WTP is 16.0 Mℓ/day and there is no prospect of upgrading the existing plant

After treatment, potable water is gravity fed through a series of pipelines (**Table 17.32**) and reservoirs (**Table 17.31**) to the areas of eMondlo and Bhukemthethwo (**Figure 17.30**).



Figure 17.29 An Aerial view of the Mondlo WTP (Google Earth 2020: website).

Table 17.29 Characteristics of the eMondlo WTP.

WTP Name:	eMondlo WTP
System:	Mfolozi Supply System
Maximum Design Capacity:	12.0 Mℓ/day
Current Utilisation:	17.0 Mℓ/day
Raw Water Storage Capacity:	0 Mℓ
Raw Water Supply Capacity:	12.0 Mℓ/day
Pre-Oxidation Type:	None
Primary Water Pre-Treatment Chemical:	Polymeric Coagulant
Total Coagulant Dosing Capacity:	13 ℓ/hour
Rapid Mixing Method:	Conventional Paddle Flash Mixer
Clarifier Type:	Dortmund Manual Clarifiers
Number of Clarifiers:	3 (2 rectangular and one circular)
Total Area of all Clarifiers:	485.14 m ²
Total Capacity of Clarifiers:	12.0 Mℓ/day
Filter Type:	Gravity Sand Filters
Number of Filters:	6 (2 Pressure filters and 4 Gravity Sand Filters)
Filter Floor Type	Laterals with Nozzles
Total Filtration Area of all Filters	106.15 m ²
Total Filtration Design Capacity of all Filters:	12.0 Mℓ/day
Total Capacity of Backwash Water Tanks:	0m ³
Total Capacity of Sludge Treatment Plant:	None
Capacity of Used Washwater System:	0 Mℓ/day
Primary Post Disinfection Type:	Chlorine gas
Disinfection Dosing Capacity:	10 kg/hr Chlorinator
Disinfectant Storage Capacity:	
Total Treated Water Storage Capacity:	15 Mℓ

Figure 17.30 shows a schematic of the eMondlo Supply Network.

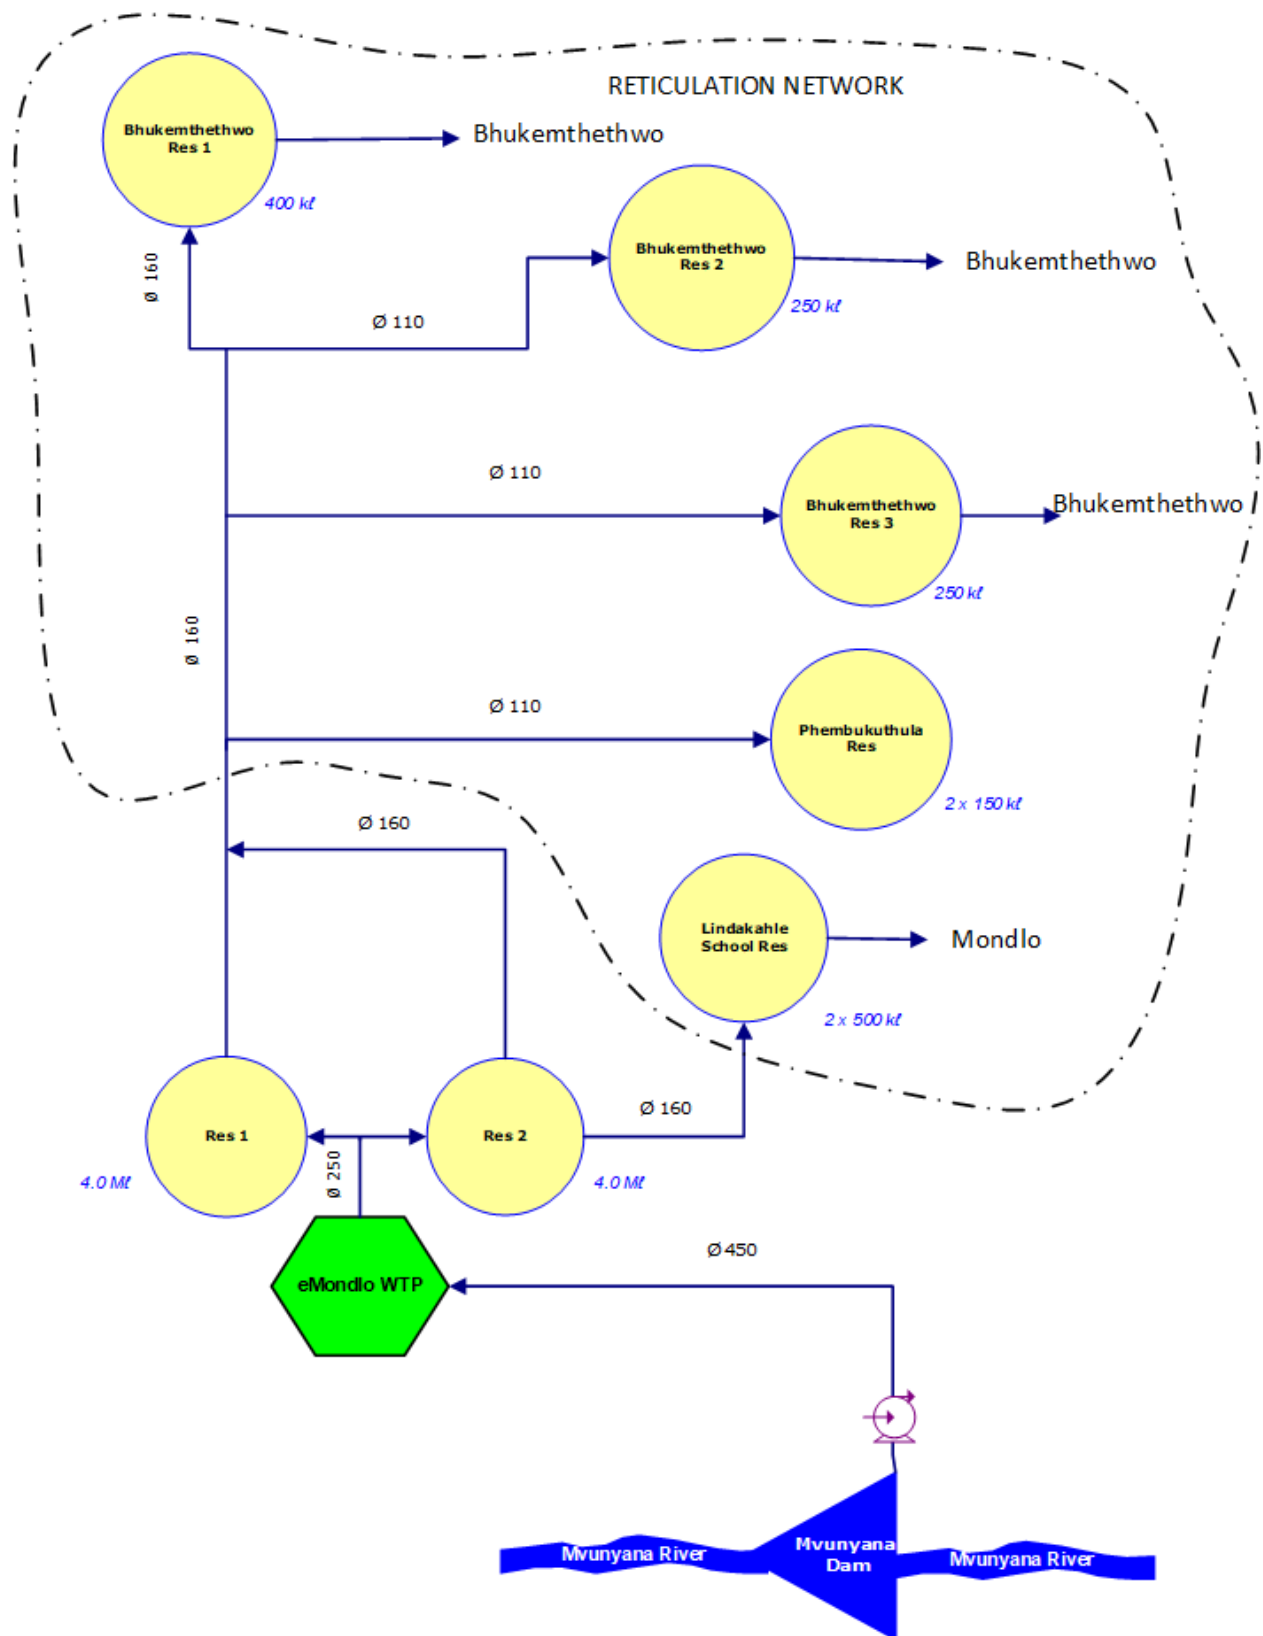


Figure 17.30 Schematic of the eMondlo Supply System

Table 17.30 Pump details: eMondlo Supply System

System	Pump Station Name	Number of Pumps		Pump Description	Supply From	Supply To	Static Head (m)	Duty Head (m)	Duty Capacity (Mℓ/day)
		Number of Duty Pumps	Number of Standby Pumps						
eMondlo	eMondlo Raw water PS	3	1		Mvunyana Dam	Mondlo WTP	180	236.1**	4

- ** These figures are based on calculated head loss

Table 17.31 Reservoir details: eMondlo BWSS.

System	Reservoir Site	Reservoir Name	Capacity (Mℓ)	Function	TWL (aMSL)	FL (aMSL)
eMondlo	eMondlo	Res 1	4.0	Distribution	1250.5*	1245*
eMondlo	eMondlo	Res 2	4.0	Distribution	1250.5*	1245*

*These figures are estimates and must be verified

Table 17.32 Pipeline details: eMondlo BWSS.

System	Pipeline Name	From	To	Length (km)	Nominal Diameter (mm)	Material	Capacity (Mℓ/day)	Age (years)
eMondlo	Raw water pipeline	Mvunyana Dam	eMondlo WTP	12.0	450	Steel	20.6**	43
eMondlo	Raw water pipeline	eMondlo WTP	Res 1 and 2	0.087	250	AC	8.48*	43
eMondlo	Potable water pipeline	Res 1	Bhukemthethwo Res 1	3.662	160	uPVC	3.47*	43
eMondlo	Potable water pipeline	Res 1	Bhukemthethwo Res 2	4.440	110	uPVC	1.64*	43
eMondlo	Potable water pipeline	Res 2	Lindakahle School Res	2.011	160	HDPE	3.47*	43
eMondlo	Potable water pipeline	Res 1	Phembukuthula Res	2.820	110	uPVC	1.64*	43

Based on a velocity of 2 m/s

** Based on a velocity of 1.5 m/s # Age need to be verified

17.3.2 Status Quo and Limitations of the uMfolozi System

(a) Nkonjeni Regional Bulk Water Supply Scheme

Ulundi/Nkonjeni and Mpungamhlope Water Supply Systems

The Nkonjeni RBWSS has a well-developed and sustainable water source.

The existing design capacity of the Ulundi WTP is adequate to supply the projected demand until 2030. However, if the service area is increased then the plant will have to be upgraded and extended

The quality of the raw water upstream of the Klipfontein Dam is poor as a result of both wastewater return flows and from land use activities including commercial forestry.

The Klipfontein Dam situated near Vryheid was built to supply the conjunctive use of domestic water supply to Vryheid and Ulundi, and for irrigation water for the farmers downstream of the dam, including the Gluckstadt Irrigation Scheme. Mpungamhlope which is located between the dam and Ulundi also benefits from the available water supply from the dam.

In 2018, the total raw water abstraction for treatment at the Mpungamhlope WTP, as well as for Makhosini, including the groundwater used to supplement the scheme, was estimated to be 0.69 million m³/annum (1.9 Mℓ/day) with a treated water production estimated to be 0.61 million m³/annum (1.67 Mℓ/day).

The estimated raw water losses in the raw water abstraction works and pipeline, as well as in the treatment processes, are estimated to be as high as 12% of the total raw water abstraction.

The current storage capacity of the system is 27 Mℓ and provides for a 36-hour storage based on current treated water production. In the summer months, this reduces to a 24-hour storage capacity, based on higher demand during that period.

The Ulundi WTP has been earmarked as the primary supply point for one of the planned 10 Regional Bulk Water Supply Schemes.

The projected demand for 2050 of the overall Nkonjeni RBWSS is estimated at 41.88 Mℓ/day

(b) Usuthu Regional Bulk Water Supply Scheme (RBWSS)

Usuthu, Vuna/Embile and Ceza Supply System

The current raw water abstraction infrastructure cannot meet the current and future demand, as the Vuna WTP supply scheme is extended to supply the areas that have been serviced by boreholes and areas that have not previously been serviced. The current demand for potable water for the supply area is 6.39 Mℓ/day, whilst the capacity of the plant is 4.5 Mℓ/day.

There is a plan to consolidate this system with the Usuthu BWSS as one of the 10 Regional Bulk Water Supply Schemes with the primary point being the Usuthu WTP.

The average annual capacity of the water treatment works is insufficient to meet the immediate water requirements of the scheme given the high system losses. Currently, the scheme is supplemented with groundwater to meet the deficits in the requirements in some communities. There is a high silt load

in the White uMfolozi River and increased maintenance will have to be implemented to prevent the silting up of the abstraction works.

The Usuthu WTP currently comprise of two 2 Mℓ/day package plants and these are inadequate to meet the current demand. Zululand DM is in the process of constructing a 12 Mℓ/day conventional plant to meet the future projected demand. The Usuthu WTP will be one of the 10 Regional Bulk Water Supply Systems in this area and will be supplemented by the Vuna and Ceza BWSS.

The current abstraction infrastructure is inadequate to meet the demand and it is proposed that a feasibility study be undertaken to assess the viability of constructing a dam on the Black uMfolozi River.

(c) Hlahlindlela Regional Bulk Water Supply System (RBWSS)

Vryheid Supply System

The main function of Klipfontein Dam is to supplement the water supplies of Bloemveld and Grootegetwaagd Dams (previously the main sources of raw water). Over the years, Vryheid's dependence on Klipfontein Dam has increased as demands have increased. There are no major water quality concerns at either the Bloemveld WTP or the Klipfontein WTP. The town of Vryheid, Bhhekuzulu Township and the Vryheid WWTW are situated in the catchment area of the Klipfontein Dam. As a result, the water quality of the Klipfontein Dam could be impacted if effluent quality standards from the plant are not controlled. There is also a threat of uncollected litter and waste which could enter the dam through the stormwater system.

The capacity of the Vryheid WWTW is being upgraded so as to support the short and medium term demand. As the flows through the WWTW increase with time, the yield of the Klipfontein Dam will also increase.

Both WTPs are able to supply the required demand in the short to medium term and the resulting water quality is regarded as good. The Bloemveld plant has a neglected appearance but appears to be in adequate condition to continue operating, provided refurbishment is not unduly delayed.

The Vryheid BWSS has been consolidated with the eMondlo BWSS and some of the smaller schemes to form the Hlahlindlela Regional Water Supply Scheme.

eMondlo Supply System

The available raw water supplies are sufficient to meet the current raw water requirements. The quality of the resource upstream of the Mvunyana Dam is not of good quality because of the wastewater return flows from Emondlo as well as the land use activities.

The eMondlo WTP was refurbished and upgraded to supply 12 Mℓ/day, but the demand has grown to 17 Mℓ/day. The Vryheid BWSS currently supplements the supply to the Mondlo BWSS.

The treatment works will have to be upgraded to meet the future projected demand. Future capacity increases would require major extensions to the works with a new inlet works, new clarifiers, new filters, as well as further upgrading of the chemical dosage systems. The site is restrictive in terms of

space and it may be more prudent to build an additional works near the dam and to pump the treated water to command reservoirs.

The eMondlo BWSS has been consolidated with the Vryheid BWSS and some of the smaller schemes to form the Hlahlindlela Regional Water Supply Scheme.

17.4 Water Balance/Availability

The Department of Water and Sanitation is currently conducting a study entitled *Development, Updating and Review of Strategies to Reconcile Water Availability and Requirement in the East Planning Area Comprising Water Supply Systems for Mbombela, Richards Bay, Mgeni and All Other Towns and Clusters of Villages – Pongola - Umfolozi: Water Reconciliation Strategy*. This study includes a detailed assessment of the available yield against present day and future demand. In addition, the study also highlights the need for supply intervention measures where deficits exist, as well as the timing thereof. The study is expected to be completed in July 2024 and will be included in the 2025 Infrastructure Master Plan.

According to the Zululand DM WSDP, 2004 a deficit in the system results from a demand which is higher than the 98% assured yield of the system (**Table 17.33**). This deficit is also as a result of provisions made for the future implementation of the Reserve.

Table 17.33 Water balance - Water availability in the uMfolozi System for year 2000 (Zululand DM WSDP, 2004).

		White uMfolozi	Black uMfolozi
		(million m ³ /annum) 98% assurance	(million m ³ /annum) 98% assurance
Available Water	Yield from Major Dams	15	0
	Yield from Minor Dams	7	2.3
	Run-of-River Yield	12.5	13
	Return flow	4.7	1.2
	Total available	39.2	16.5
Requirements	Irrigation	5	11
	Urban & Rural	19	5
	Mining & Industry	0	1
	Ecological Requirements	34	30
	Total Used	58	47
Balance		-18.8	-30.5

The following management and development options should be addressed in the White uMfolozi System:

- Providing additional water from the local surface water supplies of the White uMfolozi River, possibly including the raising of Klipfontein Dam.
- Review the proposal to construct an off-channel storage dam on the KwaNkweme River with a run-of-river scheme on the upper Black uMfolozi River.
- Implementation of Water Conservation and Demand Management measures, as a result of high system losses in the White uMfolozi River water supply systems.

- Pressure and leakage management for Vryheid, Ulundi and Emondlo BWSS, which may be due to the high average operating pressure.
- Retrofitting and consumer metering implementation will improve the revenue sufficiency of the Zululand DM and the local municipality by selling an additional 1.85 million m³/annum, while retrofitting will reduce the consumer use by approximately 1.85 million m³/annum (DWS, 2014).
- Improving the operating practices between Klipfontein Dam and Ulundi weir (losses of around 17%) is critical. The scheduling of releases from Klipfontein Dam in order to reduce water losses in the system along the White uMfolozi River and at the Ulundi Weir is important. This should be supported by a system to monitor the movement of water and sediment.

17.5 Recommendations for the uMfolozi System

In January 2021, uMngeni-uThukela Water concluded a Universal Access Plan, at a reconnaissance level, to assess the bulk and secondary bulk requirements for the Greater Zululand and uMkhanyakude District Municipalities. The study identified a number interventions to be implemented and these are listed below.

17.5.1 System Components

According to the Zululand DM IDP 2012-2016, the geographic extent and nature of the district necessitates the consolidation of bulk water supplies across the district into 10 regional schemes, which further supply small stand-alone rural schemes. The regional bulk water supply schemes (RBWSS) are as follows:

- 1) Nkonjeni RBWSS (Mfolozi)
- 2) Usuthu RBWSS (Mfolozi)
- 3) Mandlakazi RBWSS (Pongola)
- 4) Gumbi/Candover RBWSS (Pongola)
- 5) Simdlangentsha East RBWSS (Pongola)
- 6) Simdlangentsha Central RBWSS (Pongola)
- 7) Simdlangentsha West RBWSS (Pongola)
- 8) Coronation RBWSS (Pongola)
- 9) Khambi RBWSS (Pongola)
- 10) Hlahlindlela RBWSS (Mfolozi)

Accordingly, it is understood that the "smaller water schemes" form part of or are planned to be incorporated into the regional schemes as shown in **Table 17.34**.

Table 17.34 Proposed Regional Water Schemes in the Zululand District Municipality

Item No	Name of Regional Water Scheme	Current Water Supply Scheme based on coverage area	Local Municipality
1	Nkonjeni RBWSS	Ulundi/Nkonjeni Osinisingini Nkonjeni Hospital Mpungamhlophe Babanango Masokaneni	Ulundi
2	Usuthu RBWSS	Nongoma/Vuna Ceza Thlasizwe Hospital	Nongoma
3	Mandlakazi RBWSS	Mandlakazi Khangela Palace Sidinsi Kombusi	Nongoma
4	Gumbi/Candover RBWSS		
5	Simdlangentsha East RBWSS	Spekboom PongolaTown (Simdlangentsha)	Uphongola
6	Simdlangentsha Central RBWSS	Belgrade Khiphunyawo Msibi	Uphongola
7	Simdlangentsha West RBWSS	Frischgewaagd Edumbe Ophuzana Tholakele	Edumbe
8	Coronation RBWSS	Hlobane Louwsburg Coronation	Abaqulusi
9	Khambi RBWSS	Khambi Village Mountain View Enyathi	Abaqulusi
10	Hlahlindlela RBWSS	Klipfontein Bloemveld Mondlo Mvuzini Purim	Ulundi

It is recommended that a Detailed Feasibility Study be undertaken to assess the most practical application and infrastructure requirements for efficient and effective supply networks.

(a) Hlahlindlela Regional Bulk Water Supply Scheme

Water demand has been projected up to the year 2050. It includes 112 communities with Vryheid and eMondlo being formal urban areas with the rest being rural settlements. The Hlahlindlela RBWSS is expected to have a demand of 55 Mℓ/day in 2050.

The White uMfolozi is the main source of water for the Hlanhlindelela RBWSS. However, there are water use entitlements for irrigation agriculture downstream of the Klipfontein Dam. The total registered irrigation water use downstream of Klipfontein Dam is 10.04 million m³/annum at a lower assurance of supply compared to the domestic sector. It is known that the registered irrigation water is currently not being used by irrigation agriculture.

The total bulk potable water production for 2011 for the White uMfolozi River catchment was 47.5 Mℓ/day. This figure includes the water requirements for Vryheid, eMondlo, Babanango and Nkonjeni supply areas. Currently the Hlanhlindelela scheme is experiencing water shortages and is the reason for projects being put on hold.

The Klipfontein Dam is situated on the uMfolozi River and supplies Vryheid town. The Grootgewaagd and Bloemveld Dams are situated on the aMagoda River and supplies water to Vryheid town. The Mondlo Township's main source of water is the Mvunyana Dam as well as direct abstraction from the Mvunyana River. Water is also released from the Klipfontein Dam to supply the Nkonjeni Regional Scheme (Ulundi). A water resource study will be necessary to identify potential surface water and groundwater augmentation options.

The Klipfontein Dam Raising Pre-feasibility study, to increase the yield of the Klipfontein Dam, was completed by DWS in 2018. The study investigated a number of options but it was recommended that the current FSL of the dam (1090 masl) be raised by 3.0 m to 1093 masl. The raising of the dam will provide an assured supply of water to Vryheid and its surrounding areas. The scheme can also increase the assurance of supply to eMondlo WSS, the Mpungamhlope WSS, the Ulundi WSS and to irrigators between the dam and the Ulundi Balancing Weir.

(i) Bulk Conveyance

- From the Bloemveld WTP a primary ø 315mm bulk pipeline would need to extend in a northerly direction (±11km) to primary Command Reservoir (CR1);
- From CR 1, a secondary bulk pipeline ranging from ø 63mm to ø 110mm will extend further north towards Obivane 2 community. Tertiary pipelines (approximately 11km in total) will branch off the secondary pipeline towards the communities of Obivane 2, Bivanyana, Penvaan and Khambula Mission. The tertiary pipelines will range between ø 50mm and ø 75mm;
- From CR 1 another secondary bulk pipeline needs to extend (approximately 49km) south east ranging between ø 63mm and ø 250mm. Tertiary pipelines will branch off towards the communities of Helberg Farms, Zunweni, Voorkeur, Bozuzu, Ntendeka 2, Shoba 1 & 2, Kwabanga 2, Golden Valley and Tint as Drift. The tertiary pipelines will range between ø 50mm and ø 125mm and amount to ±33km; 5km from the primary, tertiary pipelines (ranging between ø 50mm and ø 110mm) will extend (23km) in a northerly direction to serve the communities of Zungwini, Mthashana, Mqwabe and KwaManzi;
- From Klipfontein WTP, a primary bulk pipeline needs to extend (±6km) to a second command reservoir at KwaMshomolozu; From CR2, secondary pipelines need to extend to the west and will range between ø 63 and ø 160mm for approximately 16km from where tertiary pipelines will branch off towards the communities of Driefontein, Fairplay, Mdlenevini, Fearmdale, Scheepersneck, KwaLubeck, Betel, Stillwater, Zaaifontein, Middelpunt and Geluk 3. The tertiary pipelines will range between ø 50mm and ø 63mm and total approximately 35km; The primary bulk pipeline will extend further south from CR2 to another command reservoir;

- Existing secondary pipelines extends from eMondlo WTP and feed Emondlo town, Phumbuthula, Enhlahelni, Zwelisha and Purim. Secondary pipelines range between \varnothing 63mm and \varnothing 315mm and amount to \pm 50km;
- From Mvuzini WTP an existing secondary pipeline extends to Nceceni from where an additional secondary pipeline (14km) is required to serve Emadwaleni, Mhlangeni, Mphezulu and hobozeni. The secondary pipeline will range between \varnothing 63mm and \varnothing 160mm;
- From the existing secondary pipeline at the Purim WTW, additional secondary pipelines (ranging from \varnothing 90mm to \varnothing 200mm) will be required to extend (approximately 26km) further south to serve the Ezidulini, Nhloshana, Amahlathi, Ezibomvu 4, Esigodini, Qweqwe 1, Elosi and Sofaya communities; and
- From the CR3, future primary bulk pipeline, additional secondary pipelines (\varnothing 63mm to \varnothing 160mm) will extend eastwards (16km) from where it will extend further towards the south (19km) upto Gwebu CPA community. The secondary pipelines will range from \varnothing 90mm to \varnothing 140mm. Tertiary bulk pipelines ranging from \varnothing 50mm to \varnothing 90mm, will branch off (34km) to serve Nsengeni, Mawelawela, Langverwacht, Vamba, Brakfontein, Emooi, Enyanyeni, Brakpan, and Gwebu CPA communities.

(ii) Storage

- The existing storage reservoirs need to be upgraded. The current storage capacity totals approximately 10Mℓ and needs to be upgraded to 17Mℓ;
- Four (4) primary command reservoirs are required with capacities to vary between 2.2Mℓ and 5Mℓ; and
- Eight (8) secondary reservoirs with capacities between 30kℓ and 2Mℓ and 48 tertiary reservoirs with capacities between 30kℓ and 1.6Mℓ will be required.

The storage capacity would need to be increased with an additional 35.2Mℓ to meet the 2050 water demand and to connect it to the Regional Scheme.

(iii) Pump Stations

- Install a new pump station at Bloevmveld WTP (202kW).

(b) Nkonjeni Regional Bulk Water Supply Scheme

The water demand for the Nkonjeni RBWSS was determined up to the year 2050. It includes approximately 175 communities with no formal urban towns. The rural communities are sparsely scattered and vast distances apart. Nkonjeni Scheme is expected to have a demand of nearly 42Mℓ in 2050.

At present the White uMfolozi catchment, at a 1:50 year level of assurance, is estimated at 51 million m³/annum. The total current requirement is in the order of 98 million m³/annum. The catchment is therefore severely stressed from a resource point of view. The Klipfontein Dam is the most significant

water resource and is situated in the upper reaches of the White uMfolozi River. The Klipfontein Dam can be used to increase the supply to Ulundi. The challenge in the White uMfolozi catchment is not that there is not enough water but there is a lack of dams which results in low firm yields and water shortages that occur during drought periods. A water resource study will be necessary to identify potential surface water augmentation options and possible dam developments.

The Ulundi and Babanango WTPs need to be upgraded to 32Mℓ/day and 0.5Mℓ/day, respectively.

(i) Bulk Conveyance

- Clear water is pumped from the UlundiWTP via an existing \varnothing 500mm rising main to a command reservoir. The WTP needs to be upgraded to 32Mℓ/day and the rising main to \varnothing 813mm; From the command reservoir (CR1), an existing secondary pipeline extends (5.5km) to the Mkhazane community in Supply Zone 014 and needs to be upgraded to \varnothing 400mm from where an existing \varnothing 600mm and \varnothing 350mm pipeline extends further to Matheng. From Mkhazane an additional \varnothing 315 mm secondary pipeline will be needed running (\pm 28km) to the east through Supply Zone 014 towards Supply Zone 087 and into Supply Zone 086 to Zilulwane community. From Zilulwane an existing \varnothing 125mm secondary bulk pipeline extends (10.5km) further north east to Onteku. Existing tertiary pipelines (ranging between \varnothing 75mm and \varnothing 110mm) branch off to Mbangweni, Mgababa 2 and Bhekimbazo. An additional \varnothing 110mm tertiary pipeline (approximately 4km) will be required to serve Njomelwane. At Mthonjaneni community, tertiary pipelines (ranging from \varnothing 110mm to \varnothing 160mm) are needed to branch off south towards Supply Zone 084 to feed the communities of KwaMvula, Gijima, Enguqe and Ekatini. The tertiary pipelines total approximately 8.5km. Additional \varnothing 125mm & \varnothing 315mm tertiary pipelines will be required to run (\pm 10km) in a north easterly direction into Supply Zone 083 to serve Sqobelo and Ntabankulu. A \varnothing 140mm tertiary pipeline will be needed to serve Supply Zone 088 (1.3km);
- Another existing \varnothing 355mm secondary pipeline from CR1 extends east towards Supply Zone 013 to serve Ulundi Unit B1. The secondary pipe (\varnothing 315mm) extends further to Ntendeka, Ulundi Unit D, Esthenilezitombi and Vukuza (14.5km) and is joined by the existing primary pipeline extending from the Nkonjeni Hospital WTP and Masokaneni WTP;
- An existing \varnothing 400mm secondary pipeline extends from CR1 north to Mbudle. 1.2km from the CR1 a \varnothing 355mm existing secondary extends (5km) in a northerly direction into Supply Zone 010 to the Cisholo community. From Cisholo the pipeline (\varnothing 315mm) further extends to Mbeka (3.55km) where it joins with an existing \varnothing 250mm secondary pipeline. The existing \varnothing 250mm secondary pipeline extends to the east and joins the existing primary pipeline (\varnothing 50mm) that comes from the Nkonjeni Hospital WTP and Masokaneni WTP (6km). An existing \varnothing 250mm extends (3km) from the primary and secondary pipeline join north east through Supply Zone 015 to Mahlabathini. From Mahlabathini an existing \varnothing 140mm tertiary pipeline extends (1.3km) north into Supply Zone 008 to Vutela;
- From Mbeka, an existing \varnothing 315mm secondary bulk pipeline extends (\pm 4km) in a north westernly direction to Qwane Vuka in Supply Zone 012. At Manaba community, an existing \varnothing 75mm tertiary pipeline runs north to Osengathini in Supply Zone 007;
- From Qwane Vuka an existing \varnothing 200mm secondary bulk pipeline extends (4km) in a northerly direction to Mahleza (Supply Zone 059) from where it extends further north to Supply Zone 005 to Mbotsheni (3.5km). Here an existing \varnothing 75mm tertiary pipeline branch off to the left to Mashulu in Supply Zone 005. From Mbotsheni an the existing \varnothing 160mm secondary pipeline runs still in a northerly direction to Cobe in Supply Zone 056 (\pm 5km). Two existing tertiary pipelines ranging between \varnothing 75mm and \varnothing 110mm branch off on either side of the secondary pipeline. One tertiary pipeline branch off to the left to Dlebe (\pm 1.7km) in Supply Zone 004 and

the other branch off to the right to Kwayaka in Supply Zone 054 and further to Ndumakude in Supply Zone 055 (± 7 km);

- From Cobe, the existing \varnothing 125mm secondary bulk pipeline extends even further north to Kwamshayazafe 3 (7.5km) in Supply Zone 058 and ends at Njoline community in Supply Zone 057. The \varnothing 90mm secondary pipeline to Njoline is approximately 4km;
- Also from Qwane Vuka, another existing \varnothing 200mm secondary bulk pipeline extends in a north westerly direction to Ohlelo (2km) in Supply Zone 009. From here the \varnothing 140mm secondary pipeline extends further (9km) through Supply Zone 053 to Supply Zone 051. The \varnothing 125mm existing secondary pipeline passes through Supply Zone 51 (Mbombo & Mbekuzeni communities) to Supply Zone 052. From Supply Zone 52 the \varnothing 90mm pipeline extends to Kwankakazi (3km). An existing \varnothing 63mm tertiary branches off at Kwankakazi to Tukelana 2 in Supply Zone 066 (± 4 km). Two existing \varnothing 50mm tertiary pipelines branch off on either side of the secondary pipeline. One towards Undindi community (3km) north of the secondary pipeline and the other to the south of the secondary pipeline in Supply Zone 053 (2.5km); From Mpungamhlope WTP (0.8M ℓ /day) an existing \varnothing 160mm primary bulk pipeline extends south towards an existing command reservoir (CR2). A \varnothing 315 mm primary bulk pipeline is needed from CR2 to extend to the east to CR1 at Ulundi WTP (± 15 km). An additional \varnothing 250mm secondary bulk pipeline is also needed to extend south from CR2 to Goje (3km). From here the \varnothing 200mm secondary pipeline will be required to extend further (3km) south to Emahlathini and further to Hlungulwane Supply Zone 002 (2km) A \varnothing 75mm tertiary pipeline will extend from the secondary bulk pipeline further south through Supply Zone 002, 006 and into 050 at Kweyezulu. From Emahlathini another \varnothing 160mm tertiary bulk pipeline is needed (10km) to serve Mehlomane, Mgababa 3, Hodlweni in Supply Zone 49 and it will end in Supply Zone 003;
- The existing Babanango WTP needs to be upgraded to 0.5M ℓ /day. An existing \varnothing 110mm primary bulk pipeline from the WTP extends to an existing command reservoir (CR3).

Bulk distribution to supply the whole Regional Scheme would need to be increased by approximately 98km. An additional 15km primary bulk pipeline (\varnothing 315mm), 40km secondary (ranging between \varnothing 63mm and \varnothing 315mm) and 44km tertiary bulk pipelines (ranging between \varnothing 75mm and \varnothing 315mm) would be necessary to supply the whole of the Nkonjeni RBWSS

(ii) Storage

- The existing storage reservoirs need to be upgraded. The current storage capacity totals approximately 16M ℓ and needs to be upgraded to 79M ℓ ;
- The three (3) primary command reservoirs (CR1, CR2 & CR3) need to be upgraded to 19.27M ℓ , 2.35M ℓ and 920k ℓ respectively;
- 24 Existing secondary storage reservoirs need to be upgraded to 42M ℓ with six (8) additional secondary reservoirs required with capacities between 360k ℓ and 1.5M ℓ ; and
- 20 Existing tertiary reservoirs need to be upgraded to 14.5M ℓ with 10 additional tertiary reservoirs required with capacities between 330k ℓ and 2.4M ℓ .

The storage capacity would need to be increased with an additional 78M ℓ to meet the 2050 water demand and to connect it to the Regional Scheme.

(c) Usuthu Bulk Regional Water Supply Scheme

The Usuthu Regional Scheme is the largest water supply scheme in the district and supplies almost the entire Nongoma LM and also represents the biggest portion of the total backlogs. The eastern part of the Nongoma LM is supplied from the Mandhlakazi RWSS.

The scheme required the development of a new water source from the Black uMfolozi River and expensive bulk infrastructure to be rolled out over vast distances to scattered rural communities.

The sustainability of the main water source of Nongoma town is under severe strain and no longer sustainable during drought periods. The installation of a bulk pipeline from the Black uMfolozi River to Nongoma is currently in progress to address this issue. The internal bulks for Nongoma town will also be upgraded to augment the existing water supply.

18. uMKHUZE / uPHONGOLO / LAKE SIBAYA SYSTEM

18.1 Synopsis

The uMkhuze (W31 and W32), uPhongolo and Lake Sibaya (or Lake Sibayi) (W70A) systems run through the northeast region of the KZN Province and mainly supply water to the Umkhanyakude DM, as well as parts of the Zululand DM. The catchment area of these river systems is predominately rural, with commercial forest plantations and agriculture (cultivation and livestock farming) being the main economic activities. The uPhongolo System is shown in **Figure 17.31** and the uMkhuze System in **Figure 17.32**.

18.1.1 Water Resources

(a) Overview

(i) uMkhuze Water Resource Region

The uMkhuze River is located in northern KwaZulu-Natal and has its source near the small town of Hlobane (east of Vryheid). The river runs near the uMkhuze Game Reserve, which constitutes the north-western part of the iSimangaliso Wetland Park – a UNESCO World Heritage Site. The uMkhuze River is one of the main rivers supplying water to Umkhanyakude District Municipality. This District Municipality also receives water from the uPhongolo and uMfolozi Rivers. Water can be transferred from the Pongolapoort Dam to the uMkhuze River to augment supply to the Mkuze town as well as the Zululand District Municipality. The uMkhuze Catchment includes the drainage areas of both the uMkhuze (W31) and Hluhluwe (W32) Rivers. The drainage basin covers an area of 9 545 km² and the rivers discharge into Lake St Lucia which then drains into the Indian Ocean.

The uMkhuze River System flows within tertiary catchment W31. The catchment consists of predominately commercial cattle and game farming (the main economic activities), with a small area of Traditional Authority land located in the southeast. The major water users in this catchment are irrigation and commercial forestry. Irrigators abstract water from run-of-river flows or farm dams. Some of the small towns in the region include Mkuze, Hluhluwe and Nongoma. The only significant dam in the catchment is the Hluhluwe Dam, which was primarily constructed for irrigation purposes. Today, the dam also supplies water for domestic purposes to the town of Hluhluwe.

The catchment is critical for the environmental flow requirements of Lake St Lucia and other areas east of the Lebombo Mountains. Lake St Lucia is an ecologically sensitive area and a World Heritage Site (Mhlathuze Water, 2016: 39).

The Hluhluwe system can be supported by the uMfolozi River and the water supply schemes that are either dependent on, or that could potentially be supplied by the uMfolozi and Hluhluwe River systems include the following:

- Mtubatuba Water Supply Scheme – this scheme includes the towns of St Lucia and Mtubatuba (which is located along the N2 highway). This scheme is dependent on run-of-river abstraction from the uMfolozi River.
- Hluhluwe Town Water Supply – the town and neighbouring communities are located on the left bank of the Hluhluwe River and are supplied by an abstraction works on the left bank of the Hluhluwe Dam.

- Hluhluwe Rural Water Supply Scheme – this scheme covers the area to the north and north east of Hluhluwe town, comprising mainly rural communities and is dependent on the water resources of the Hluhluwe River.
- Mpukunyoni Water Supply Scheme – this scheme is located west of Mtubatuba and is supplied by the Nyalazi River, a seasonal river that flows through the area into Lake St Lucia.

A general layout of the uMkhuze Region is shown in **Figure 17.33**. The dominant land cover in this region includes forestland (29%), cultivated (28%) and urban areas (17%).

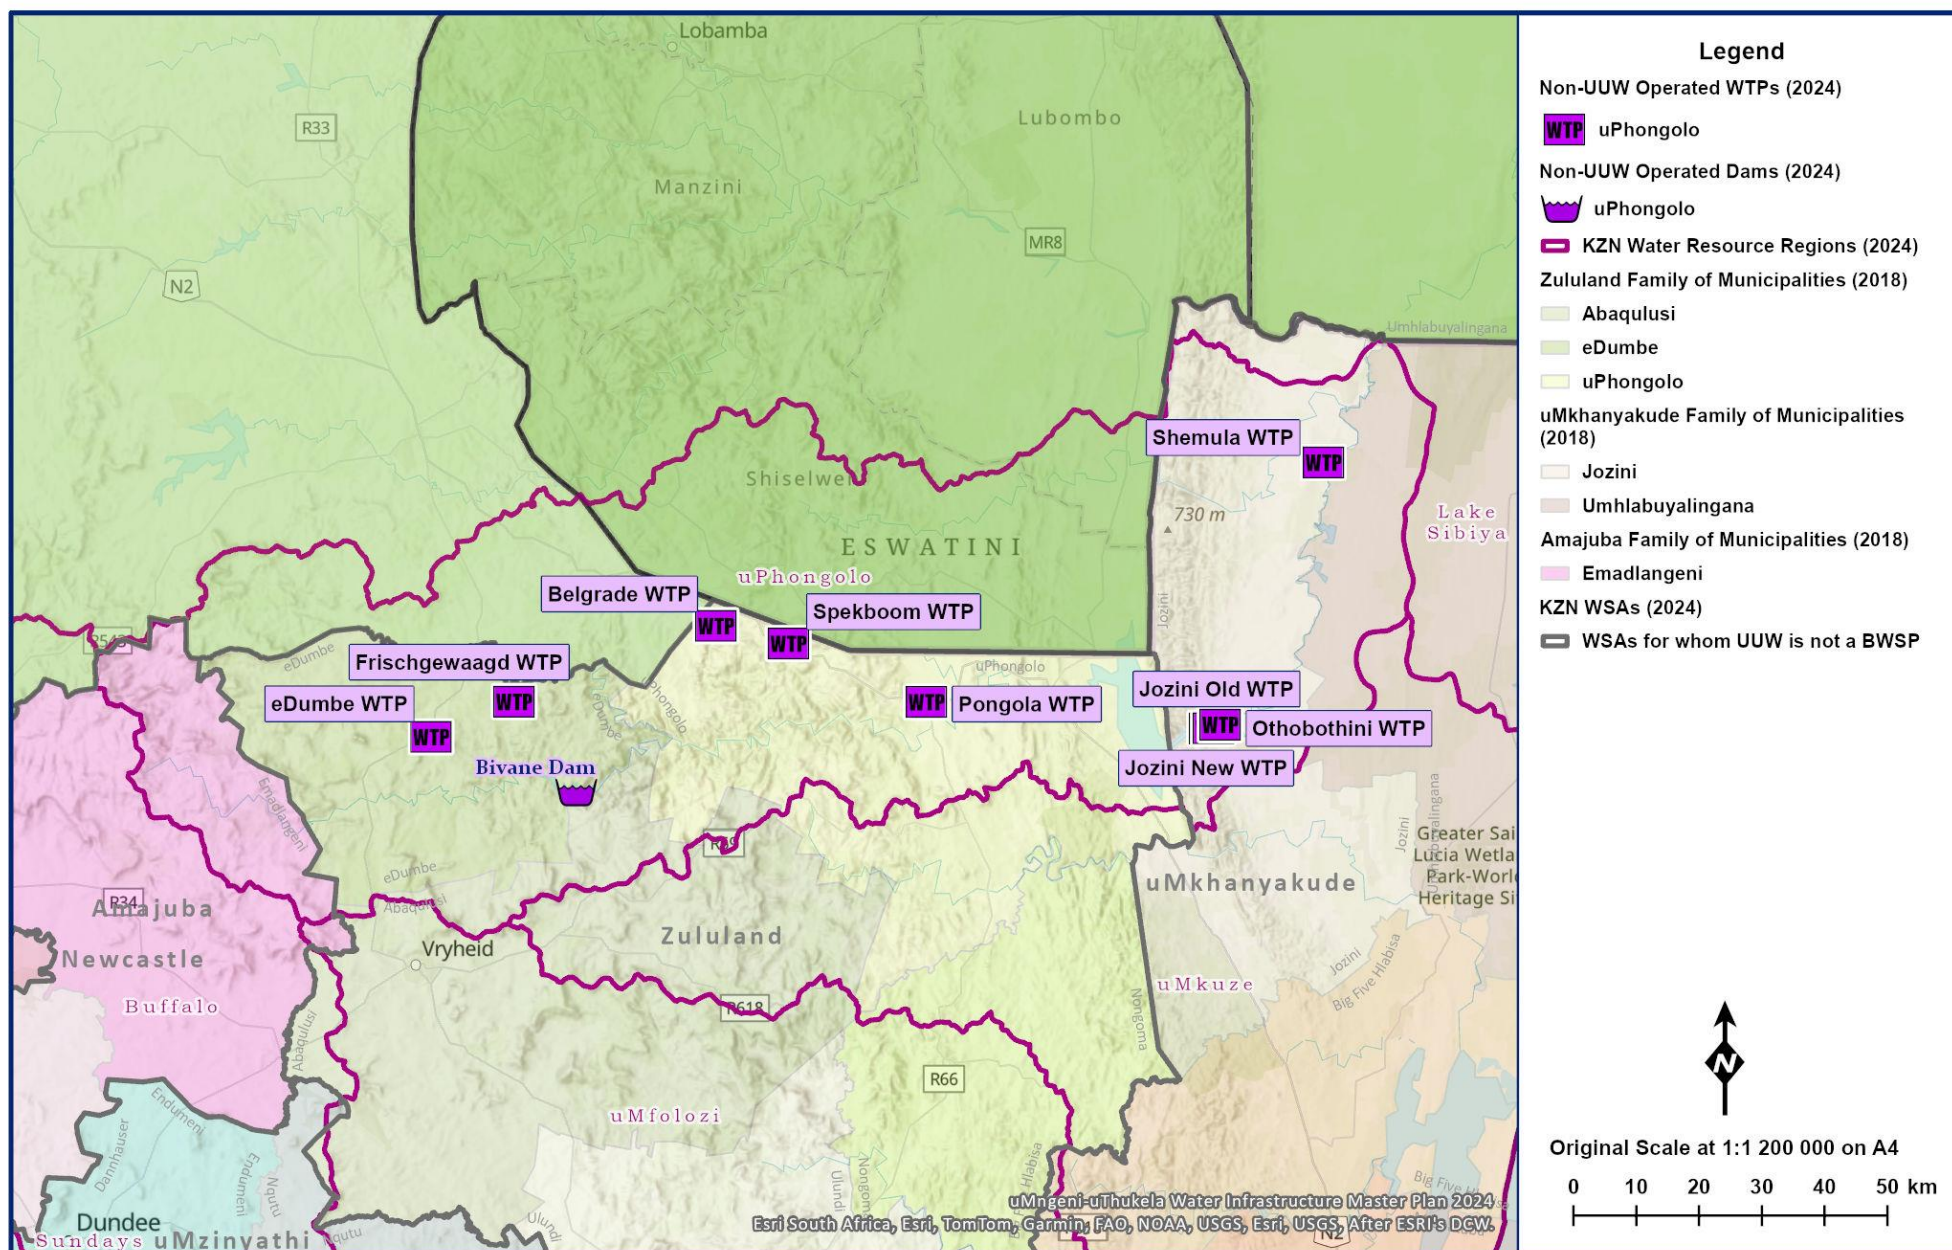


Figure 17.31 General layout of the uPhongolo System (MDB 2020).

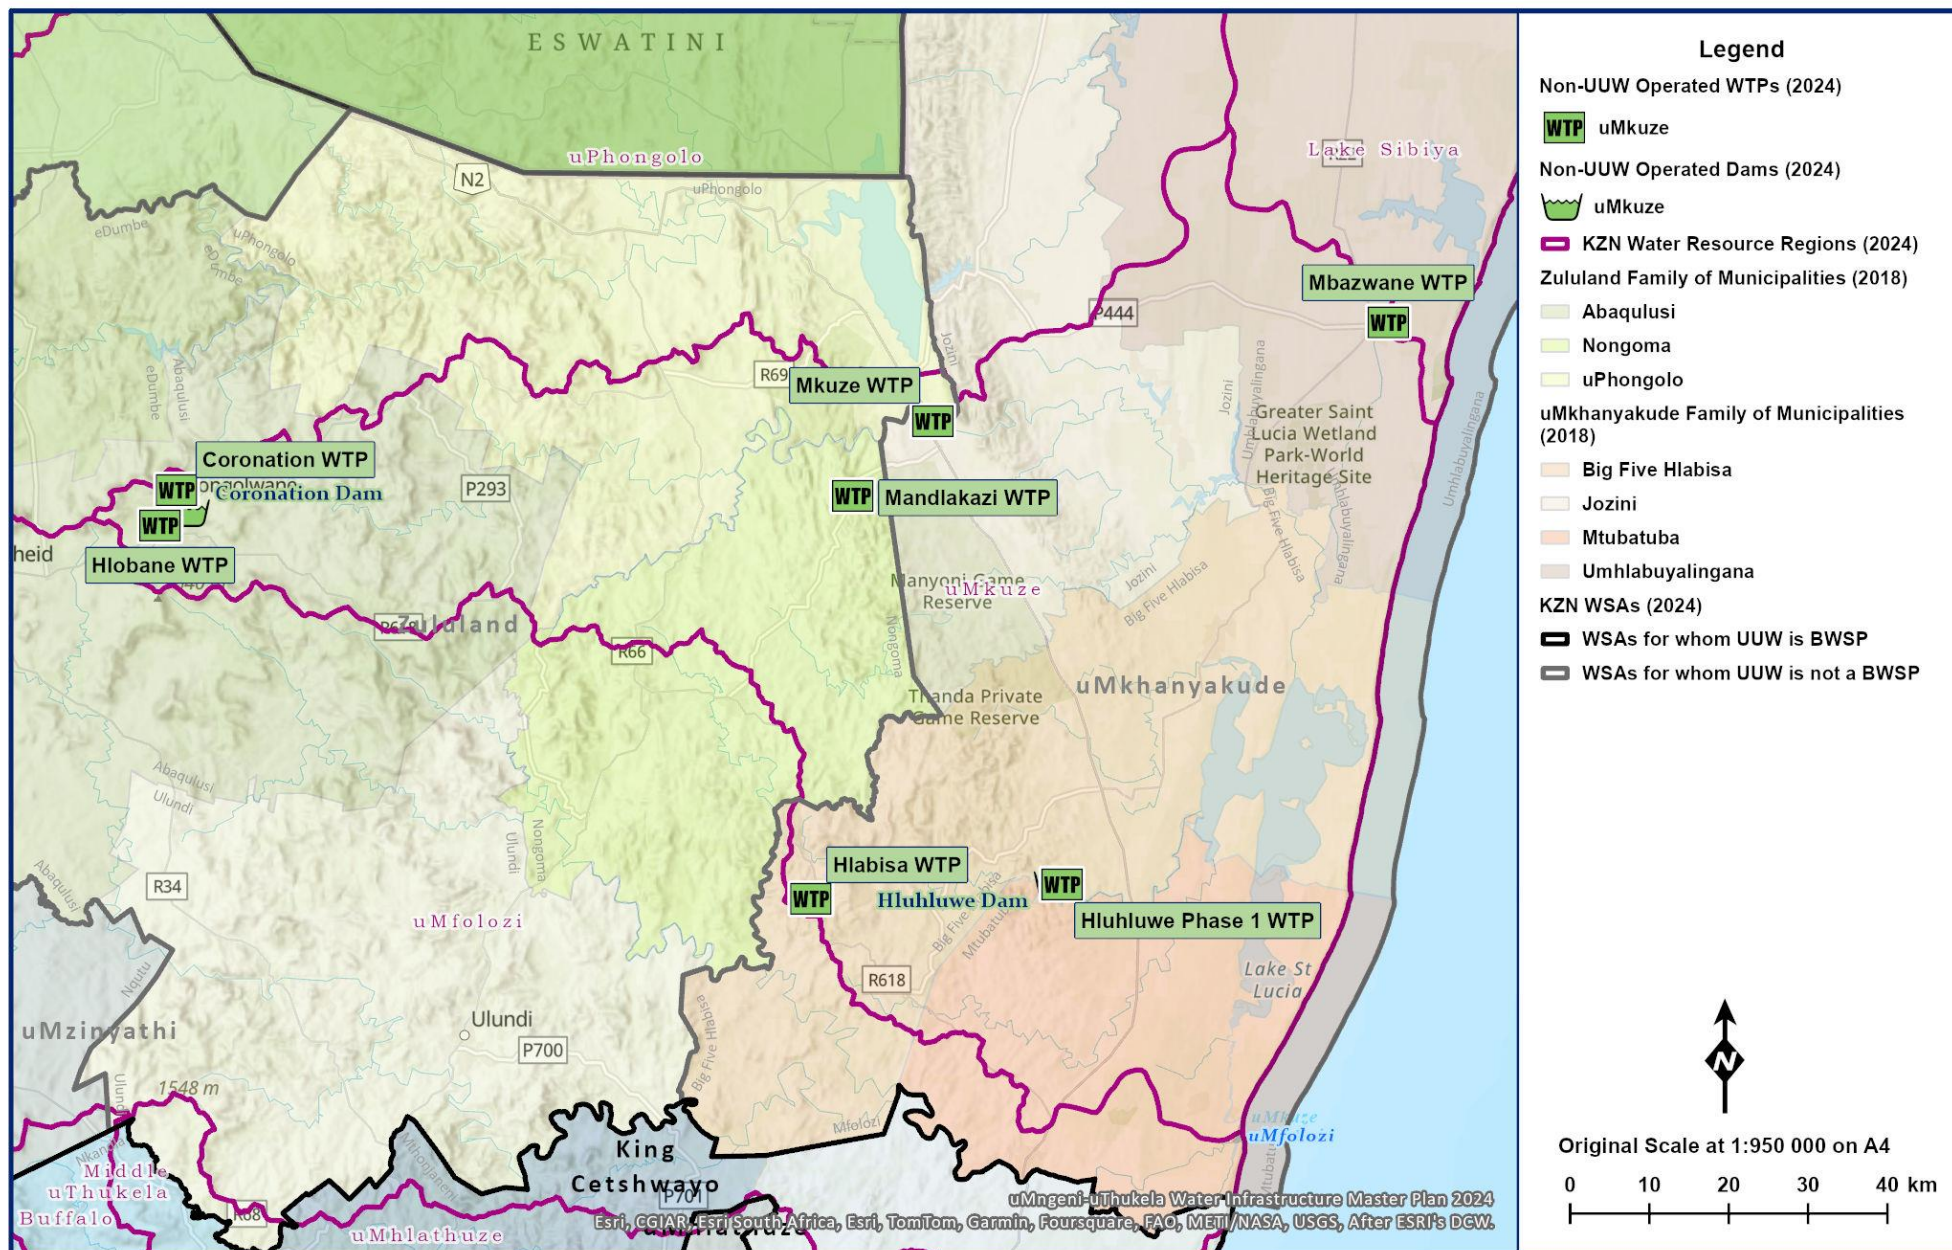


Figure 17.32 General layout of the uMkhuze System (MDB 2020).

(ii) uPhongolo Water Resource Region

The uPhongolo River passes through the Lebombo Mountains along the Zululand-Umkhanyakude municipal boundary and flows into the Pongolapoort Dam (commonly referred to as Jozini Dam). The river sources its water along the eastern escarpment of the Mpumalanga-KwaZulu-Natal provincial boundary. The uPhongolo River flows from the Zululand District Municipality, with some of its catchments situated in Swaziland. It passes through the Umkhanyakude District Municipality into Mozambique, where it becomes the Maputo River (**Figure 17.34**).

Water resources in the uPhongolo River system have been developed for conjunctive use. This includes direct abstraction from the Pongolapoort Dam and releases from the dam for downstream abstraction by existing water supply systems. The system also includes groundwater abstractions, particularly in the W70A coastal aquifer, and abstraction from Lake Sibaya.

Below the Pongolapoort Dam, the uPhongolo River meanders across a gently sloping floodplain with numerous pans which are dependent upon periodic flooding by the river (Lankford et al., 2011). The floodplain extends for approximately 50 km in length, varying in width between 0.8 and 4.8 km to the confluence of the Pongola and Usutu Rivers, on the border with Mozambique.

The uPhongolo System consists of the following water supply schemes:

- Simdlangentsha West WSS – this scheme sources its water from the uPhongolo River abstractions via run-of-river abstractions, as well as from the Bivane Dam.
- Simdlangentsha East WSS – this scheme sources its water from the uPhongolo River abstractions via run-of-river abstractions and supplies water to the town of Pongola.
- Mandlakazi Regional WSS – this scheme sources its water from the Pongolapoort Dam and supplies the area of Mandlakazi, located on the eastern side of the town of Nongoma.

The uPhongolo catchments are characterised by large-scale afforestation in the upper uPhongolo and Bivane tributaries, as well as large-scale irrigation in areas upstream of the Pongolapoort Dam. The main irrigated crop is sugarcane. Apart from the Pongolapoort and Bivane Dams, irrigators receive water through a system of canals constructed by the Department of Water and Sanitation (DWS) in the 1970s. This scheme is known as the Pongola Government Water Scheme and was upgraded in the early 1990s. The Bivane Dam also supplies the town of Pongola with water via irrigation canals in the lower uPhongolo Catchment. The Pongolapoort Dam is the main source of domestic water supply for downstream water users up to the border with Mozambique. Water is also transferred from the dam to the uMkhuze River where it supplies the Mkuze town as well as the Zululand DM.

The water supply schemes that are dependent on the Pongolapoort Dam, or could potentially be supplied from the system, include the following:

- Shemula WSS – this is the largest scheme which may be extended to include Phelindaba and KwaNgwanase in the future as continued groundwater abstraction may negatively impact on the wetlands in these areas. The Shemula WSS is dependent on releases from the Pongolapoort Dam.
- Jozini North and Nondabuya Schemes – these schemes are located on the left bank of Pongolapoort Dam and are supplied by an abstraction works on the left bank of the dam.
- Jozini-Makhathini WSS – This scheme supplies water to the town of Jozini, which is located on the right bank of Pongolapoort Dam and extends to the shores of the dam. The scheme extends into Makhathini Flats up to the small Muzi River and the uMkhuze River in the south. Depending on the availability of groundwater resources, as well as the water resource status of Lake Sibaya, the

scheme areas of Mbazwana and Mseleni may, in the long-term, be supplied from the uPhongolo River.

- uMkhuze-Ubombo WSS – This scheme is supplied from the uMkhuze River and supplemented by the uPhongolo River.

(iii) Lake Sibaya Water Resource Region

Lake Sibaya (or Lake Sibayi or Lake Sibhayi) is the largest freshwater lake in South Africa and currently supplies the Mseleni and Mbazwana Water Supply Systems. The lake has an estimated inflow of approximately 25 million m³/annum (UUW, 2020) and an estimated storage capacity of 858 million m³. The Lake Sibaya catchment has been documented to have high groundwater recharge and, as a result, there is high groundwater potential in the region. Although Lake Sibaya has an abundance of coastal resources, it is also susceptible to pollution and siltation due to human influences.

The Lake Sibaya catchment is groundwater-driven, with no major rivers flowing into the lake. Due to the sandy nature of the soils surrounding the lake, the amount of surface runoff is limited and, consequently, the lake water level is maintained largely by groundwater inflow (Smithers et al., 2017). The only significant surface drainage feature for the Lake Sibaya catchment is the Mseleni Stream, feeding the western arm of the lake (**Figure 17.35**).

Lake Sibaya's area of supply faces a physical water scarcity threat as the lake's water level has been constantly declining since the year 2000. This is a major concern among local stakeholders as the lake is the main source of water for the local town of Mbazwana and surrounding areas. From what was once a big, 70 km² freshwater body, Lake Sibayi has now been disjointed into different sections, with the southern arm being completely removed from the main lake. Due to the good rainfall received over the last three years, some signs of recovery have been observed, with some parts of the lake being rejoined with the main lake.

The main economic activity in the lake's catchment, commercial forestry (covering 115 km² of the catchment), has been suggested to be the major driver of the declining lake levels (Smithers et al., 2017). Due to their tall, dense and evergreen canopies (which maintain a relatively high leaf area index over the entire year), commercial forest plantations have been found to use more water than replaced natural grasslands. In addition, commercial forest plantations are characterized by deep rooting systems, which have an ability to access groundwater reserves.

Another major cause of the declining water levels is the observed below-average precipitation received in the area since cyclone Eline in 2000 (Smithers et al., 2017). In contrast to the low precipitation levels, the population and hence the demand for domestic water supply has been gradually increasing. Abstraction for local domestic water supply has been estimated to be 1.35 million m³/annum and may increase in the medium-term. The declining lake water level will impact on the lake's yield, thus increasing the risk of non-supply.

The lake's condition has attracted interest from various stakeholders. In particular, the South African Environmental Network (SAEON) has developed a network of hydro-meteorological monitoring equipment and stations to enhance the understanding of the relationship between local climate, land use and lake water levels. Variables being monitored include the lake's water level, groundwater levels in strategic points, water level in the Mseleni stream and climatic variables (e.g. rainfall, temperature, humidity, etc.) at various parts of the catchment.

SAEON's research also seeks to establish an understanding of water movement in the lake's catchment area, as well as the lake's interaction with the sea. Although the volumes are not fully understood, some studies suggest that a relatively small amount of water may be lost from the lake through seepage to the sea.

The observed negative changes to Lake Sibayi's physical characteristics have prompted the local communities to investigate the potential to invest in alternative land use activities to yield higher economic returns with a lower water footprint, as opposed to commercial forest plantations (Shabalala et al., 2022). There is ongoing research to investigate the water use of macadamia nut trees as a potential replacement for commercial forest plantations in the area. Developments from this study will be reported when the results are available.

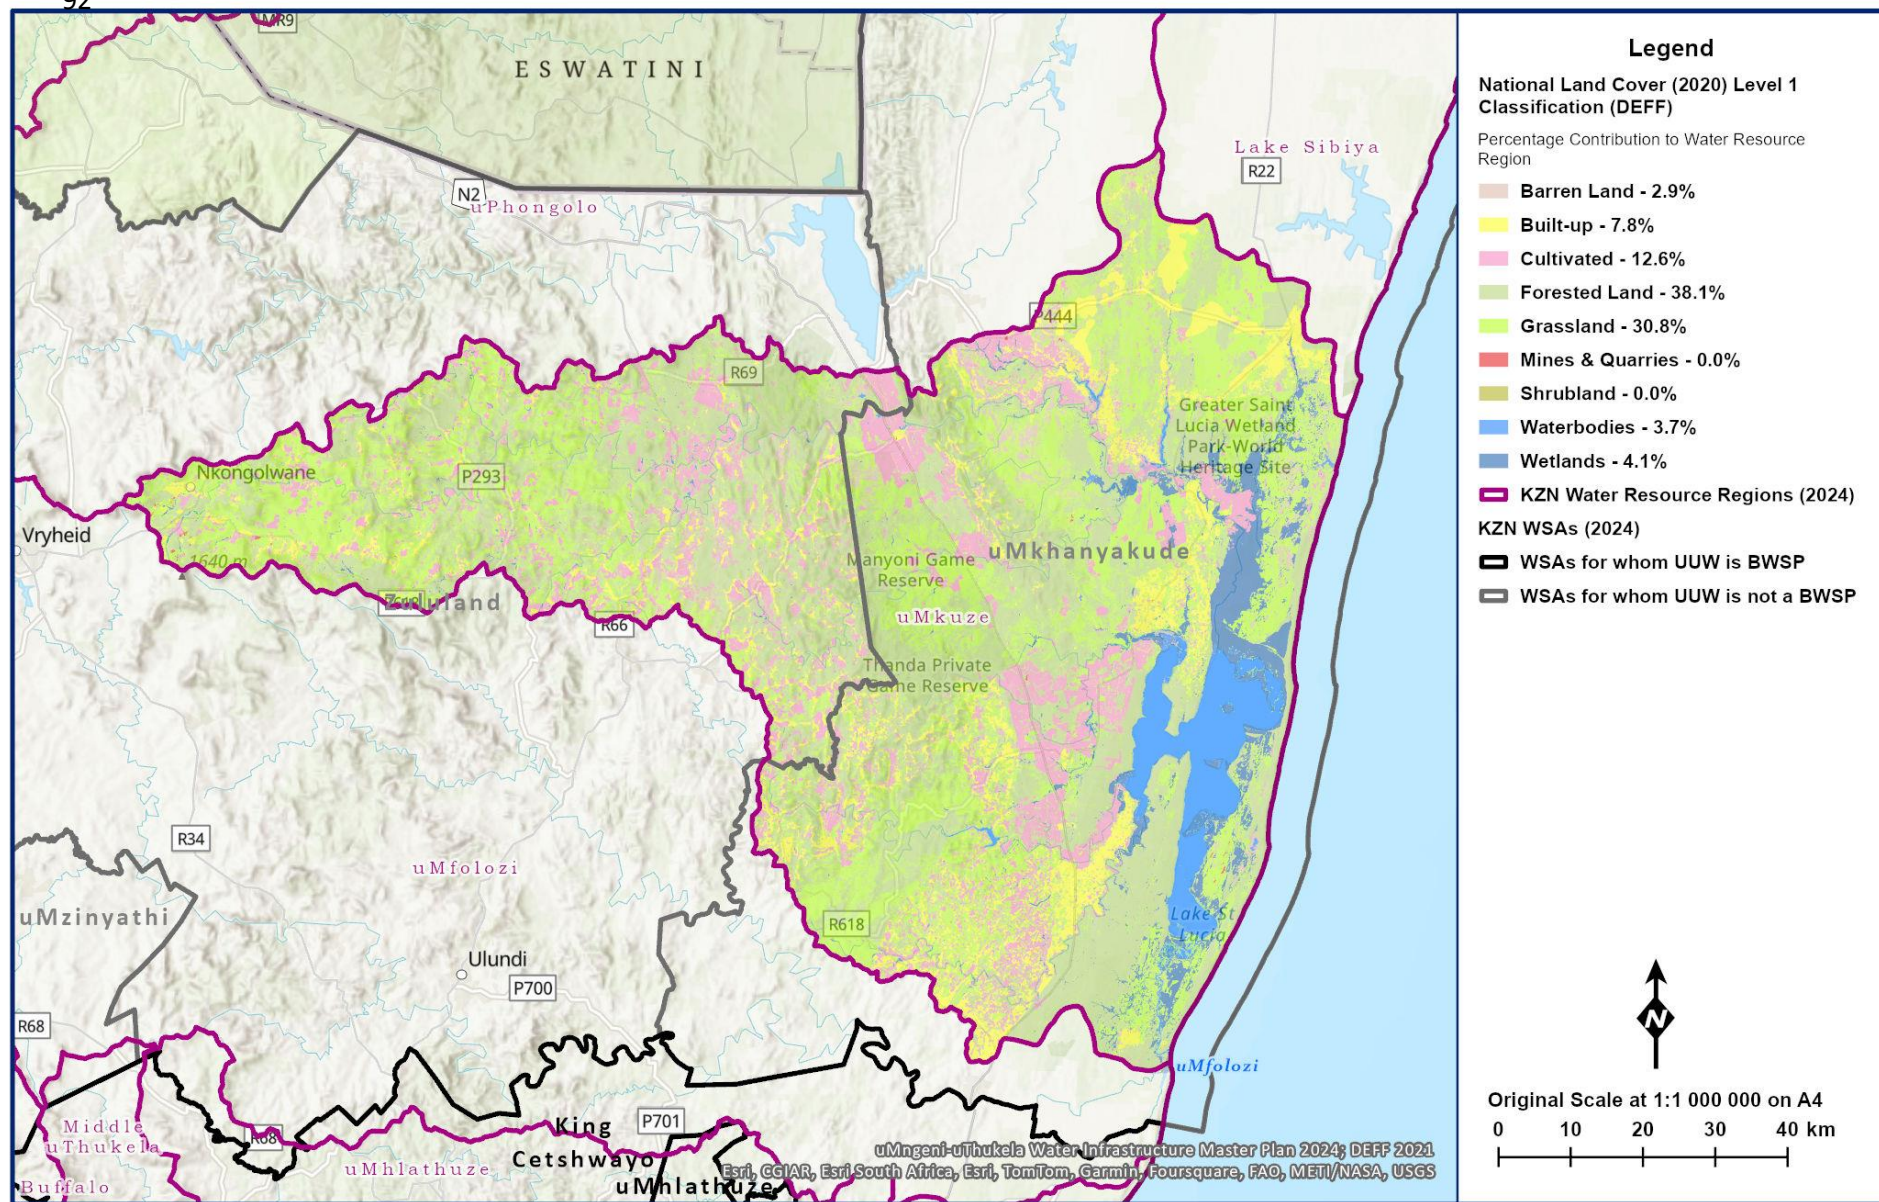


Figure 17.33 General Layout of the uMkhuzi Region (DEFF 2020, MDB 2020, Umgeni Water 2022, WR2012).

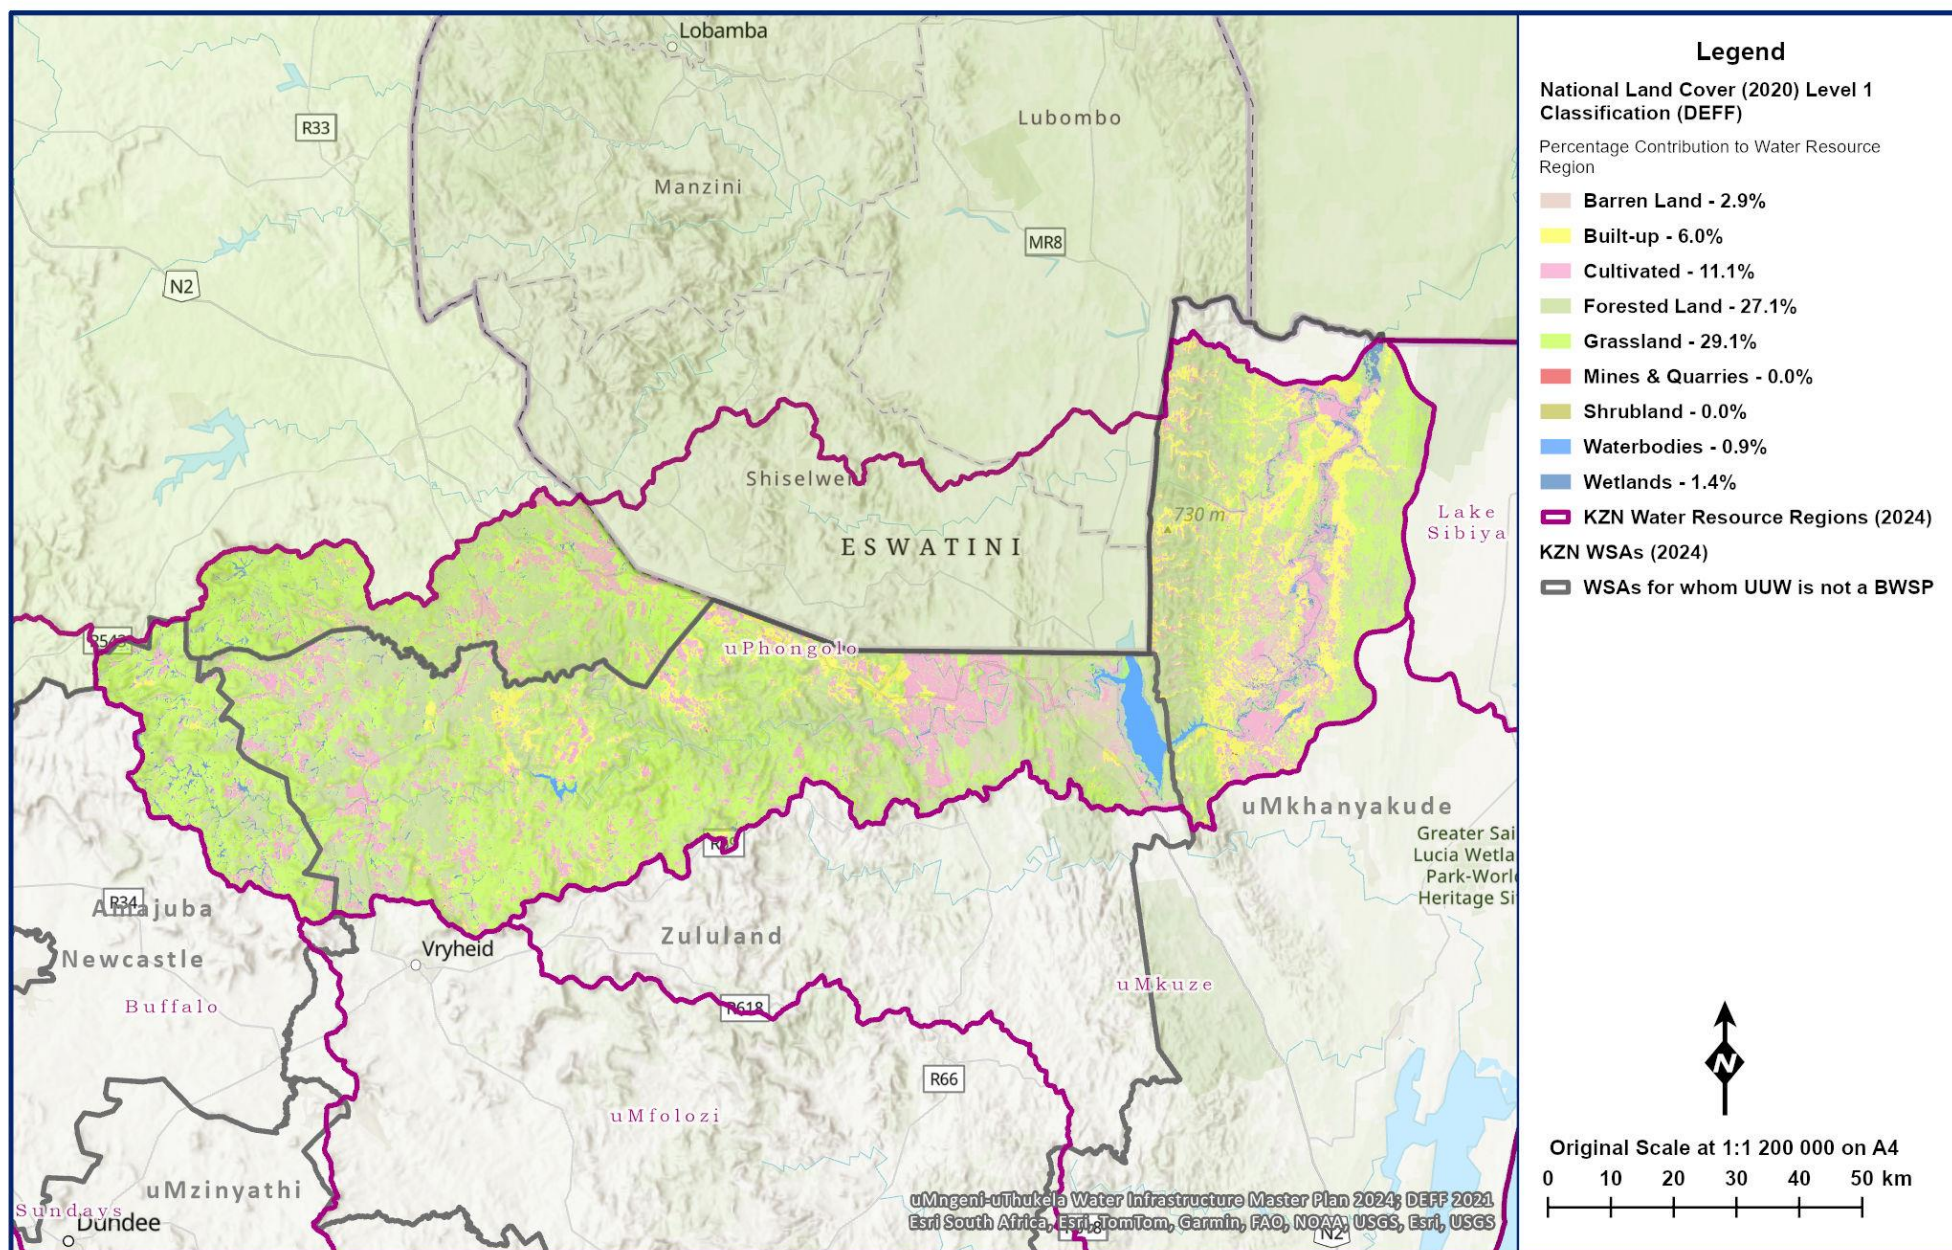


Figure 17.34 General Layout of the uPhongolo Region (DEFF 2020, MDB 2020, Umgeni Water 2022, WR2012).

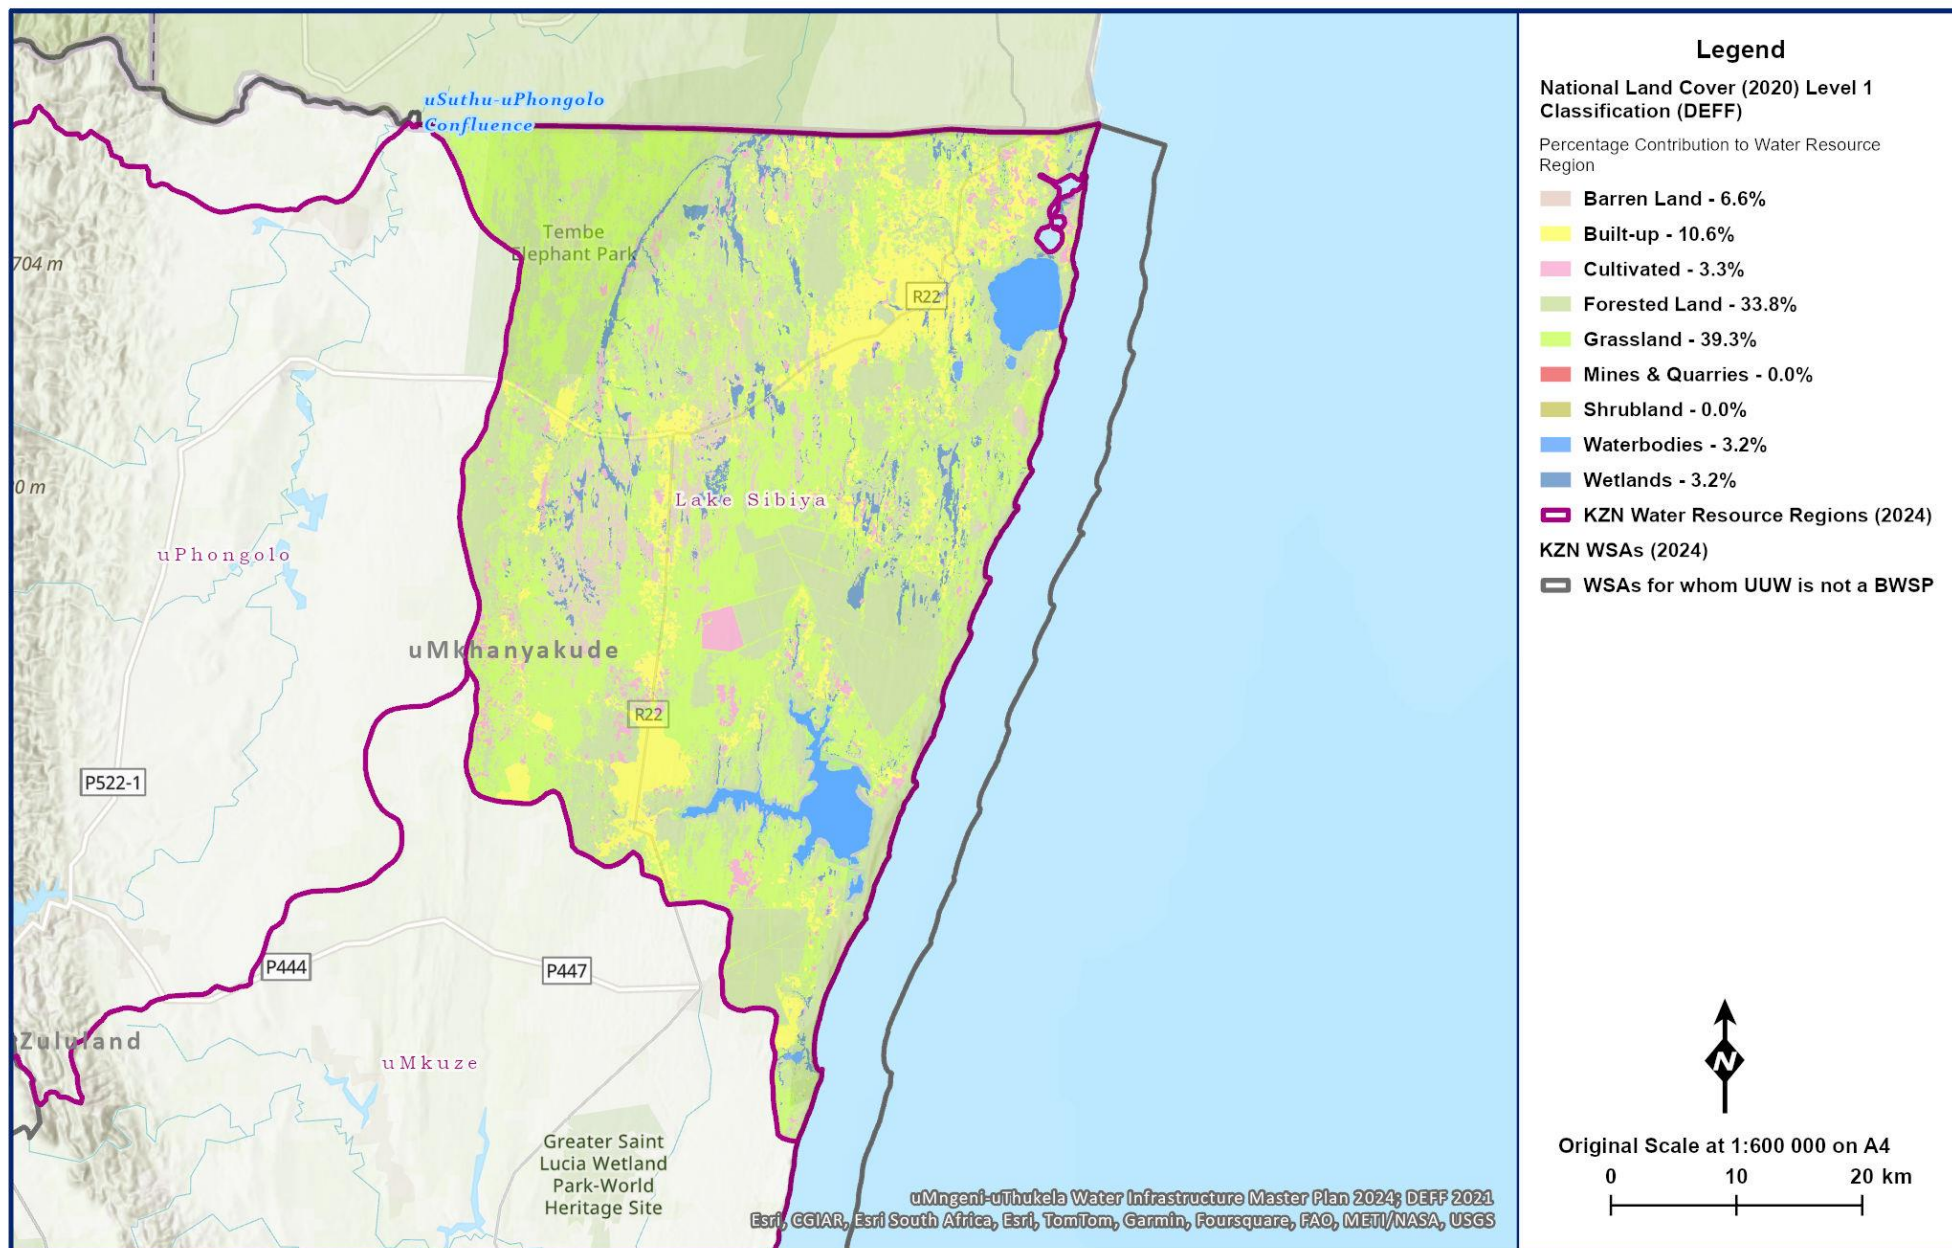


Figure 17.35 General layout of Lake Sibayi System (DEFF 2020, MDB 2020, Umgeni Water 2022, WR2012).

(b) Surface Water

The hydrological characteristics for the uMkhuze, Uphongolo and Lake Sibayi Water Resource Regions are summarised in **Table 17.35**, **Table 17.36** and **Table 17.37**, respectively.

Table 17.35 Hydrological characteristics of the uMkhuze Region (WR2012: Usutu-Mhlathuze Quat Info WMA 6 7Jul2015 spreadsheet)

Region	River (Catchment)	Area (km ²)	Annual Average			
			Evaporation (mm)	Rainfall (mm)	Natural Runoff (million m ³ /annum)	Natural Runoff (mm)
uMkhuze	uMkhuze River (W31)	4 630	1 435	851	469.9	101.5
	uMkhuze River (W32)	4 916	1 491	778	291.3	59.3
	Total	9 546				

Table 17.36 Hydrological characteristics of uPhongolo Region (WR2012: Usutu-Mhlathuze Quat Info WMA 6 7Jul2015 spreadsheet)

Region	Tertiary Catchments	Area (km ²)	Annual Average			
			Evaporation (mm)	Rainfall (mm)	Natural Runoff (million m ³ /annum)	Natural Runoff (mm)
uPhongolo	W41	1 691	1 413	887	264.5	156.4
	W42	4 088	1 423	863	564.2	138.0
	W44	2 003	1 500	619	51.9	25.9
	W45	1 798	1 500	615	49.9	27.8

Table 17.37 Lake Sibaya Hydrological Characteristics (WR2012: Usutu-Mhlathuze Quat Info WMA 6 7Jul2015 spreadsheet)

Region	Lake Sibaya (Catchment)	Area (km ²)	Annual Average	
			Evaporation (mm)	Rainfall (mm)
Lake Sibaya	Lake Sibaya (W70A)	530	1 500	769

According to the Zululand District Municipality Water Services Development Plan (2004):

“The total surface water resources of the uPhongolo catchments are estimated at about 910 million m³/annum, and return flows are estimated to be about 10% of the irrigation demand, or 20 million m³/annum. The water resources of the uPhongolo catchments are fully developed through the Pongolapoort Dam. The dam is a 2.5 x MAR dam which produces a large yield from the substantial runoff of the uPhongolo catchments and there is no further scope for increasing the yield as a whole. However, surplus yield is available although there are uncertainties regarding the magnitude due to uncertainties surrounding the

environmental requirements. The Bivane Dam was constructed in the Bivane catchments to increase the assurance of supply to irrigators upstream of the Pongolapoort Dam. There is an existing operating rule that determines the frequency and magnitude of flood releases from the Pongolapoort Dam to meet social and environmental requirements on the flood plains downstream of the dam. These releases reduce the yield of the Pongolapoort Dam substantially (by about 250 million m³/annum). However, the downstream parties do not always welcome these releases and Mozambique has recently objected, as have riparian farmers along the lower uPhongolo River”.

(c) Groundwater

(i) Mkuze Region

The Mkuze Region is located in two hydrogeological regions, the North Zululand Coastal Plain and Southern Lebombo (DWAF, 2008) (**Figure 17.36**).

Hydrogeological Units

The inland area, west of the coastal strip is dominated by the igneous and sedimentary rocks of the Karoo Supergroup. The Lebombo Group basalts and rhyolites make up the majority of the igneous lithology. The sedimentary shales, mudstones and sandstones can be found in the Beaufort and Ecca Groups.

In the coastal strip the Zululand Group is made up of mainly siltstones, conglomerates and sandstones and overlies the volcanic succession of the Lebombo Group. The Zululand Group underlies most of the coastal plain, but are exposed mainly along its inland westerly marginal areas along the Lebombo.

Geohydrology

The coastal area is unique in that it essentially comprises an unconsolidated to semi-consolidated sedimentary sequence, with few “hard-rock” areas. Another aspect that is of importance is the interaction between the many natural inland lakes and the groundwater regime.

The basal conglomerate layer of the Zululand Group, the Makatini Formation, is the most promising horizon geohydrologically. The Mzinene and St Lucia Formations have a low permeability and water quality is generally extremely poor. These formations are overlain by the Uloa Formation. In terms of water bearing characteristics this is the best aquifer in the entire succession. The Uloa Formation is in turn overlain by the unconsolidated Aeolian sands of the Port Durnford Formation. The overlying sands of the Berea Formation cover large parts of the area.

Important geohydrological units inland include the sandstones of the Vryheid and Natal Group. Groundwater occurrence in the Vryheid Formation sandstone is generally associated with dolerite intrusions, fractures and faults. The difference in the formation of secondary porosities in the Natal Group and the Vryheid sandstone is the absence of dolerite intrusions affecting the former.

Very few lineaments of regional scale and no dykes are discernible in the area underlying the Natal Group sandstone.

Groundwater Potential

The Zululand coastal plain has a huge groundwater development potential. The Port Durnford Formation acts as a huge storage reservoir for the Uloa aquifer, although it also is a good aquifer.

Production boreholes developed in these formations are capable of producing yields of up to 15 ℓ/s provided the boreholes are well designed and developed.

The sands of the Berea Formation are frequently exploited for water by the local population. Hand dug wells of approximately one metre in diameter and generally less than 5 m in depth are common throughout the area. These are usually equipped with handpumps or left open. If properly developed and with appropriate screens and gravel packs, these sands can yield up to 4 ℓ/s.

The flat coastal plain and shallow groundwater table, results in a close relationship between the surface water bodies (inland lakes) and the groundwater. The Zululand coastal plain is a largely unexploited aquifer system, however, it is delicately balanced and the environmental consequences should be examined before exploitation is considered.

Water Quality

The chloride content, as a percentage of the total dissolved solids is generally high in the study area. However, it is effectively washed away in sections where the effective Mean Annual rainfall (MAR) is high. In the western areas of the study area, surrounding Hlabisa, where the MAR is in excess of 1000 mm/annum, the chloride content in borehole water is lowest. The relatively high chloride content in geological Groups and Formations particularly in the Dwyka (Tillite) Formation, the Eccra Group and the Letaba Formation basalt, is due to salt being carried inland by the prevailing winds from the Indian ocean as far as the escarpment.

The magnesium concentrations in the Letaba Formation are the product of dissolution of mafic minerals such as olivine, are relatively high averaging 65 mg/ℓ.

Groundwater from Vryheid sandstone is characterised by a wide range in electrical conductivity. This can be associated with the situation that some of the boreholes were drilled into the contact zone between the dolerite and the surrounding sandstone, others in unaltered host sandstone.

The overall quality of groundwater in the coastal plain is good, with pH generally ranging between 6 and 9 and electrical conductivity (EC) generally < 100 mSm. There appears to be a correlation between the geology and the EC. Low EC (< 50 mSm) appear to be concentrated in the eastern parts of the coastal plain, whereas the higher EC ground waters tend to be associated with the older geological formations (Uloa and Lebombo).

(ii) Phongola Region

The Phongola Region is located in four hydrogeological regions, the Northern Zululand Coastal Plain, Southern Lebombo, Northeastern Middleveld and. Northwestern Middleveld.

Hydrogeological Units

The catchment is distinctive from others in the province due to the dominance of the Pongola Supergroup for almost the entire area. These metamorphosed sedimentary rocks and volcanic rocks rest unconformably upon the granites. There are several major structural trends in these rocks, indicative of a complex structural history; the strata are folded and extensively fractured and faulted.

Rocks of the Karoo Supergroup comprising the Dwyka, Pietermaritzburg and Vryheid Formations are found surrounding Jozini Dam. The Dwyka formation lies unconformably on the underlying Basement Granite, Pongola and Natal Group rocks.

Dolerites are unusual in the Pongola rocks where older diabase dykes are prominent.

Geohydrology

The Pongola rocks can be weathered up to 30m deep and are placed in the weathered and fractured class. Weathering of the Tillite is limited and generally <20m, therefore the Dwyka Formation is classified as a fractured aquifer. The main control to exploitable groundwater occurrence in the Pietermaritzburg shales is the presence of fracturing associated with the dolerite intrusive. The aquifer is classified as fractured. Weathering of the Vryheid Formation sandstone is limited to less than 20m and groundwater is controlled by fracturing, jointing and contact zones with dolerite intrusives. The aquifer is assigned to the fractured class.

Groundwater Potential

There are relatively few boreholes in the area of the Pongola rocks due to the rugged topography and reliance on springs and surface water. This area is well watered by rivers and streams. Borehole records for this area indicate that some very good yields have been achieved. These boreholes are in the Simlandgentsha District and have blow yields of 11 to 21 ℓ/s. These are however, exceptionally high yields. Typical yields are in the moderate range (0.5 to 3 ℓ/s). Reported water strikes range from 6m to 119m, with a median of 32m. This relatively shallow depth indicates that weathering plays an important role in the mode of groundwater occurrence in the Pongola rocks.

The Dwyka is generally a moderate aquifer with boreholes having yields of 0.5 to 3 ℓ/s. However, the Dwyka Tillite has the largest marginal class (<0.1 ℓ/s) when compared to the other hydrological units.

Borehole yields in the Pietermaritzburg shales are generally moderate. Due to the relatively narrow outcrops of the shale in many area, boreholes in which the Pietermaritzburg Shale is an aquifer often comprise other hydrological units e.g. Vryheid Formation. Yields in the Vryheid Formation are moderate having a yield of 0.5 to 3 ℓ/s. Dykes and sills are important for the occurrence of groundwater in these sandstones as for that in the Pietermaritzburg Shales.

Water Quality

When analysing groundwater water quality consideration must be given to the fact that water strikes in secondary fractured aquifers occur along lithological breaks and possibly two dissimilar rock types, which can have an influence on the water chemistry. The groundwater is generally of good quality (<70 mSm). Groundwater of unacceptable quality is found in areas in the Dwyka Tillite and Pietermaritzburg Formation shales.

Nitrate levels are generally below the maximum guideline of 5 mg/ℓ as N. Areas with higher nitrate where prone to be situated too close to a source of organic waste e.g. pit latrines.

Fluoride values are also generally below the maximum guideline value of 1 mg/ℓ.

Ambient water quality is generally good, with Total Dissolved Solids (TDS) ranging from 300 mg/ℓ for boreholes in the Vryheid Formation to 900 mg/ℓ for the Natal Group.

(iii) Lake Sibaya

The Lake Sibaya region is located in the Northern Zululand Coastal Plain hydrogeological region (DWS, 2008) (**Figure 17.38**).

Hydrogeological Units

The area is essentially a flat sandy coastal plain. Geologically the area is covered by mainly unconsolidated to semi-consolidated fine sands overlying rocks of Tertiary and Cretaceous age. No structural geological features that influence groundwater conditions have been identified in the area.

The rocks of Tertiary and Cretaceous age can be regarded as floor rocks. The Zululand Group of mainly siltstones, conglomerates and sandstones overlies the volcanic succession of the Lebombo Group. This group consists of three stratigraphically conformable formations, the St Lucia, Mzinene and Makatini. These underlie most of the coastal plain, but are exposed mainly along its inland westerly marginal groundwater areas along the Lebombo.

The Lebombo Group is overlain by the Uloa Formation which is richly fossiliferous and one of the main aquifers in the succession.

The Uloa Formation is overlain by the Port Durnford formation, which is a thick succession of loosely consolidated sands, silts, clays and lignite.

The Port Durnford Formation is overlain by fluvial and Aeolian sands.

Geohydrology

The area is covered by essentially unconsolidated to semi-consolidated fine sands containing varying amounts of clay and silt. This aquifer is therefore classified as intergranular in nature.

The Uloa Formation shows numerous karstic conditions and is therefore classified as “Karstic”.

The Port Durnford has a large storage capacity and low permeability due to fine grain size and argillaceous character in places. The Port Durnford is classified as intergranular in nature.

Groundwater Potential

In terms of groundwater potential the Makitini Formation is the most promising horizon. The sedimentary rocks of the Mzinene and St Lucia formations have low permeability and water quality is generally poor.

The Uloa Formation has good groundwater potential and numerous boreholes extracting in excess of 10 ℓ/s from the upper parts of this unit.

The Port Durnford has a large storage capacity and low permeability due to fine grain size and argillaceous character in places. Production boreholes developed in this formation are capable of producing yields of up to 15 ℓ/s

Because of the generally shallow water levels in the overlying sands covering large parts of the area, the local population frequently exploits these for water. Hand dug wells of approximately 5 m deep are common and are usually equipped with handpumps or left as open wells.

Water Quality

Overall the water quality is good with almost 90% of all groundwater samples analysed have electrical conductivity of <100 mS/m.

The quality of groundwater in the Lebombo Group is extremely poor with TDS values typically >5000 mg/ℓ.

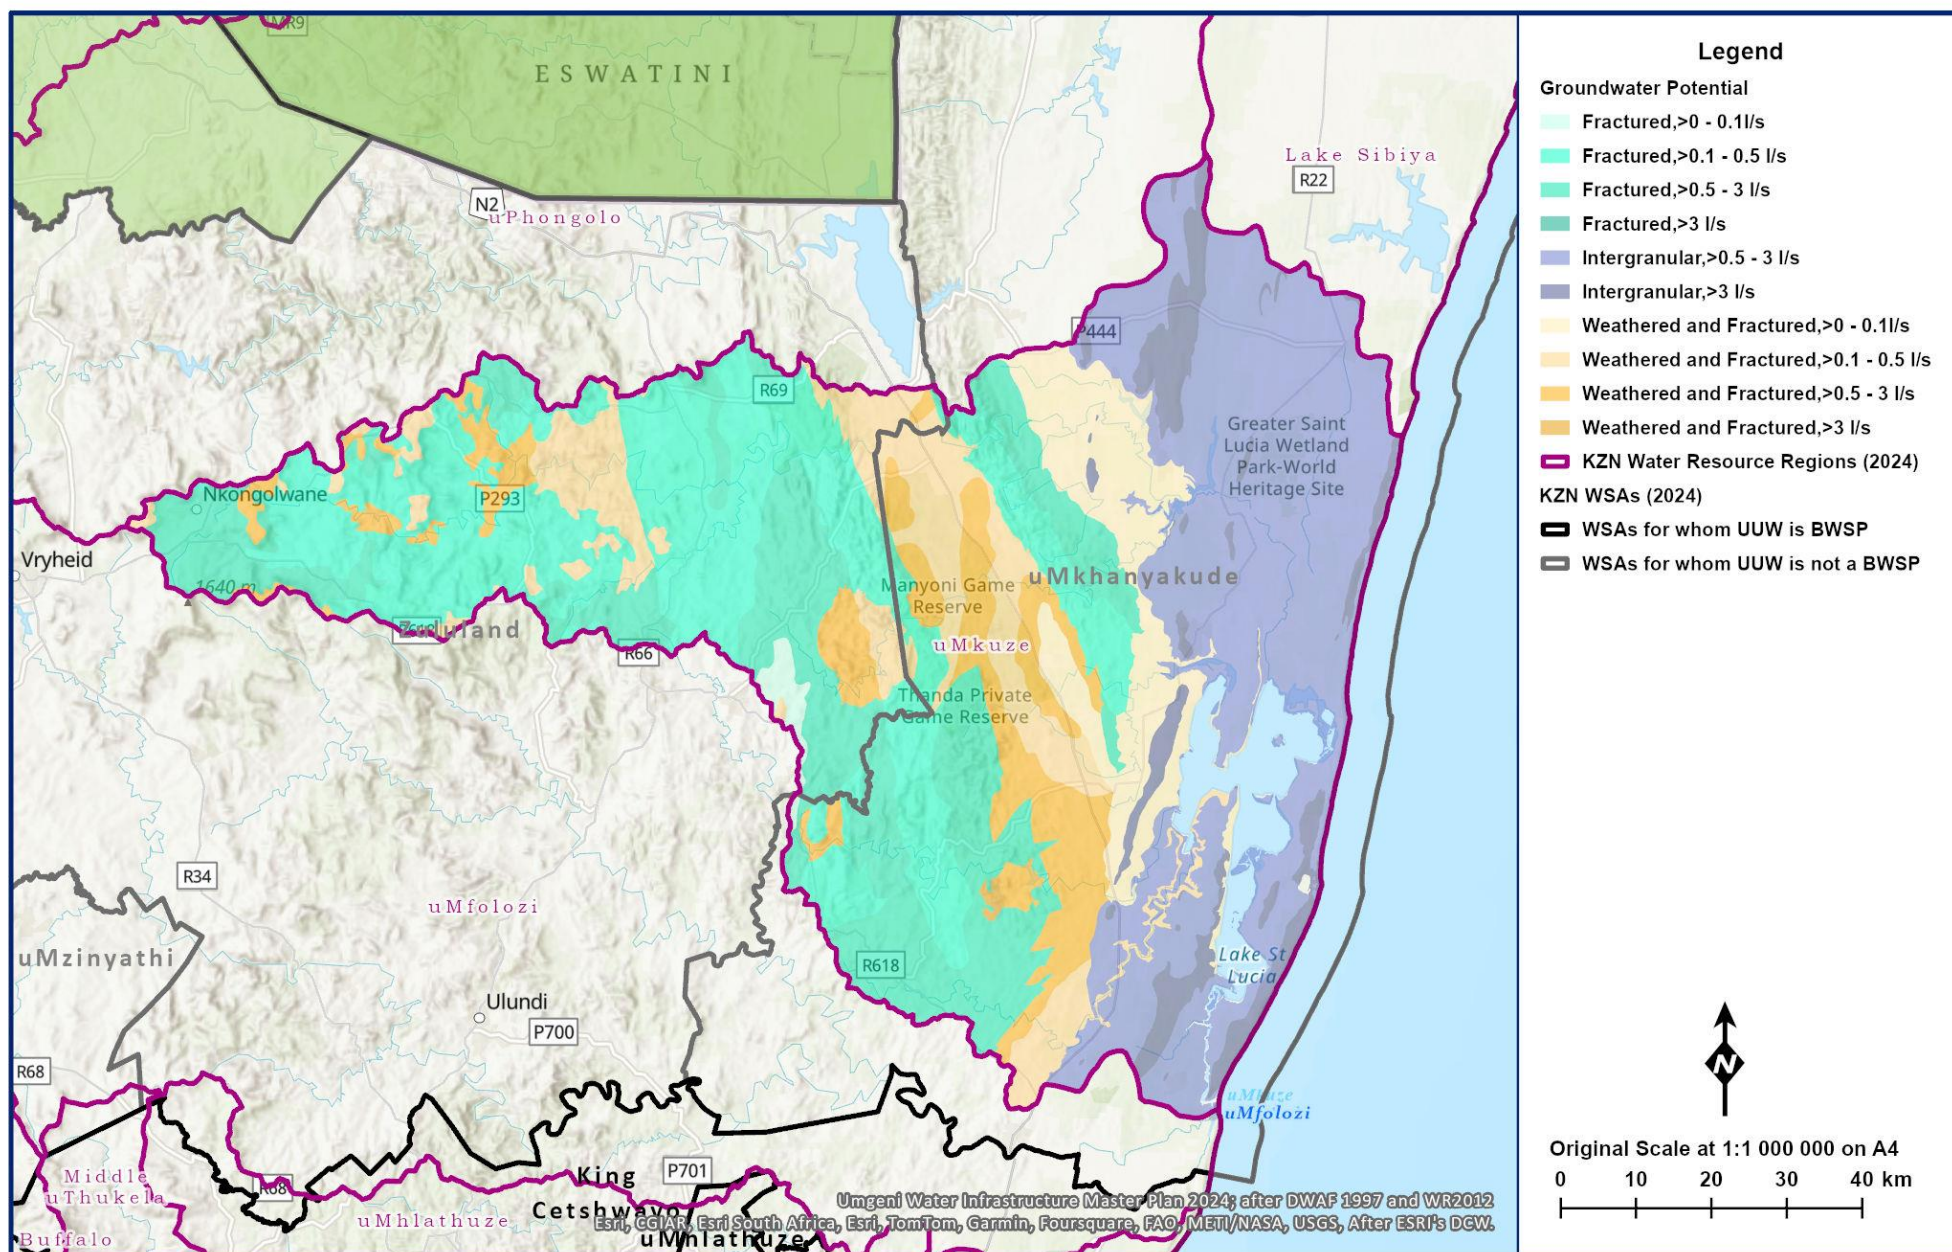


Figure 17.36 Groundwater potential in the uMkhuze Region (MDB 2020, Umgeni Water 2021, after DWAF 1997 and WR2012).

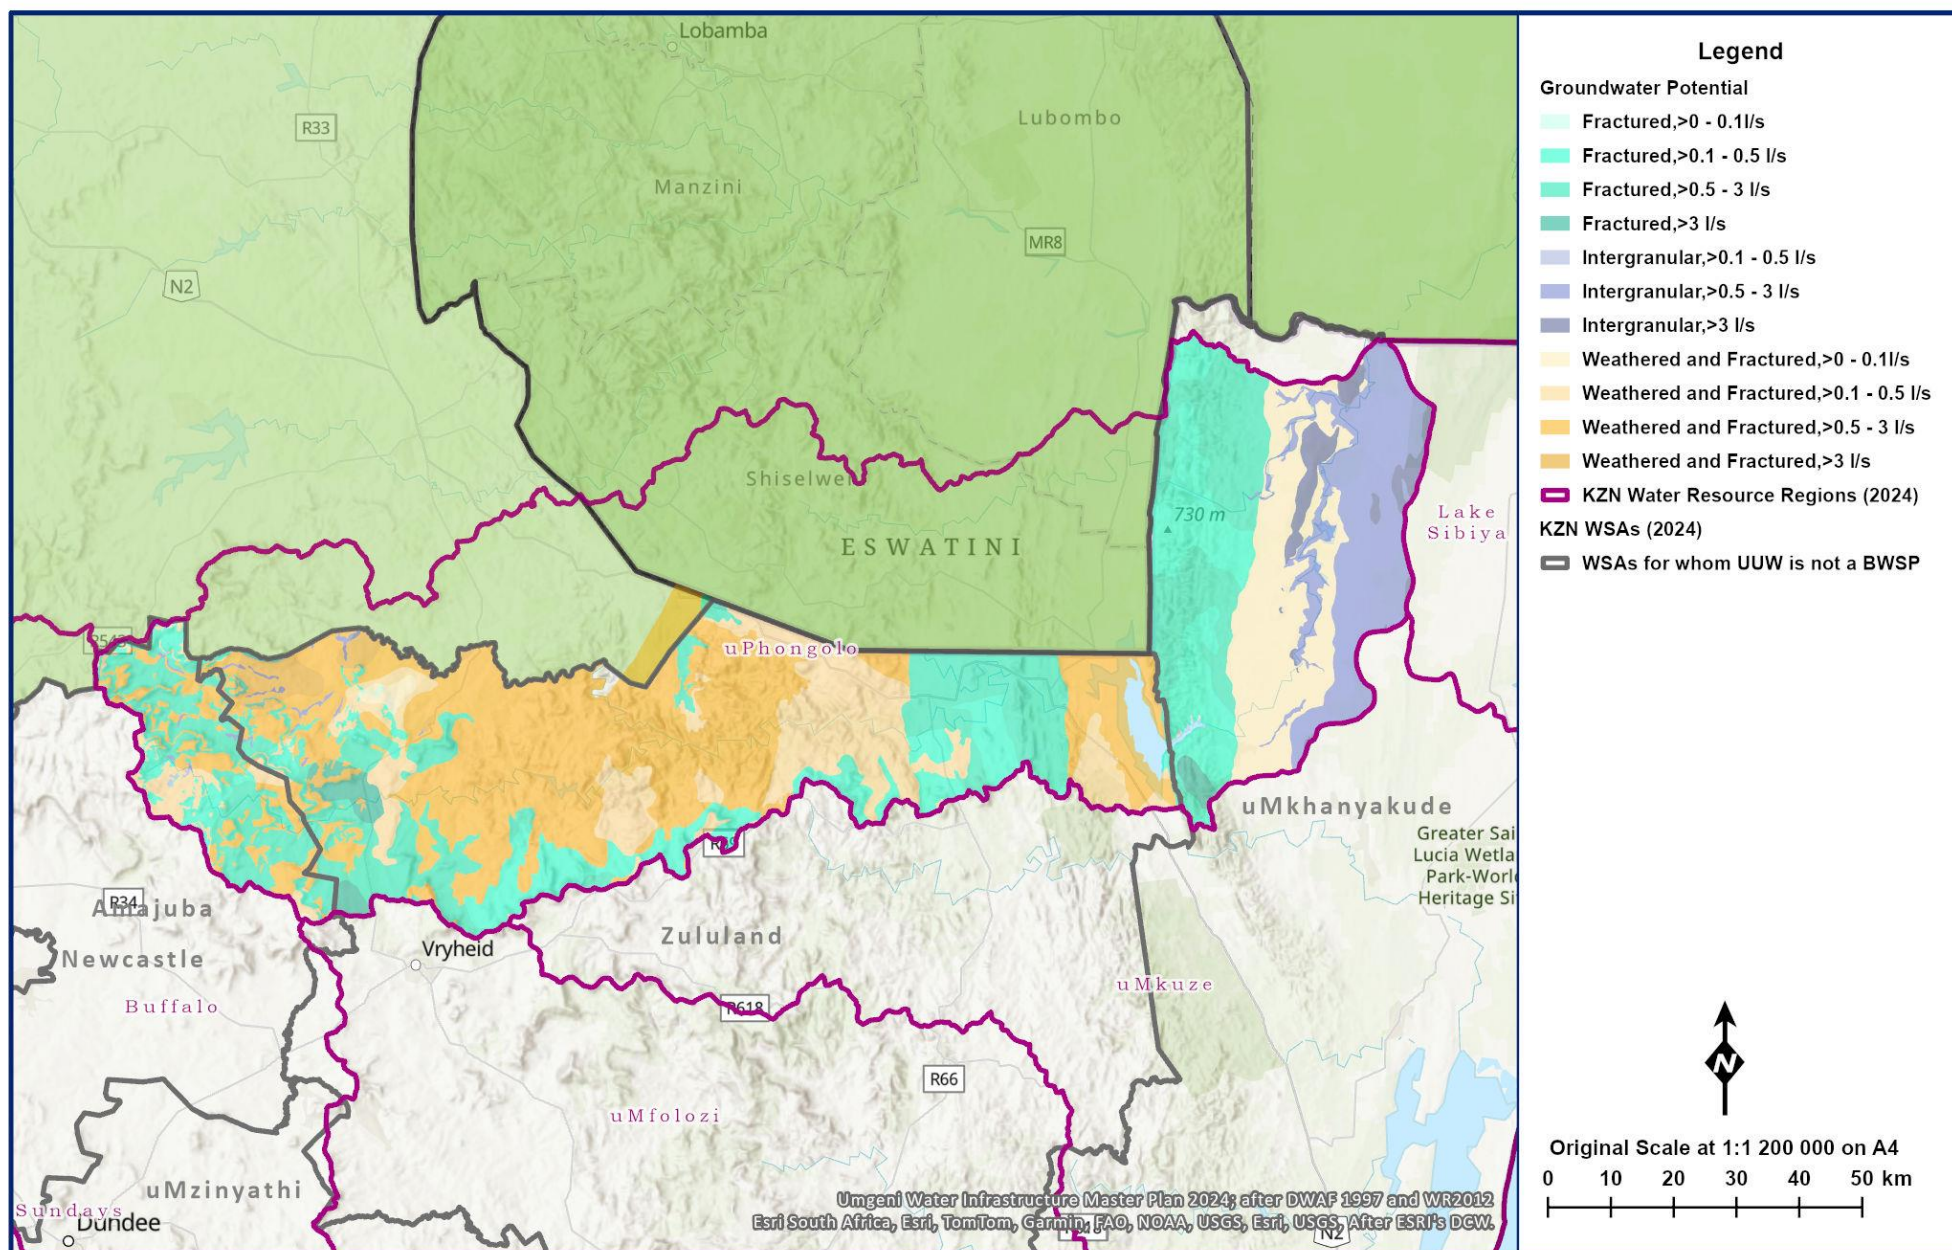


Figure 17.37 Groundwater potential in the Phongola Water Resource Region (MDB 2020, Umgeni Water 2022, after DWAF 1997 and WR2012).

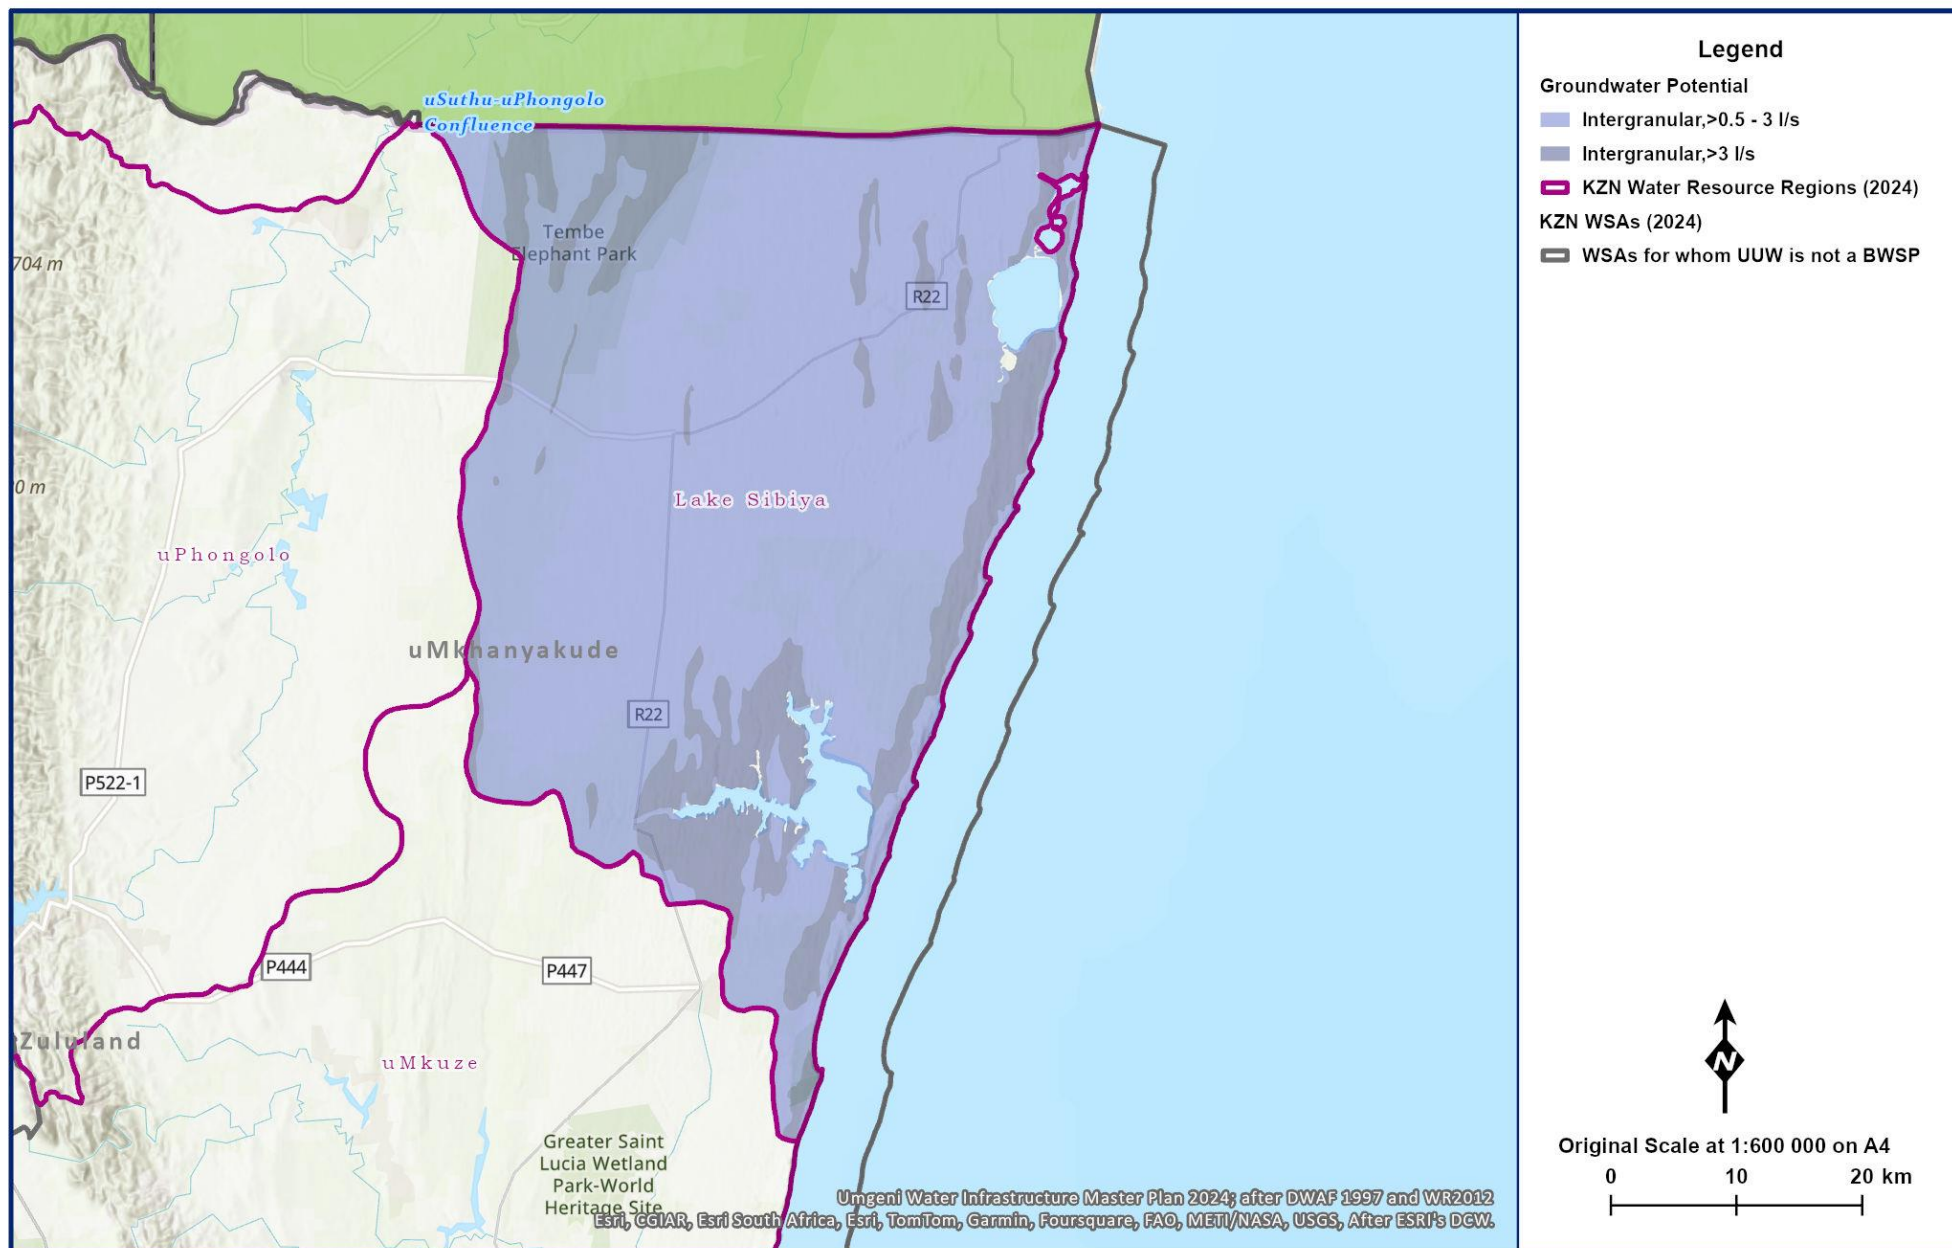


Figure 17.38 Groundwater potential in the Lake Sibaya Water Resource Region (MDB 2020, Umgeni Water 2022, after DWAF 1997 and WR2012).

18.1.2 Reserve

In December 2021, DWS commissioned a study entitled *Classification of Significant Water Resources and Determination of Resource Quality Objectives (RQOs) for Water Resources in the Usutu to Mhlathuze Catchments* in order to reassess the present ecological status of water resources in the region. The study will also make recommendations for the targeted ecological status of the different parts of this Water Resource Region. The study is expected to be completed in July 2024; however, some components of the study have been finalised – including the RQOs for rivers, wetlands and estuaries. Key findings from the study are summarised below. It is important to note that these findings are yet to be officially Gazetted by DWS and any changes included in the final Gazette will be included in the 2025 Infrastructure Master Plan.

(a) uMkhuze River

One of the main challenges facing the uMkhuze River is poor water quality due to the combined effects of coal mining, forestry, off-channel dams, rural areas, irrigated crops, alien vegetation, intream dams, erosion and sedimentation in its catchment. Extensive commercial and subsistence farming is one of the major contributors to the poor water quality due to on-farm management practices such as the use of fertilisers. The present ecological status of the uMkhuze River is Category B/C and the recommended ecological category is Category B/C. From a water quantity perspective, it is recommended that the following monthly river flow targets be met:

- The total annual flow should at least be 58.87 million m³ (37.1% of the natural MAR);
- The total annual requirement for low flows is 34.74 million m³ (21.9% of the natural MAR);
- A flow rate of 0.90 m³/s should be exceeded 60% of the time during February (i.e. high flow);
- A flow rate of 0.40 m³/s should be exceeded 90% of the time during September (i.e. low flow).

(b) uPhongolo River

The uPhongolo River discharges into the floodplains downstream of the Pongolapoort Dam and, as a result, the environmental flows of this river are critical to maintaining the ecological health of this resource. A rapid assessment of the Ecological Reserve was carried out for the Pongolapoort and Bivane Dams and an operating rule has been developed to ensure an appropriate magnitude of water is released from the Pongolapoort Dam to meet social and environmental requirements on the flood plains. These releases reduce the yield of the Pongolapoort Dam substantially (by about 250 million m³/annum). The present ecological status of the uPhongolo River is Category C. The recommended ecological category is Category C, which means that the current river ecological status must be maintained. From a water quantity perspective, it is recommended that the following monthly river flow targets be met:

- The total annual flow should at least be 97.31 million m³ (27.3% of the natural MAR);
- The total annual requirement for low flows is 58.84 million m³ (15.4% of the natural MAR);
- A flow rate of 1.98 m³/s should be exceeded 60% of the time during February (i.e. high flow);
- A flow rate of 0.32 m³/s should be exceeded 90% of the time during September (i.e. low flow).

(c) Lake Sibaya Water Resource Region

The present ecological state of Lake Sibayi is Category B and the recommended ecological state is Category B. Inflow water quality is one of the major threats to the lake's ecological status, due to effluent inflow from the Mseleni Hospital and farming activities.

(d) uMgobozeleni Estuary

The W70 catchment includes the uMgobozeleni Estuarine Lake system, which is part of the iSimangaliso Wetland Park. This Estuary has been recently discovered to be an important system for marine biodiversity, and it is essential that it is managed to the highest possible condition. The present ecological state of the lake is Category B and it is recommended that this is improved to a Category A/B. It is recommended that the flow regime is maintained to create the required habitat for birds, fish, macrophytes, microalgae and water quality. This can be achieved by maintaining groundwater levels within 15% of natural levels.

(e) Kosi Estuary

Similar to the uMgobozeleni Estuarine Lake system, the Kosi Estuarine Lake system is a very important system for biodiversity within the iSimangaliso Wetland Park. The system is groundwater-driven and is mainly threatened by commercial forest plantations within the catchment. Its present ecological state is Category A/B and it is recommended that this is improved to a Category A. It is recommended that the flow regime is maintained to create the required habitat for birds, fish, macrophytes, microalgae and water quality. The river and groundwater distribution patterns should not vary by more than 5% of the natural regime.

(f) St Lucia/iMfolozi Estuary

The St Lucia/iMfolozi Estuarine Lake system is important for various ecosystem goods and services due to its high natural biodiversity. However, the state of the Estuary has degraded in recent years and its present ecological state is Category D. It is recommended that the state of this system be improved to a Category C in the short term. The recommended long-term ecological status is Category B. To improve the state of the estuary, the following interventions have been proposed:

- Protection of the flow regime to create the required habitat for birds, fish, macrophytes, microalgae and water quality;
- The freshwater inflow from the influent rivers should be maintained at a level that is as close as possible to natural conditions and should not be lower than present-day conditions;
- Runoff from the uMfolozi River should ensure that the mouth of the estuary functions in a manner that resembles natural conditions. A minimum flow of 3.0 m³/s should be maintained at DWS gauging station W2H032.
- Runoff from the smaller rivers (Mkhuze, Hluhluwe, Msinene, Nyalazi and Mpate), as well as groundwater levels, should be maintained in order to ensure that the Estuary water level is maintained.

18.1.3 Existing Water Resource Infrastructure and Yields

(a) uMkhuze Water Resource Region

The water resources of the uMkhuze Water Resource Region are mostly undeveloped, with only a number of farm dams for irrigation purposes. The domestic and irrigation (largest water user in the catchment) water requirements are dependent on run-of-river yields. These vary significantly between the summer and winter months for the same level of assurance of supply.

The Hluhluwe Dam (**Figure 17.39** and **Table 17.38**) is the only significant dam in the catchment. It has a storage capacity of 25.89 million m³ and estimates a historical firm yield of 11.2 million m³/annum (**Table 17.39**) (DWS, 2022). This yield is lower than compared to the figure obtained in an earlier study by DWS (2016) due to the inclusion of the Ecological Water Requirements (EWR). The dam supplies water for irrigation and domestic use in the Hluhluwe WSS. The Hluhluwe WSS supplies water to areas in the Big 5 Hlabisa Local Municipality within the uMkhanyakude District Municipality.

The total water resource available in the uMkhuze catchment is approximately 74 million m³/a, after the allowance of the Ecological Reserve, irrigation return flows, the contribution of groundwater, and the transfer of water from Pongolapoort Dam for the Charl Senekal Trust (uMngeni-uThukela Water, 2019:36). The latest modelling results (i.e. DWS, 2022) concluded that supplying the EWR as a priority over other users poses a high risk of failure for the Hluhluwe Dam. Raising of the Hluhluwe Dam should be considered to increase the assurance of supply for the domestic and irrigation users while maintaining environmental flow requirements.

The Hluhluwe River is one of the water sources in the catchment as it supplies the Hluhluwe Supply Area downstream of the Hluhluwe Dam. The Hluhluwe River is said to be the part of the uMkhuze Catchment that is currently oversubscribed. The river flows into the iSimangaliso Wetland Park and, as a result, protection of the Ecological Reserve is important (uMngeni-uThukela Water, 2019: 23).



Figure 17.39 Hluhluwe Dam (DWS, 2016)

Table 17.38 Hluhluwe Dam (DWS 2018: Hydrographic Surveys Dams Database, DWS 2019: List of Registered Dams Database, WR2012).

Catchment Details	
Incremental Catchment Area:	456 km ² ^a
Total Catchment Area:	456 km ² ^a
Mean Annual Precipitation:	769 mm ^b
Mean Annual Runoff:	28.28 million m ³ ^b
Annual Evaporation:	1450 mm ^b
Dam Characteristics	
Gauge Plate Zero:	Unknown at this stage
Full Supply Level:	80.74 mASL ^c
Net Full Supply Capacity:	25.8927 million m ³ ^c
Spillway Height:	33 m ^c
Dead Storage:	Unavailable
Total Capacity:	25.9 million m ³ ^c
Original Measured Dam Capacity:	29.658 million m ³ (1978) ^d
Second Measured Dam Capacity:	28.775 million m ³ (1985) ^d
Third Measured Dam Capacity:	25.893 million m ³ (2000) ^d
Surface Area of Dam at Full Supply Level:	3.64 km ² ^c

Dam Type:	Arch and Earth fill ^c
Material Content of Dam Wall:	
Crest Length:	Crest length: 750 m ^e Spillway Section: 232 m ^e Non-Spillway Section: 517 m ^e
Type of Spillway:	Uncontrolled Ogee ^c
Capacity of Spillway:	1590 ^f
Date of Completion:	1965 ^c
Date of Last Area Capacity Survey:	2000
Date of Next Area Capacity Survey:	2014 (Overdue)

^a Quaternary Catchment's calculate geometry tool in ArcGIS.

^b WR2012.

^c DWS List of Registered Dams Database (April 2019).

^d DWS Hydrographic Surveys Dams Database (2018).

^e Measured in Google Earth.

^f SANCOLD

Table 17.39 Hluhluwe Dam Yields (DWS, 2022).

Dam	Historical Firm Yield (million m ³ /annum)	Stochastic Yield (million m ³ /annum)	
		1:50	1:100
Hluhluwe Dam	11.2	13.80	12.5

(b) uPhongolo Water Resource Region

The main surface water resources include the Bivane (**Figure 17.40, Table 17.40**) and Pongolapoort Dams (**Figure 17.41, Table 17.41**), on Bivane and uPhongolo Rivers, respectively, that account for 88% of the available water resources. The water resources of the uPhongolo catchments are fully developed through the Pongolapoort Dam. This dam is a 2.5 MAR dam which produces a large yield from the substantial runoff of the uPhongolo catchments. There is no further scope for increasing the yield. Surplus yield is currently available although the quantum is uncertain and will remain so until the environmental requirements/releases are completely determined. The Bivane Dam was constructed in the Bivane catchment to increase the assurance of supply to irrigators upstream of the Pongolapoort Dam (Zululand DM ZD-WSDP, 2004).

The seasonal pattern of storage in the Pongolapoort Dam is not typical of most dams. A significant flood release typically occurs in the month of October to flood the Makhathini Flats (the floodplain below the uPhongolo Dam). The yield characteristics associated with the dam take this seasonal pattern into account, particularly as the available storage during this critical period reduces. The flood release itself is curtailed when storage volumes decrease; therefore, the seasonal pattern changes based on water availability in the dam. As a modern approach, the seasonal pattern was revised to align with a likely allocation of water based on the short-term yield available for the selected storage. This was achieved through an iterative approach.

The Pongolapoort Dam has a storage capacity of 2 267 million m³ and a historical firm yield of 443 million m³/annum (DWS, 2022). This is a substantial decrease from the previous estimates of over 600 million m³/annum. This change is due to the lower runoff estimates used in the latest modelling study (i.e. WR2012 hydrology), as well as the increase in the water demand from users upstream the dam. There is an obligation to release water from the Pongolapoort Dam to maintain the Makhathini

floodplain. The current operating rule for the floodplain results in a yield impact of 250 million m³/a. This release is made between October and November (i.e. beginning of the rainfall season) when the storage level is above 70% FSC. Besides meeting the water requirements of South Africa, the Pongolo River is an internationally shared watercourse and some of the water is released to meet the international obligations in accordance with the Interim Inco-Maputo Agreement.



Figure 17.40 Bivane Dam - Source (<http://www.bestfishingspots.co.za/dam>)

Table 17.40 Characteristics of Bivane Dam

Catchment Details	
Incremental Catchment Area:	1595 km ² ^a
Total Catchment Area:	1595 km ² ^a
Mean Annual Precipitation:	838 mm ^b
Mean Annual Runoff:	267.3 million m ³ ^b
Annual Evaporation:	1400 mm ^b
Dam Characteristics	
Gauge Plate Zero:	669.8 mASL ^d
Full Supply Level:	742 mASL ^d
Spillway Height:	72.2 m ^c
Net Full Supply Capacity:	115 million m ³ ^c
Dead Storage:	million m ³
Total Capacity:	115 million m ³ ^c
Surface Area of Dam at Full Supply Level:	6.90 km ² ^d
Original Measured Dam Capacity	115 million m ³ ^c

Dam Type:	Double Curvature Concrete Arch ^c
Crest Length:	Crest Length: 223 m ^d Spillway Section: 57 m ^d Non-Spillway Section: 166 m ^d
Type of Spillway:	Uncontrolled Ogee ^c
Capacity of Spillway:	3800 m ³ /s
Date of Completion:	2000 ^c
Date of Area Capacity Survey:	2011 ^c
Date of next Area Capacity Survey:	2026 ^f

^a Sum of the Quaternary Catchments using statistics tool in ArcGIS.

^b WR2012 Database of Quaternary Catchment Information.

^c DWS List of Registered Dams Database (April 2019).

^d Measured on Google Earth.

^e SANCOLD

^f DWS communication



Figure 17.41 Pongolapoort Dam (<https://www.royaljozini.com/pongolapoort-dam-some-history/>)

Table 17.41 Characteristics of Pongolapoort Dam.

Catchment Details	
Incremental Catchment Area:	6219 km ² ^a
Total Catchment Area:	7814 km ² ^a
Mean Annual Precipitation:	581 mm ^b
Mean Annual Runoff:	903.3 million m ³ ^b
Annual Evaporation:	1500 mm ^b
Dam Characteristics	
Gauge Plate Zero:	42 mASL ^d
Full Supply Level:	137.2 mASL ^d
Spillway Height:	89 m ^c
Net Full Supply Capacity:	2267.07 million m ³ ^d
Dead Storage:	233.85 million m ³
Total Capacity:	2267.06 million m ³ ^d
Surface Area of Dam at Full Supply Level:	132.728 km ² ^c
Original Measured Dam Capacity	2500.91 million m ³ (1973) ^d
Second Measured Dam Capacity	2445.25 million m ³ (1984) ^d
Third Measured Dam Capacity	2267.07 million m ³ (2001) ^d
Dam Type:	Arch ^c
Crest Length:	Crest Length: 451 m ^e Spillway Section: 130 m ^e Non-Spillway Section: 321 m ^e
Type of Spillway:	Ogee ^c
Capacity of Spillway:	5700 m ³ /s ^f
Date of Completion:	1973 ^c
Date of Area Capacity Survey:	2001 ^d
Date of next Area Capacity Survey:	2016 ^g

^a Sum of the Quaternary Catchments using statistics tool in ArcGIS

^b WR2012 Database of Quaternary Catchment Information.

^c DWS List of Registered Dams Database (April 2019).

^d DWS Hydrographic Surveys Dams Database (2018).

^e Measured on Google Earth.

^f SANCOLD

^g DWS Survey

(c) Lake Sibaya Water Resource Region

Lake Sibaya has, over recent years, reduced in capacity. This is a result of the combined effects of relatively low precipitation levels since 2000, water demand from the timber industry, subsistence agricultural activities and increasing demand for domestic supply. By 2017, the surface level of Lake Sibaya had dropped by at least 4 m. However, there are currently signs of recovery following the good rainfall received in South Africa over the last three years (**Figure 17.42**).



Figure 17.42 Lake Sibayi (<https://infrastructurenews.co.za>)

18.1.4 Operating Rules

(a) uMkhuze Water Resource Region

Domestic water requirements in the uMkhuze Water Resource Region are dependent on run-of-river abstractions. These run-of-river abstractions are also affected by seasonal flow patterns in the river.

A Drought Operating rule was developed for the Hluhluwe Dam and is based on modelled results from a planning analysis scenario where curtailments are imposed according to the water user classification and curtailment definition. The rule provides the basis for quantifying water restrictions that may be required in the system and these are based on the actual storage level in the dam on a May decision date. The decision is valid for a 12-month period and reviewed annually.

In cases where restrictions are implemented, but adequate rainfall is thereafter experienced during a wet season and causes a recovery in storage levels, those restrictions may be lifted. However, if drought conditions persist stricter curtailments are progressively imposed.

The Department of Water and Sanitation recently (2022) completed a Drought Operating Rules study for the Hluhluwe Dam. This was an update from a similar study conducted during the recent drought (2016). Results from this study show that the Hluhluwe Dam is over-allocated and the dam cannot

sustainably supply the current requirements without failing. The simplified operating rule is presented in **Figure 17.43** and can be summarised as follows:

- There should be no restrictions for domestic supply when the dam is above 30% FSC and 20% restrictions should be imposed when the dam is below 30%.
- A 25% curtailment should be imposed on irrigators when the dam is above 65% and not spilling and this curtailment should be increased to 45% when the dam level reaches 65% FSC.

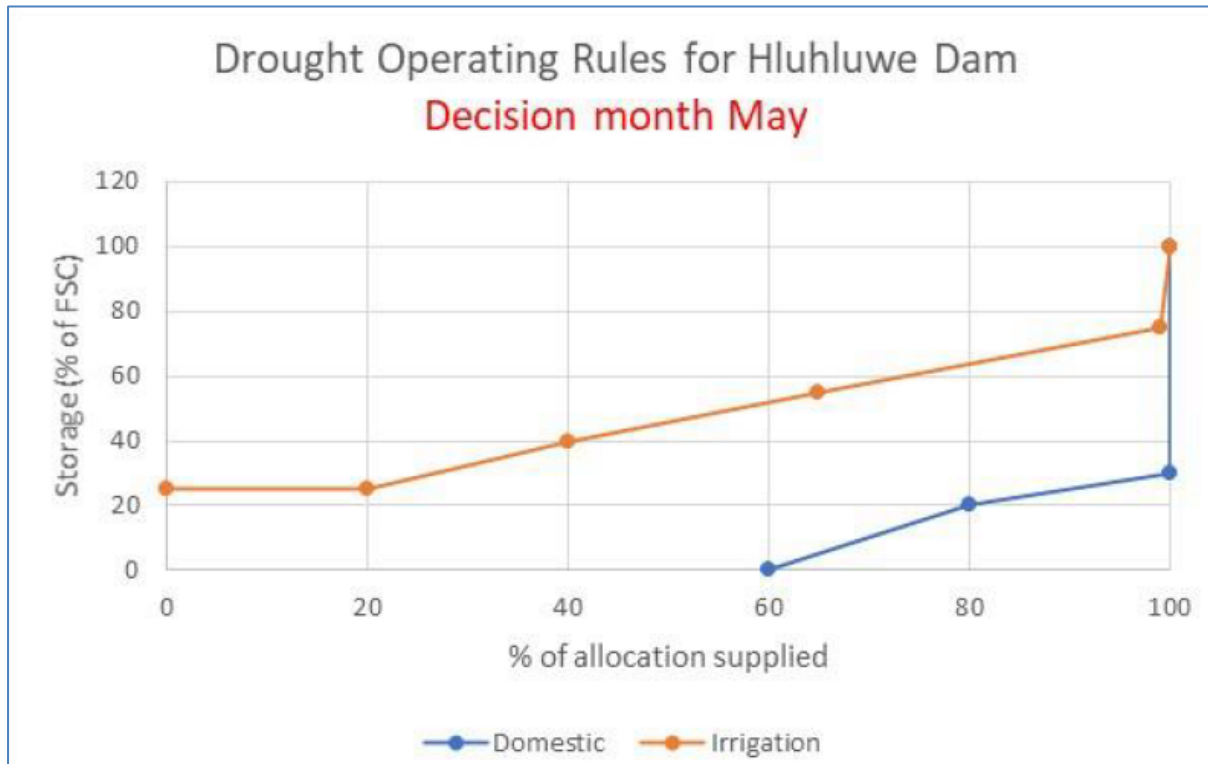


Figure 17.43 Hluhluwe Dam Drought Operating Rules (DWS, 2022).

(b) uPhongolo Water Resource Region

Pongolapoort Dam has environmental release operating rules but no water abstraction operating rules. The uPhongolo River does, however, experience deficits from time to time during winter months. This deficit is resolved by releases either from Bivane Dam or through off-channel storage to optimise the use of summer high flows. DWS confirm a level of 70% of the full capacity as a trigger for the flood rule at the Pongolapoort Dam. The volume above this level can be released for the purposes of maintenance of the floodplain downstream. A constant release of 5 m³/s for downstream users, including international requirements, is made in low flow conditions.

An assessment of the safety of the Pongolapoort Dam by the DWS Dam Safety Office, after the 2004 floods, reported that the spillway capacity may not be sufficient to sustain a large flood. Recommendations were subsequently made to operate the dam at 80% of its storage capacity. This has an impact on the yield of dam with a reduction in yield of approximately 49 million m³/annum (UAP Phase 3, 2019). During a drought sequence, flood releases are only made if the dam level is above 70%. The flood release requires a peak flow rate of at least 800 m³/s to inundate the floodplain and if the storage is below 60% of the FSC then this flow rate cannot be achieved. Flood releases were

incrementally implemented, up to 800 m³/s, between 14 October and 07 November 2023 (~250 million m³).

DWS undertakes annual analyses to define and optimise the short-term (annual) allocation of water as part of the drought operating rules. The operating rule takes into consideration the storage level at a given point of time and provides a corresponding annual system yield (**Table 17.42**). A decision month of May takes into consideration the high summer rainfall and low winter rainfall for this area. Although, the yield assessments indicate that there is a low likelihood for the Pongolapoort Dam to fail, an operating rule was developed by DWS (2021). According to this rule, restrictions for the domestic supply would only be required when the dam level reaches 30% FSC (**Figure 17.44**).

Table 17.42 Pongolapoort Dam Short term yields (DWS, 2018).

Starting Storage %	Yield (million m ³ /annum)			
	1:100	1:50	1:20	1:10
100	770	825	920	1010
80	710	770	860	950
60	595	655	755	850
40	520	550	620	700
30	450	470	580	610
20	350	380	405	500
10	280	350	380	410

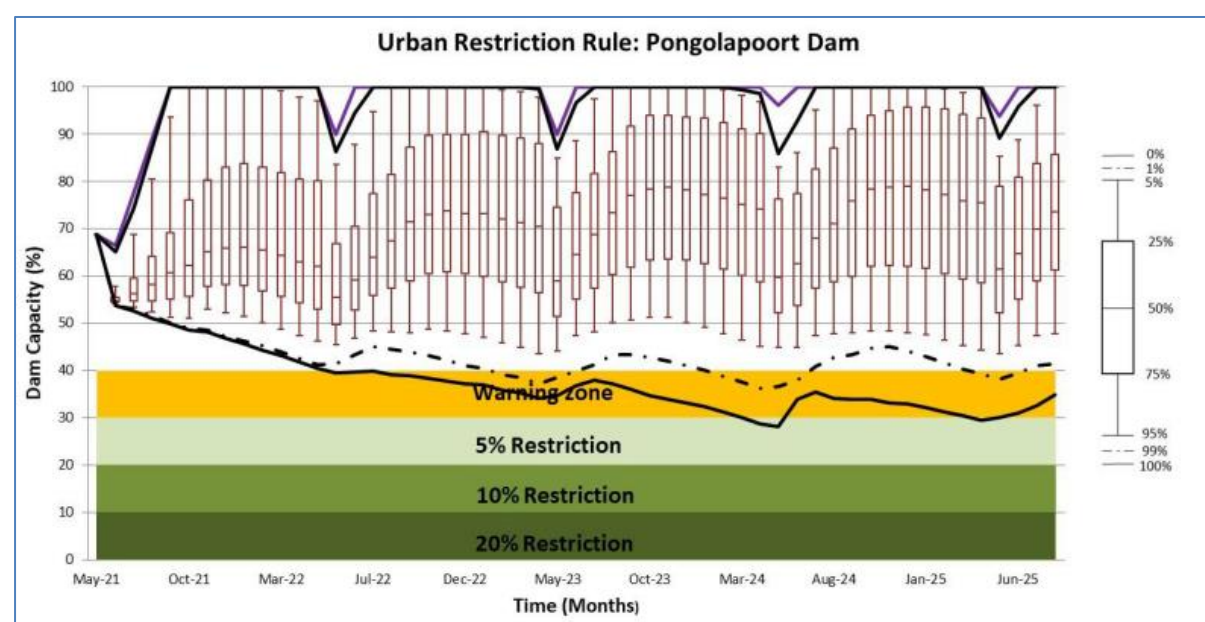


Figure 17.44: Restriction Rule for Domestic supply from the Pongolapoort Dam (DWS, 2021).

(c) Lake Sibaya Water Resource Region

Meyer and Godfrey (2003) found that the maximum water level fluctuations recorded for Lake Sibaya are a minimum of 18 and maximum 20 mASL, representing a volume change of roughly 165 million m³. Based on the recorded long-term lake levels from gauging stations W7R001 A03,

and the ecological requirements, the lake reserve levels have been defined by DWS and are presented in **Table 17.43**.

Table 17.43 Lake Sibayi water levels

	Lake Water Level [masl]	Equivalent Lake Volume [million m ³]
Current full supply level	20.0	858.2
Maintenance minimum water level	19.6	802.2
Maintenance minimum dry season water level	18.9	752.7
Drought minimum water level	18.0	693.2

18.2 Supply Systems

18.2.1 Description of the uMkhuze, Uphongolo and Lake Sibaya Water Supply Systems

Mhlathuze Water is acting as an Implementing Agent (IA) for Umkhanyakude District Municipality (UKDM) on several of the regional water supply projects within the DM. They are also involved as a bulk water supplier in King Cetshwayo District Municipality to the south of uMkhanyakude. In 2017 UKDM requested Mhlathuze Water to fund and facilitate the compilation of a district-wide Water Master Plan for the DM to enable integrated and sustainable water supply to its consumers.

UKDM is currently served by a large number of small and medium-sized borehole schemes or surface water schemes through package treatment plants. There are only a few significant water treatment Plants (WTPs) that have the potential to be used as regional treatment facilities namely; Jozini (40 Mℓ/day under construction), Shemula (20 Mℓ/day recently commissioned augmenting existing 7 Mℓ/day capacity) and Mtubatuba (24 Mℓ/day).

The total system losses or non-revenue water (NWR) in 2008 from the uMkhuze -Ubombo Water Supply Scheme area were estimated at 2.1 Mℓ/day (0.75 million m³/annum), or 66%, based on water use and operating practices. This estimate was based on the 2008 consumption figures. The high-water losses are mainly due to leakages at the service reservoirs.

18.2.2 uMkhuze Water Supply Supply

uMkhuze is situated in the town of uMkhuze within UKDM. The uMkhuze supply area includes the uMkhuze Town and Extends to Ubombo and the surrounding Ubombo Mountains. The raw water source for the uMkhuze WTP (**Figure 17.45, Table 17.44**) is the uPhongolo Dam. Raw water is pumped from uPhongolo Dam into the Blackie Dam (Charl Senekal Dam) and then pumped (**Table 17.45**) through a 160mm diameter rising main (**Table 17.46**) to the uMkhuze River. The Charl Senekal Trust has a raw water abstraction license of 3.1 Mℓ/day. The uMkhuze WTP is a 1.5 Mℓ/day plant with a conventional process of flocculent dosage, sedimentation, and filtration.

The uMkhuze-Ubombo bulk pipeline extends from outskirts of uMkhuze towards uMkhuze town and the potable water rising main from uMkhuze WTP towards Bethesda Hospital Reservoir (Ubombo Reservoir) (**Table 17.47**) crossing the uMkhuze River. The bulk line from Ubombo WTP, sourced from 3 boreholes, augment the supply to Bethesda Reservoir. The supply area includes the Bethesda Hospital Reservoir, commercial and household settlements including a limited supply extended beyond the rural town. Pipe sizes are currently unknown but will be verified with the latest asset register.

The uMkhuze Supply System is shown in **Figure 17.46**.



Figure 17.45 uMkhuze WTP ((Google Earth 2020: website).

Table 17.44 Characteristics of the uMkhuze WTP

WTP Name:	uMkhuze WTP
System:	Mkhuze Supply System
Maximum Design Capacity:	1.5 Mℓ/day upgraded to 4.5Mℓ/day
Current Utilisation:	1.5 Mℓ/day
Raw Water Storage Capacity:	1 Mℓ/day
Raw Water Supply Capacity:	*3 Mℓ/day
Pre-Oxidation Type:	None
Primary Water Pre-Treatment Chemical:	Polymeric Coagulant
Total Coagulant Dosing Capacity:	10 ℓ/hour*
Rapid Mixing Method:	Conventional Paddle Flash Mixer
Clarifier Type:	Circular
Number of Clarifiers:	2
Total Area of all Clarifiers:	*50 m ²
Total Capacity of Clarifiers:	1.2 Mℓ/day
Filter Type:	Pressure Sand Filters
Number of Filters:	2
Filter Floor Type	Filter Sand
Total Filtration Area of all Filters	*40 m ²
Total Filtration Design Capacity of all Filters:	4 m ³ /hr
Total Capacity of Backwash Water Tanks:	0m ³
Total Capacity of Sludge Treatment Plant:	Sludge removed periodically by desludge into sludge lagoons.
Capacity of Used Washwater System:	None
Primary Post Disinfection Type:	Sodium Hypochlorite
Disinfection Dosing Capacity:	2.5 ℓ/hr
Disinfectant Storage Capacity:	20 ℓ tanks
Total Treated Water Storage Capacity:	1 Mℓ

*Information needs verification

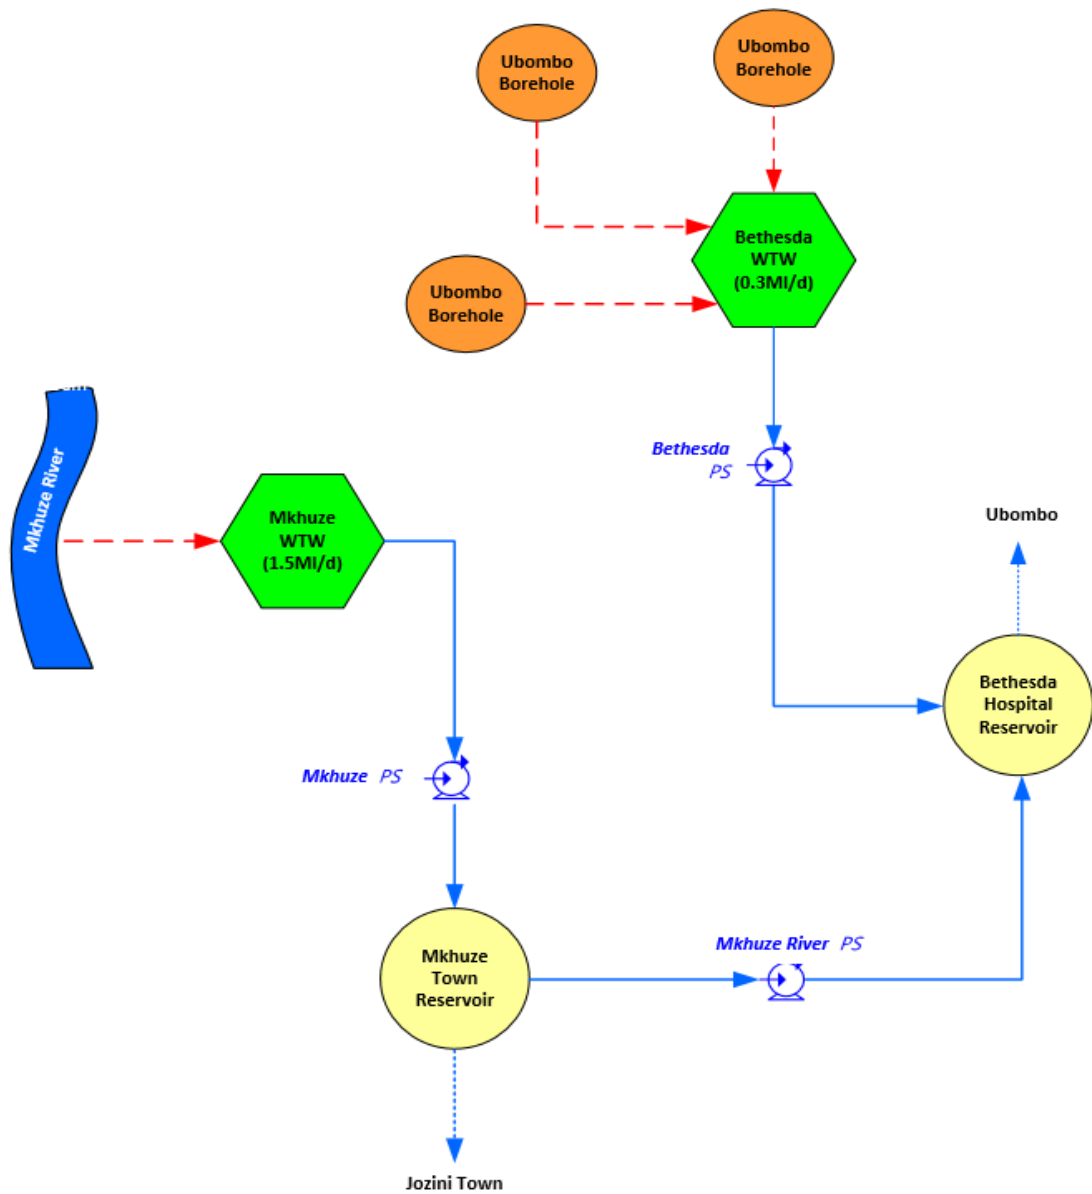


Figure 17.46 Layout of uMkhuze WTP Supply System

Table 17.45 Pump Details

System	Pump Station Name	Number of Pumps		Pump Description	Supply From	Supply To	Static Head (m)	Duty Head (m)	Duty Capacity (Mℓ/day)
		Number of Duty Pumps	Number of Standby Pumps						
uMkhuze	Mkhuze River PS	2	0		Mkhuze River	Mkhuze WTP	8*	10*	2.5
uMkhuze	Mkhuze PS	2	0		Mkhuze WTP	Mkhuze Town Res	12*	15*	1.0*
uMkhuze	Mkhuze River PS	2	0		Mkhuze River PS	Bethesda Hospital Res	97*	100*	1.0*

*These figures are estimates and must be verified

Table 17.46 Pipeline Details

System	Pipeline Name	From	To	Length (km)	Nominal Diameter (mm)	Material	Capacity (Mℓ/day)	Age (years)
uMkhuze	uMkhuze raw water	UMkhuze River	UMkhuze WTP	0.01	100	Steel	1.01	42
uMkhuze	uMkhuze pumping main	UMkhuze WTP	UMkhuze PS	0.08	100	Steel	1.01	42
uMkhuze	uMkhuze pumping main	UMkhuze PS	UMkhuze Town Res	3.0	100	Steel	1.01	42
uMkhuze	uMkhuze River pumping	UMkhuze Town Res***	UMkhuze River PS	7.0	100	Steel	1.01	42
uMkhuze	uMkhuze River pumping	UMkhuze River PS	Bethesda Hospital Res	3.8	100	Steel	1.01	42

*Capacity based on 1.5 m/s **Capacity based on 1.5 m/s #Age be verified

Table 17.47 Reservoir Details

System	Reservoir Site	Reservoir Name	Capacity (Mℓ)	Function	TWL (mASL)	FL (mASL)
uMkhuze	uMkhuze WTP	uMkhuze WTP	1.5*	Terminal	128*	124
uMkhuze	uMkhuze Town	uMkhuze Town Res	1.0*	Terminal	138*	134
uMkhuze	Bethesda Hospital	Bethesda Hospital Res	1.0*	Distribution	592*	588

*These figures are estimates and must be verified.

18.2.3 Hlobane/Coronation Water Supply System

Hlobane is positioned approximately 25 km north east of Vryheid on the road to Louwsburg and Pongola. The Hlobane WTP (**Figure 17.47**, **Figure 17.48** and **Table 17.48**) is a 2 Mℓ/day conventional process with flocculant dosage, sedimentation, and filtration. However, it is unusual in that it comprises elevated steel tanks rather than concrete structures. The works is not a package plant but all the units are free-standing tanks prefabricated in steel with the larger tanks welded together on site. The incoming water is pumped (**Table 17.49**) through a raw water pipeline (**Table 17.50**) to the elevated clarifiers from where it flows by gravity to the filters. After the filters the water is chlorinated and then flows to a treated water sump. It is then pumped again to the high-level storage reservoir (**Table 17.51**), which is also a steel tank in prefabricated sections. The Hlobane WTP receives raw water from the Hlobane Dam positioned a few hundred meters away. The water is pumped from the dam by pumps located at the Raw Water Pump Station.

Coronation is positioned about 40 km east of Vryheid on the road to Louwsburg and Pongola. The 0.4 Mℓ/day WTP (**Figure 17.49**) is a conventional process with flocculent dosage, sedimentation, and filtration. The works is a conventional plant with concrete tanks. The incoming water is pumped to an elevated storage tank from where it overflows to an elevated clarifier and then flows via gravity to the elevated rapid gravity filter. From there the water is chlorinated and flows to the treated water reservoir. This plant is in close proximity to the Hlobane BWSS and the Coronation Dam is on the same river as the Hlobane Dam. Zululand DM plan to consolidate the smaller plants with larger regional schemes. Raw water is sourced from the Coronation Dam a few kilometres from the WTP. This raw water is pumped to the treatment plant.

No projects are currently planned as the Coronation scheme is under revision and the scheme has water source challenges.

In evaluating whether the existing infrastructure would meet the demand for 2050, the current water source is insufficient. It is proposed that once a new source has been identified, the water treatment plant would need to be upgraded and the bulk distribution and storage be increased.



Figure 17.47 Aerial View of the Hlobane WTP (Google Earth 2020: website).



Figure 17.48 Hlobane WTP (Google Earth 2020: website).



Figure 17.49 Aerial view of Coronation WTP (Google Earth 2020: website).

Table 17.48 Characteristics of the Hlobane/Coronation WTP's

WTP Name:	Hlobane WTP	Coronation WTP
System:	UMkhuze Bulk Supply System	UMkhuze Bulk Supply System
Maximum Design Capacity:	3.6 Ml/day	0.4 Ml/day
Current Utilisation (January 2020):	1.6 Ml/day	0.4 Ml/day

Additional Information Unavailable

Figure 17.50 shows a schematic of the Hlobane/Coronation Supply System.

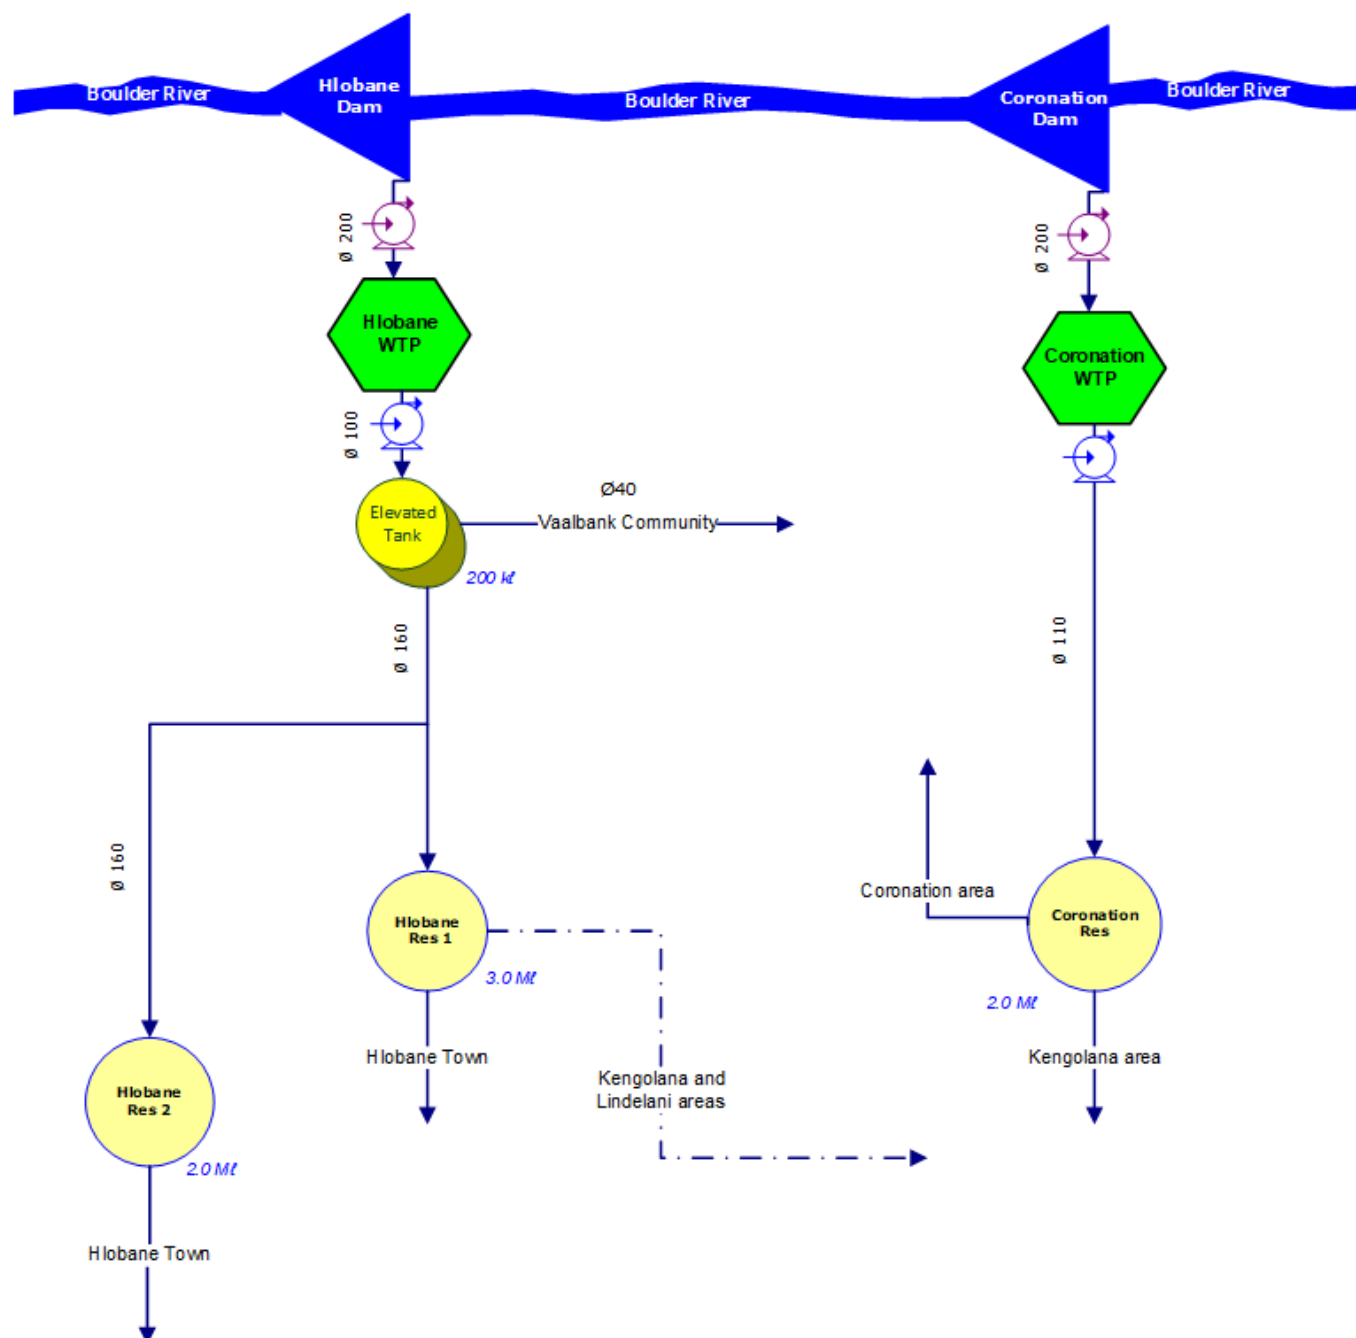


Figure 17.50 Schematic of the Hlobane/Coronation Supply System.

Table 17.49 Pump Details

System	Pump Station Name	Number of Pumps		Pump Description	Supply From	Supply To	Static Head (m)	Duty Head (m)	Duty Capacity (ML/day)
		Number of Duty Pumps	Number of Standby Pumps						
Hlobane	Raw water PS	1	1		Hlobane Dam	Hlobane WTP	35	45	3.5
Hlobane	Hlobane PS	1	1		Hlobane WTP	Elevated Tank	26	35	2
Coronation	Raw water PS	1	1		Coronation Dam	Coronation WTP	74	85	0.4
Coronation	Coronation PS	1	1		Coronation WTP	Coronation Res	31	40	0.4

Table 17.50 Pipeline Details

System	Pipeline Name	From	To	Length (km)	Nominal Diameter (mm)	Material	Capacity (ML/day)	Age (years)
Hlobane Coronation	Hlobane raw water	Hlobane Dam	Hlobane WTP	0.73	200	Steel	4.07*	42
Hlobane Coronation	Hlobane potable water	Hlobane WTP	Elevated Tank	0.05	100	Steel	1.01*	42
Hlobane Coronation	Potable water	Elevated Tank	Hlobane Res 1	2.95	160	uPVC	3.47**	42
Hlobane Coronation	Potable water	Hlobane Res 1	Hlobane Res 2	1.5	160	uPVC	3.47**	42
Hlobane Coronation	Coronation raw water	Coronation Dam	Coronation WTP	3.82	200	uPVC	4.07*	42
Hlobane Coronation	Potable water	Coronation WTP	Coronation Res	2.95	110	uPVC	1.23*	42

*Capacity based on 2 m/s **Capacity based on 1.5 m/s

Table 17.51 Reservoir Details

System	Reservoir Site	Reservoir Name	Capacity (Mℓ)	Function	TWL (mASL)	FL (mASL)
Hlobane Coronation	Hlobane Coronation	Hlobane Res 1	3.0	Terminal	1253*	1248
Hlobane Coronation	Hlobane Coronation	Hlobane Res 2	2.0	Terminal	1322*	1317
Hlobane Coronation	Hlobane Coronation	Hlobane Elevated Tank	0.2	Distribution	1279*	1274
Hlobane Coronation	Hlobane Coronation	Coronation Res	2.0	Terminal	1310*	1305

*These figures are estimates and have to be verified

18.2.4 Description of the uPhongolo System

(a) Overview of the uPhongolo System

Zululand DM is one of the 14 Water Services Authorities in KwaZulu-Natal Province. The Zululand District is positioned in the northern region of the KwaZulu-Natal Province and covers an area of approximately 14 810 km². The system is bounded by Swaziland and Mpumalanga Province to the north, Amajuba DM to the west, Umkhanyakude DM to the east and Umzinyathi and King Cetshwayo District Municipalities to the south. Approximately half of the area is under the jurisdiction of traditional authorities while the remainder is divided between commercially owned farms and conservation areas. The District comprises the following five local municipalities as depicted in **Figure 17.51**).

- eDumbe (KZ 261)
- uPhongolo (KZ 262)
- Abaqulusi (KZ 263)
- Nongoma (KZ 265)
- Ulundi (KZ 266)



Figure 17.51 Local Municipalities in Zululand District (unknown source).

According to Zululand DM's WSDP 2014 The Zululand DM falls within the Umfolozi, uMkhuze and uPhongolo Secondary Catchments of the Usuthu/Mhlathuze Water Management Area (WMA). The aerial extent of the Zululand DM occupies approximately 22% of this WMA.

This chapter will only describe the water supply systems fed by the uPhongolo WMA and specifically water supply systems where the WTP is greater than or equal to 2 Mℓ/day. These catchments consist mostly of Traditional Authority land, with the main activity being cattle farming.

The two Local Municipalities, within the Zululand District Municipality, that are being supplied from the uPhongolo WMA are, eDumbe (KZ 261) and uPhongolo (KZ 262)

The uPhongolo WMA serves as raw water resource for the following Bulk Water Supply Systems:

- Simdlangentsha East Regional Bulk Water Supply Scheme (Spekboom BWSS, uPhongolo BWSS) Simdlangentsha West Regional Bulk Water Supply Scheme (Frischgewaagd BWSS, Edumbe BWSS)
- Simdlangentsha Central Regional Bulk Water Supply Scheme (Belgrade BWSS)

(a) Edumbe Water Treatment Supply System

The main source of water supply for the Edumbe (Paulpietersburg) Water Supply Scheme is the Edumbe Dam situated in the headwaters of the Egoda River, a tributary of the uPhongolo River in Quaternary Catchment W42D. The registered municipal water use for the Edumbe Water Supply Scheme from the system comprising the Edumbe Dam, is 0.53 million m³/annum according to the DWS WARMS records. No other downstream users depend on Edumbe Dam. The water allocation for this scheme is registered in the name of Edumbe Local Municipality, which is the Water Service Provider (WSP). The registered water use for the scheme should be transferred to Zululand DM as the WSA. There are no known water quality problems at the Edumbe WTP (**Figure 17.52** and **Table 17.52**). The quality of the resource upstream of the Edumbe Dam appears to be good because of the limited land use in the catchment although some areas do have commercial forestry.

The Edumbe WTP is the only plant, which supplies treated water to the Edumbe Water Supply Scheme area (**Table 17.53**, **Table 17.54** and **Table 17.55**). The total peak hydraulic design capacity of the Edumbe WTP is 3.5 Mℓ/day. The average annual capacity of the WTP is estimated to be 2.7 Mℓ/day. The average annual capacity of the WTP is sufficient to meet the immediate water requirements of the Edumbe Water Supply Scheme area.



Figure 17.52 Aerial view of Edumbe Water Treatment Plant (Google Earth 2020: website).

Table 17.52 Characteristics of the Edumbe WTP.

WTP Name:	Edumbe WTP
System:	Phongolo Supply System
Maximum Design Capacity:	3.5 Mℓ/day
Current Utilisation:	2.7 Mℓ/day
Raw Water Storage Capacity:	0 Mℓ
Raw Water Supply Capacity:	4.0 Mℓ/day
Pre-Oxidation Type:	None
Primary Water Pre-Treatment Chemical:	Polymeric Coagulant
Total Coagulant Dosing Capacity:	13 ℓ/hour
Rapid Mixing Method:	Conventional Paddle Flash Mixer
Clarifier Type:	Dortmund Manual Clarifiers
Number of Clarifiers:	3
Total Area of all Clarifiers:	314.6 m ²
Total Capacity of Clarifiers:	4.0 Mℓ/day
Filter Type:	Rapid Gravity Sand Filters
Number of Filters:	3
Filter Floor Type	Laterals with Nozzles
Total Filtration Area of all Filters	109.13 m ²
Total Filtration Design Capacity of all Filters:	4.0 Mℓ/day
Total Capacity of Backwash Water Tanks:	0m ³
Total Capacity of Sludge Treatment Plant:	None
Capacity of Used Washwater System:	0 Mℓ/day
Primary Post Disinfection Type:	Chlorine gas
Disinfection Dosing Capacity:	10 kg/hr Chlorinator
Disinfectant Storage Capacity:	
Total Treated Water Storage Capacity:	5.5 Mℓ

Figure 17.53 shows a schematic of the Edumbe Supply System.

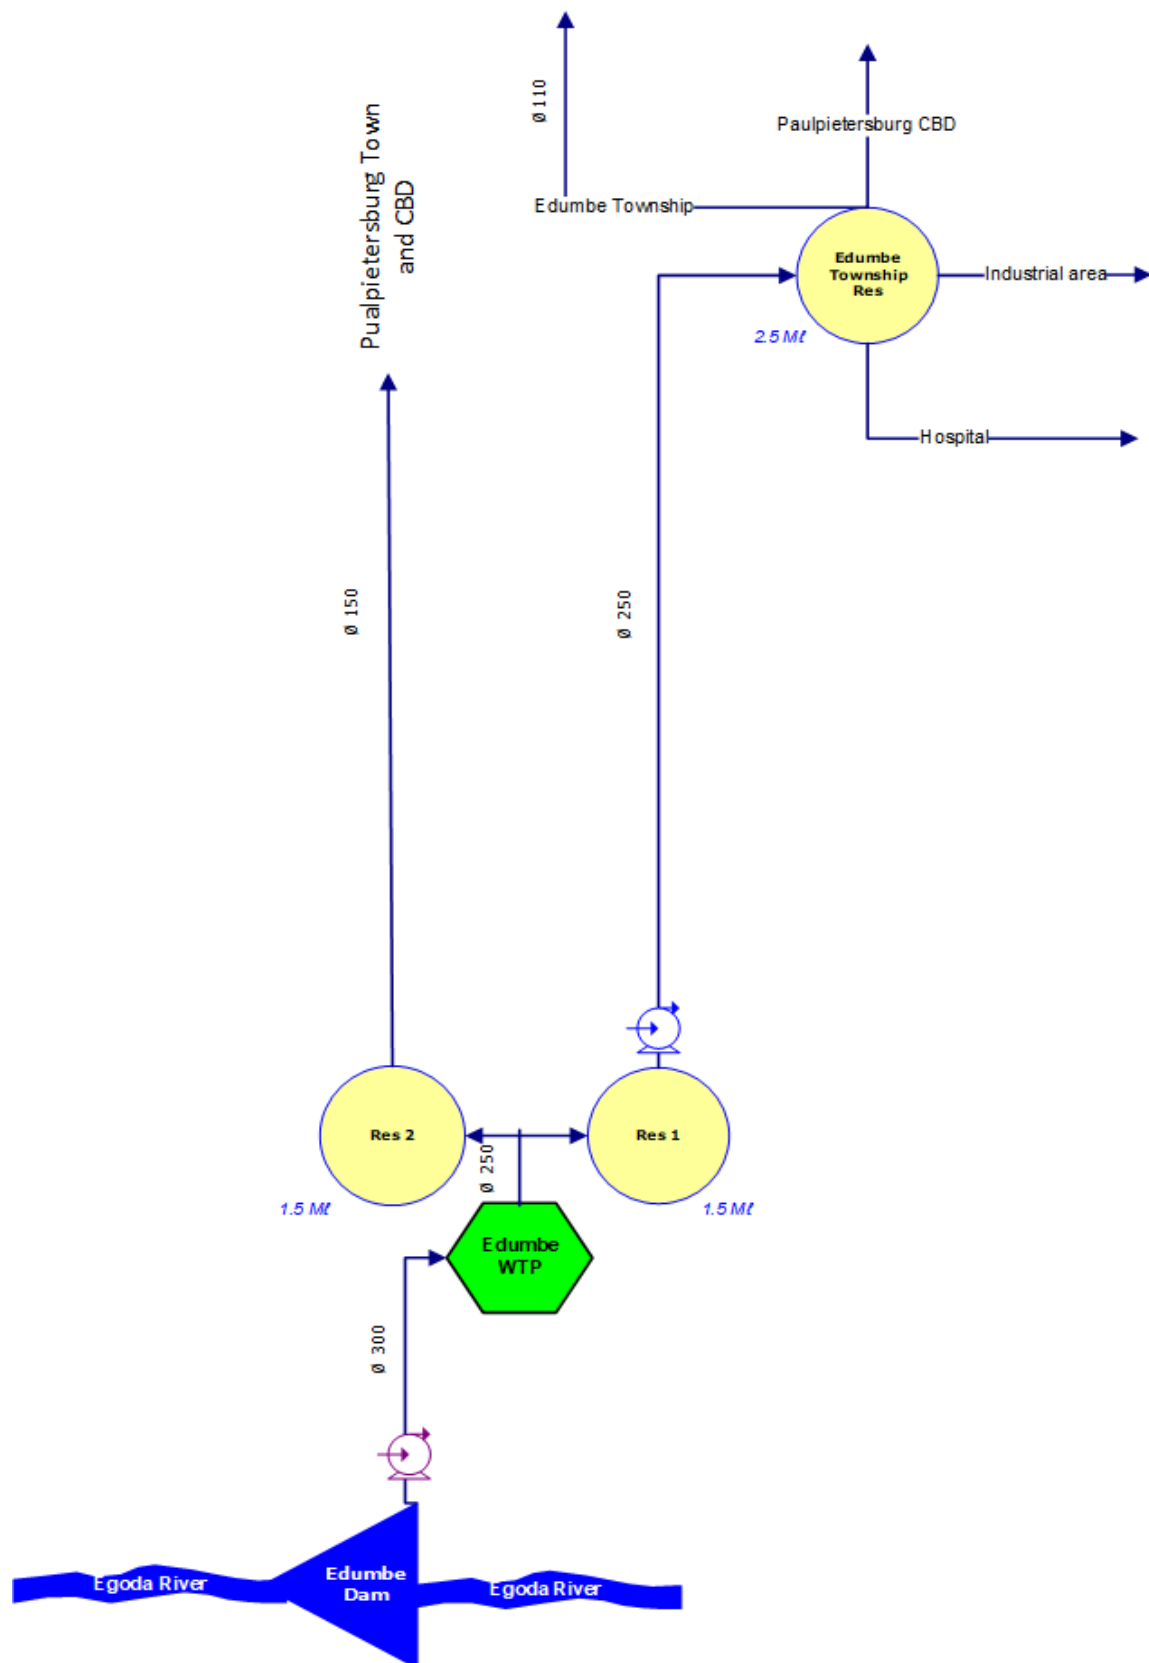


Figure 17.53 Schematic of the Edumbe Supply System

Table 17.53 Pump details: Edumbe Supply System

System	Pump Station Name	Number of Pumps		Pump Description	Supply From	Supply To	Static Head (m)	Duty Head (m)	Duty Capacity (Mℓ/day)
		Number of Duty Pumps	Number of Standby Pumps						
Edumbe	Edumbe Raw water PS	1	1	Franklin 65250 CIM-S	Edumbe Dam	Edumbe WTP	50	55**	4
Edumbe		1	1	KSB ETA 100-400	Res 1	Edumbe Township Res	1	15**	3.6#

- ** These figures are based on calculated head loss

Table 17.54 Reservoir details: Edumbe BWSS.

System	Reservoir Site	Reservoir Name	Capacity (Mℓ)	Function	TWL (aMSL)	FL (aMSL)
Edumbe	Edumbe	Res 1	1.5	Terminal	1170*	1165*
Edumbe	Edumbe	Res 2	1.5	Distribution	1170*	1165*
Edumbe	Edumbe	Edumbe Township Res	2.5	Terminal	1170	1165*

*These figures are estimates and must be verified

Table 17.55 Pipeline details: Edumbe BWSS.

System	Pipeline Name	From	To	Length (km)	Nominal Diameter (mm)	Material	Capacity (Ml/day)	Age (years)
Edumbe	Raw water pipeline	Edumbe Dam	Edumbe WTP	2.16	300	Steell	9.16**	41
Edumbe	Potable water pipeline	Edumbe WTP	Res 1 and 2	0.087	250	Steel	8.48*	41
Edumbe	Potable water pipeline	Res 1	Paulpietersburg CBD and Town	2.290	150	Steel	3.05*	41
Edumbe	Potable water pipeline	Res 2	Edumbe Township Res	4.180	250	Steel	6.36**	41

Based on a velocity of 2 m/s ** Based on a velocity of 1.5 m/s # Age need to be verified

(b) Frischgewaagd Water Treatment Supply System

The Frischgewaagd WTP (**Figure 17.54** and **Table 17.56**) is a conventional rapid gravity filtration works. The peak hydraulic design capacity of the WTP was determined to be 2 Mℓ/day based on the registered volume of water for the plant. The average annual demand is 1.48 Mℓ/day.

The Frischgewaagd WTP sources its raw water from the uPhongolo River via an abstraction pumping system (**Table 17.57**).

The treated water is then distributed (**Table 17.59**) to four storage reservoirs (**Table 17.58**), which supplies potable water to the communities.

Figure 17.54 shows an aerial view of the Frischgewaagd WTP and storage three of the storage reservoirs.



Figure 17.54 Aerial view of Frischgewaagd Water Treatment Plant (Google Earth 2020: website).

Table 17.56 Characteristics of the Frischgewaagd WTP.

WTP Name:	Frischgewaagd WTP
System:	Phongolo Supply System
Maximum Design Capacity:	2.0 Mℓ/day
Current Utilisation:	1.48 Mℓ/day
Raw Water Storage Capacity:	0 Mℓ
Raw Water Supply Capacity:	2.0 Mℓ/day
Pre-Oxidation Type:	None
Primary Water Pre-Treatment Chemical:	Polymeric Coagulant
Total Coagulant Dosing Capacity:	13 ℓ/hour
Rapid Mixing Method:	Conventional Paddle Flash Mixer
Clarifier Type:	Dortmund Manual Clarifiers
Number of Clarifiers:	2
Total Area of all Clarifiers:	236.88 m ²
Total Capacity of Clarifiers:	2.0 Mℓ/day
Filter Type:	Pressure Filters
Number of Filters:	7
Filter Floor Type	Laterals with Nozzles
Total Filtration Area of all Filters	40.87 m ²
Total Filtration Design Capacity of all Filters:	2.0 Mℓ/day
Total Capacity of Backwash Water Tanks:	0m ³
Total Capacity of Sludge Treatment Plant:	None
Capacity of Used Washwater System:	0 Mℓ/day
Primary Post Disinfection Type:	Chlorine gas
Disinfection Dosing Capacity:	10 kg/hr Chlorinator
Disinfectant Storage Capacity:	
Total Treated Water Storage Capacity:	2.5 Mℓ

Figure 17.55 shows a schematic of the Frischgewaagd Supply System

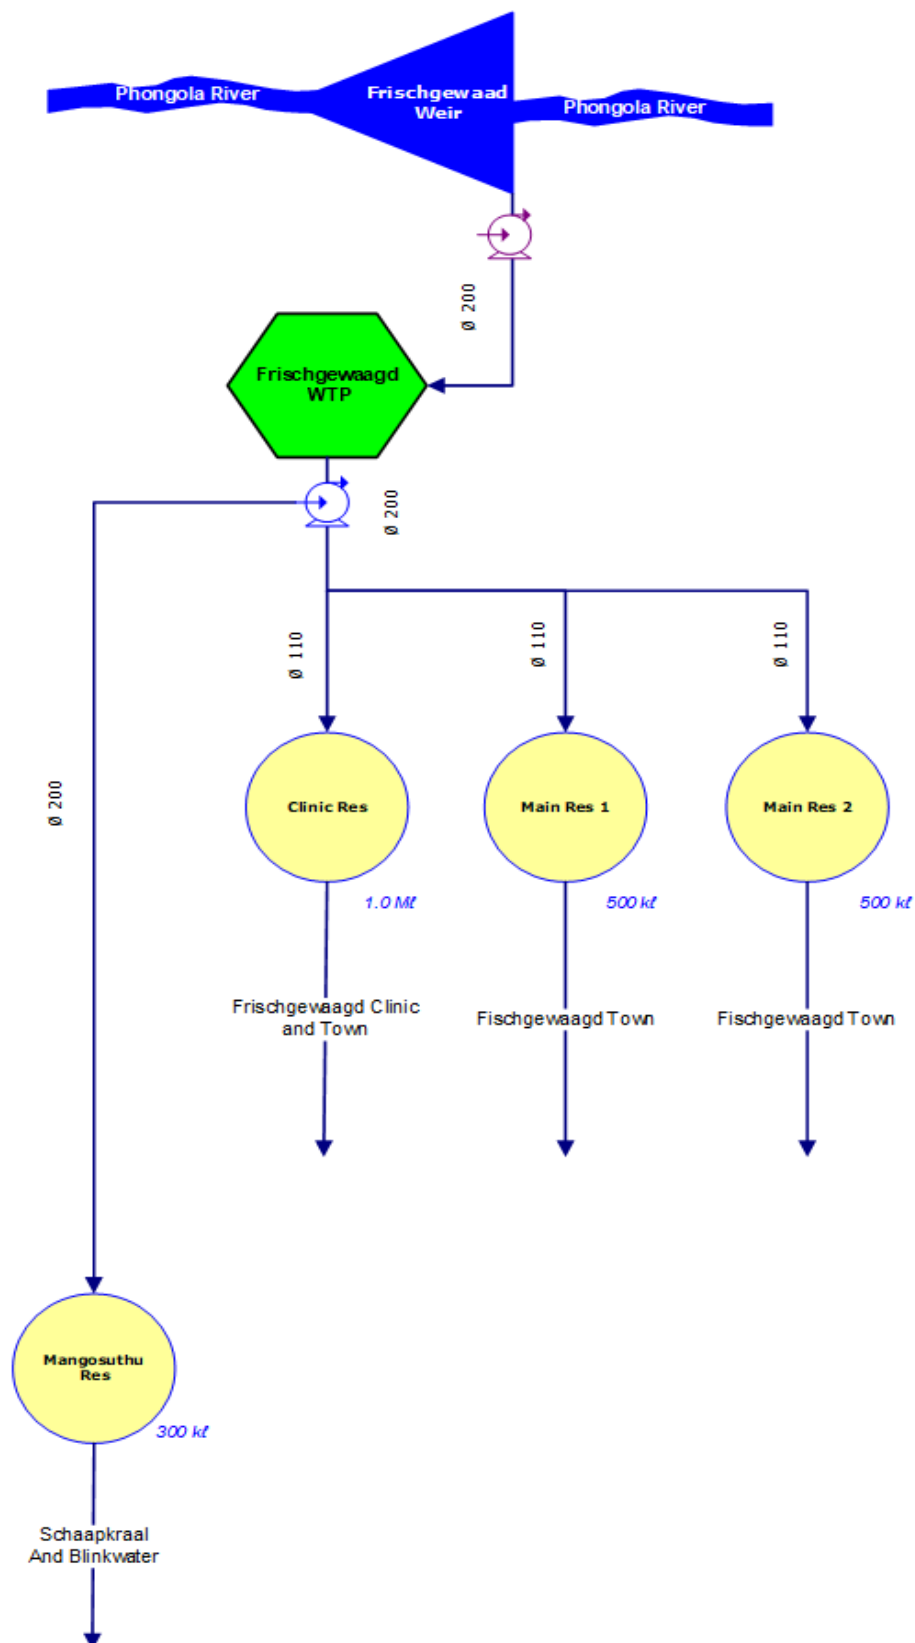


Figure 17.55 Schematic of Frischgewaagd WTP Supply System

Table 17.57 Pump details: Frischgewaagd Supply System

System	Pump Station Name	Number of Pumps		Pump Description	Supply From	Supply To	Static Head (m)	Duty Head (m)	Duty Capacity (Mℓ/day)
		Number of Duty Pumps	Number of Standby Pumps						
Frischgewaagd	Frischgewaagd Raw water PS	1	1	KSB WKLn 80/4	Phongolo River	Frischgewaagd WTP	222	230**	2
Frischgewaagd	Mangosuthu Pump Station	1	1	Pedrollo F 65/160B	Frischgewaad WTP	Mangosuthu Res	37	50	0.864
Frischgewaagd	Clinic Pump Station	1	1	Pedrollo CPm 160B	Frischgewaad WTP	Clinic Res	36	50	0.3168
Frischgewaagd	Main Reservoir Pump Station	1	1	Pedrollo F 65/160B	Frischgewaad WTP	Main Res1/Main Res2	37	50	0.864

- ** These figures are based on calculated head loss

Table 17.58 Reservoir details: Frischgewaagd BWSS.

System	Reservoir Site	Reservoir Name	Capacity (Mℓ)	Function	TWL (aMSL)	FL (aMSL)
Frischgewaagd	Frischgewaagd	Res 1	0.5	Terminal	1055*	1050*
Frischgewaagd	Frischgewaagd	Res 2	0.5	Terminal	1055*	1050*
Frischgewaagd	Frischgewaagd	Clinic	1.0	Terminal	1057	1050*
Frischgewaagd	Frischgewaagd	Mangosuthu Res	0.3	Terminal	1097	1091*

*These figures are estimates and must be verified

Table 17.59 Pipeline details: Frischgewaagd BWSS.

System	Pipeline Name	From	To	Length (km)	Nominal Diameter (mm)	Material	Capacity (Mℓ/day)	Age (years)
Frischgewaagd	Raw water pipeline	Phongolo River	Frischgewaagd WTP	3.6	200	Steell	4.07**	41#
Frischgewaagd	Potable water pipeline	Frischgewaagd WTP	Res 1, 2 and Clinic Res	0.087	110 for each reservoir	uPVC	1.23*	41#
Frischgewaagd	Potable water pipeline	Frischgewaagd WTP	Mangosuthu Res	3.234	200	uPVC	4.07*	41#

Based on a velocity of 2 m/s

** Based on a velocity of 1.5 m/s # Age need to be verified

18.2.5 Simdlangentsha Central Regional Bulk Water Supply Scheme (Belgrade BWSS)

(a) Belgrade Water Treatment Supply System

The Belgrade (New) Water Treatment Plant is located in the town Belgrade in the Zululand District of Kwazulu-Natal. The Belgrade Water Supply Scheme is supplied from two sources namely a weir in the Mozana River and a small dam in the tributary of Mozana River near the water treatment plant.

The total peak hydraulic design capacity of the Belgrade WTP (**Figure 17.56** and **Table 17.60**) is estimated to be 1.5 Mℓ/day. The average annual flow rate of the plant is estimated to be 1.2 Mℓ/day. The current raw water abstraction from the Mozana River was estimated to be 1.36 Mℓ/day (0.5 million m³/annum) assuming water losses from the raw water abstraction works pumping main as well as the water treatment losses.

Water is pumped (**Table 17.61**) from the WTP through rising mains (**Table 17.63**) to a number of distribution reservoirs (**Table 17.62**) in the system.

Figure 17.56 shows an aerial view of the Belgrade WTP.



Figure 17.56 Aerial view of Belgrade Water Treatment Plant (Google Earth 2020: website).

Table 17.60 Characteristics of the Belgrade WTP.

WTP Name:	Belgrade WTP
System:	Phongolo Supply System
Maximum Design Capacity:	1.5 Mℓ/day
Current Utilisation:	1.2 Mℓ/day
Raw Water Storage Capacity:	0 Mℓ
Raw Water Supply Capacity:	1.36 Mℓ/day
Pre-Oxidation Type:	None
Primary Water Pre-Treatment Chemical:	Polymeric Coagulant
Total Coagulant Dosing Capacity:	13 ℓ/hour
Rapid Mixing Method:	Conventional Paddle Flash Mixer
Clarifier Type:	Dortmund Manual Clarifiers
Number of Clarifiers:	4
Total Area of all Clarifiers:	236.88 m ²
Total Capacity of Clarifiers:	2.0 Mℓ/day
Filter Type:	Pressure Filters
Number of Filters:	4
Filter Floor Type	Laterals with Nozzles
Total Filtration Area of all Filters	40.87 m ²
Total Filtration Design Capacity of all Filters:	2.0 Mℓ/day
Total Capacity of Backwash Water Tanks:	0m ³
Total Capacity of Sludge Treatment Plant:	None
Capacity of Used Washwater System:	0 Mℓ/day
Primary Post Disinfection Type:	Chlorine gas
Disinfection Dosing Capacity:	10 kg/hr Chlorinator
Disinfectant Storage Capacity:	
Total Treated Water Storage Capacity:	2.5 Mℓ

Figure 17.57 shows a schematic of the Belgrade Supply System

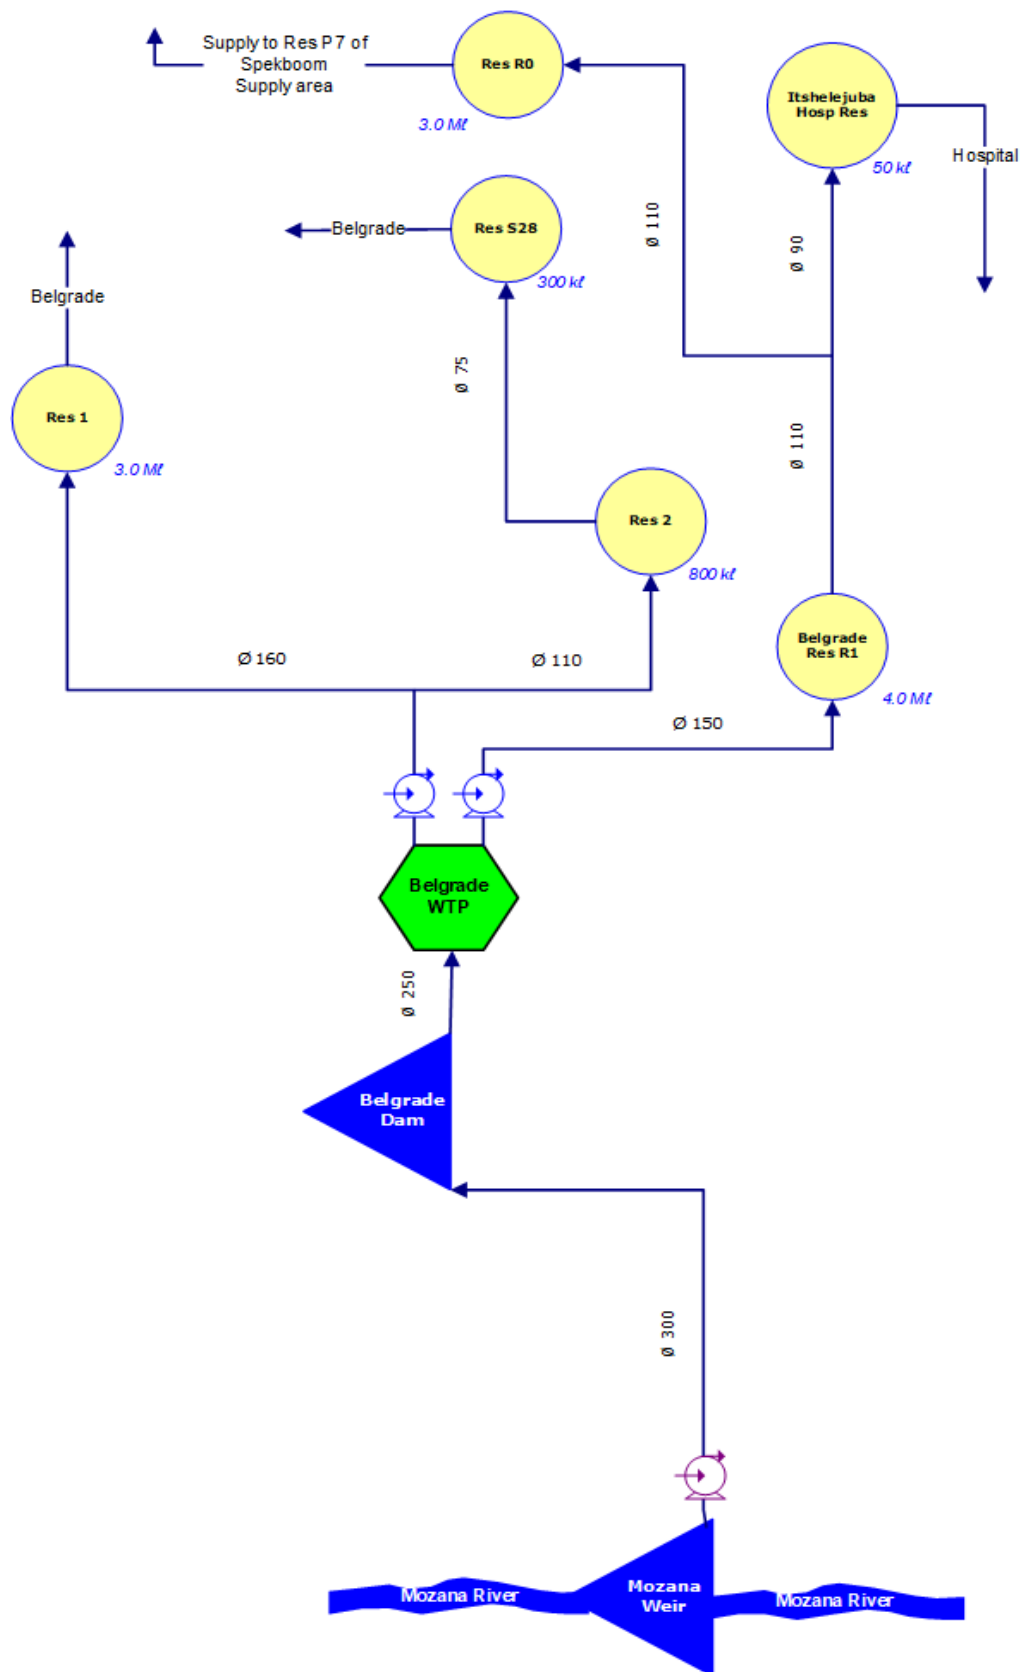


Figure 17.57 Schematic of Belgrade WTP Supply System

Table 17.61 Pump details: Belgrade Supply System

System	Pump Station Name	Number of Pumps		Pump Description	Supply From	Supply To	Static Head (m)	Duty Head (m)	Duty Capacity (Mℓ/day)
		Number of Duty Pumps	Number of Standby Pumps						
Belgrade	Mozane River abstraction	3	1	KSB KRT - F 80/250	Mozana Weir	Belgrade dam	134	140**	2
Belgrade	Mozane HL Station	2	2	KSB WKLn 80/4	Mozana Weir	Belgrade dam	134	150	0.3
Belgrade	Belgrade dam	1	1	Grundfos	Belgrade dam	Belgrade new WTP			
Belgrade	Belgrade old plant	1	1	KSB WKLn 50/3	Belgrade WTP	Res 1	81	90**	0.5
Belgrade	Belgrade old plant	1	1	KSB WKLn 50/4	Belgrade WTP	Res 2	93	100**	0.5
Belgrade	Belgrade new plant	1	1	KSB KWLn 150/5	Belgrade WTP	Belgrade Res R1	210		4.3

- ** These figures are based on calculated head loss

Table 17.62 Reservoir details: Belgrade BWSS.

System	Reservoir Site	Reservoir Name	Capacity (Mℓ)	Function	TWL (aMSL)	FL (aMSL)
Belgrade	Belgrade	Res 1	3.0	Terminal	944*	937*
Belgrade	Belgrade	Res 2	0.8	Balancing	956*	947*
Belgrade	Belgrade	Res R1	4.0	Distribution	1042*	1035*
Belgrade	Belgrade	Res R0	3.0	Distribution	914*	909*

*These figures are estimates and must be verified

Table 17.63 Pipeline details: Belgrade BWSS.

System	Pipeline Name	From	To	Length (km)	Nominal Diameter (mm)	Material	Capacity (Ml/day)	Age (years)
Belgrade	Raw water pipeline	Mozana River	Belgrade Dam	5.6	300	Steell	9.16**	41#
Belgrade	Raw water pipeline	Belgrade Dam	Belgrade WTP	0.087	250	uPVC	8.48*	41#
Belgrade	Potable water pipeline	Belgrade WTP	Res 1	1.6	160	uPVC	2.6*	41#
Belgrade	Potable water pipeline	Belgrade WTP	Res 2	2.4	110	uPVC	1.23**	41#
Belgrade	Potable water pipeline	Belgrade WTP	Res R1	5.0	150	Steel	2.3**	41#
Belgrade	Potable water pipeline	Res R1	Res R0	9.0	110	uPVC	1.64*	41#

* Based on a velocity of 2 m/s ** Based on a velocity of 1.5 m/s # Age need to be verified

18.2.6 Simdlangentsha East Regional Bulk Water Supply Scheme (Spekboom BWSS, uPhongolo BWSS)

(a) Spekboom Water Treatment Supply System

The Spekboom Water Treatment Plant (**Figure 17.58**, **Table 17.64**) is located approximately 25km North West of the town of Pongola in the Zululand District of Kwazulu-Natal and supplies treated water to the settlement of Spekboom. Raw water is pumped (**Table 17.65**) from the Spekboom River and treatment takes place in a packaged plant consisting of a sedimentation tank and two pressure filters. Treated water is stored in a concrete reservoir (**Table 17.66**) on site before it is pumped, through rising mains (**Table 17.67**), to the reticulation network (**Figure 17.59**).

The maximum processing capacity of the package plant is 1.2 Mℓ/day.



Figure 17.58 Aerial view of Spekboom Water Treatment Plant (Google Earth 2020: website).

Table 17.64 Characteristics of the Spekboom WTP.

WTP Name:	Spekboom WTP
System:	Phongolo Supply System
Maximum Design Capacity:	1.2 Mℓ/day
Current Utilisation:	1.2 Mℓ/day
Raw Water Storage Capacity:	0 Mℓ
Raw Water Supply Capacity:	1.2 Mℓ/day
Pre-Oxidation Type:	None
Primary Water Pre-Treatment Chemical:	Polymeric Coagulant
Total Coagulant Dosing Capacity:	13 ℓ/hour
Rapid Mixing Method:	Conventional Paddle Flash Mixer
Clarifier Type:	Dortmund Manual Clarifiers
Number of Clarifiers:	1
Total Area of all Clarifiers:	236.88 m ²
Total Capacity of Clarifiers:	1.2 Mℓ/day
Filter Type:	Pressure Filters
Number of Filters:	2
Filter Floor Type	Laterals with Nozzles
Total Filtration Area of all Filters	40.87 m ²
Total Filtration Design Capacity of all Filters:	1.2 Mℓ/day
Total Capacity of Backwash Water Tanks:	0m ³
Total Capacity of Sludge Treatment Plant:	None
Capacity of Used Washwater System:	0 Mℓ/day
Primary Post Disinfection Type:	Chlorine gas
Disinfection Dosing Capacity:	10 kg/hr Chlorinator
Disinfectant Storage Capacity:	
Total Treated Water Storage Capacity:	2.5 Mℓ

Figure 17.59 shows a schematic of the Spekboom Supply System

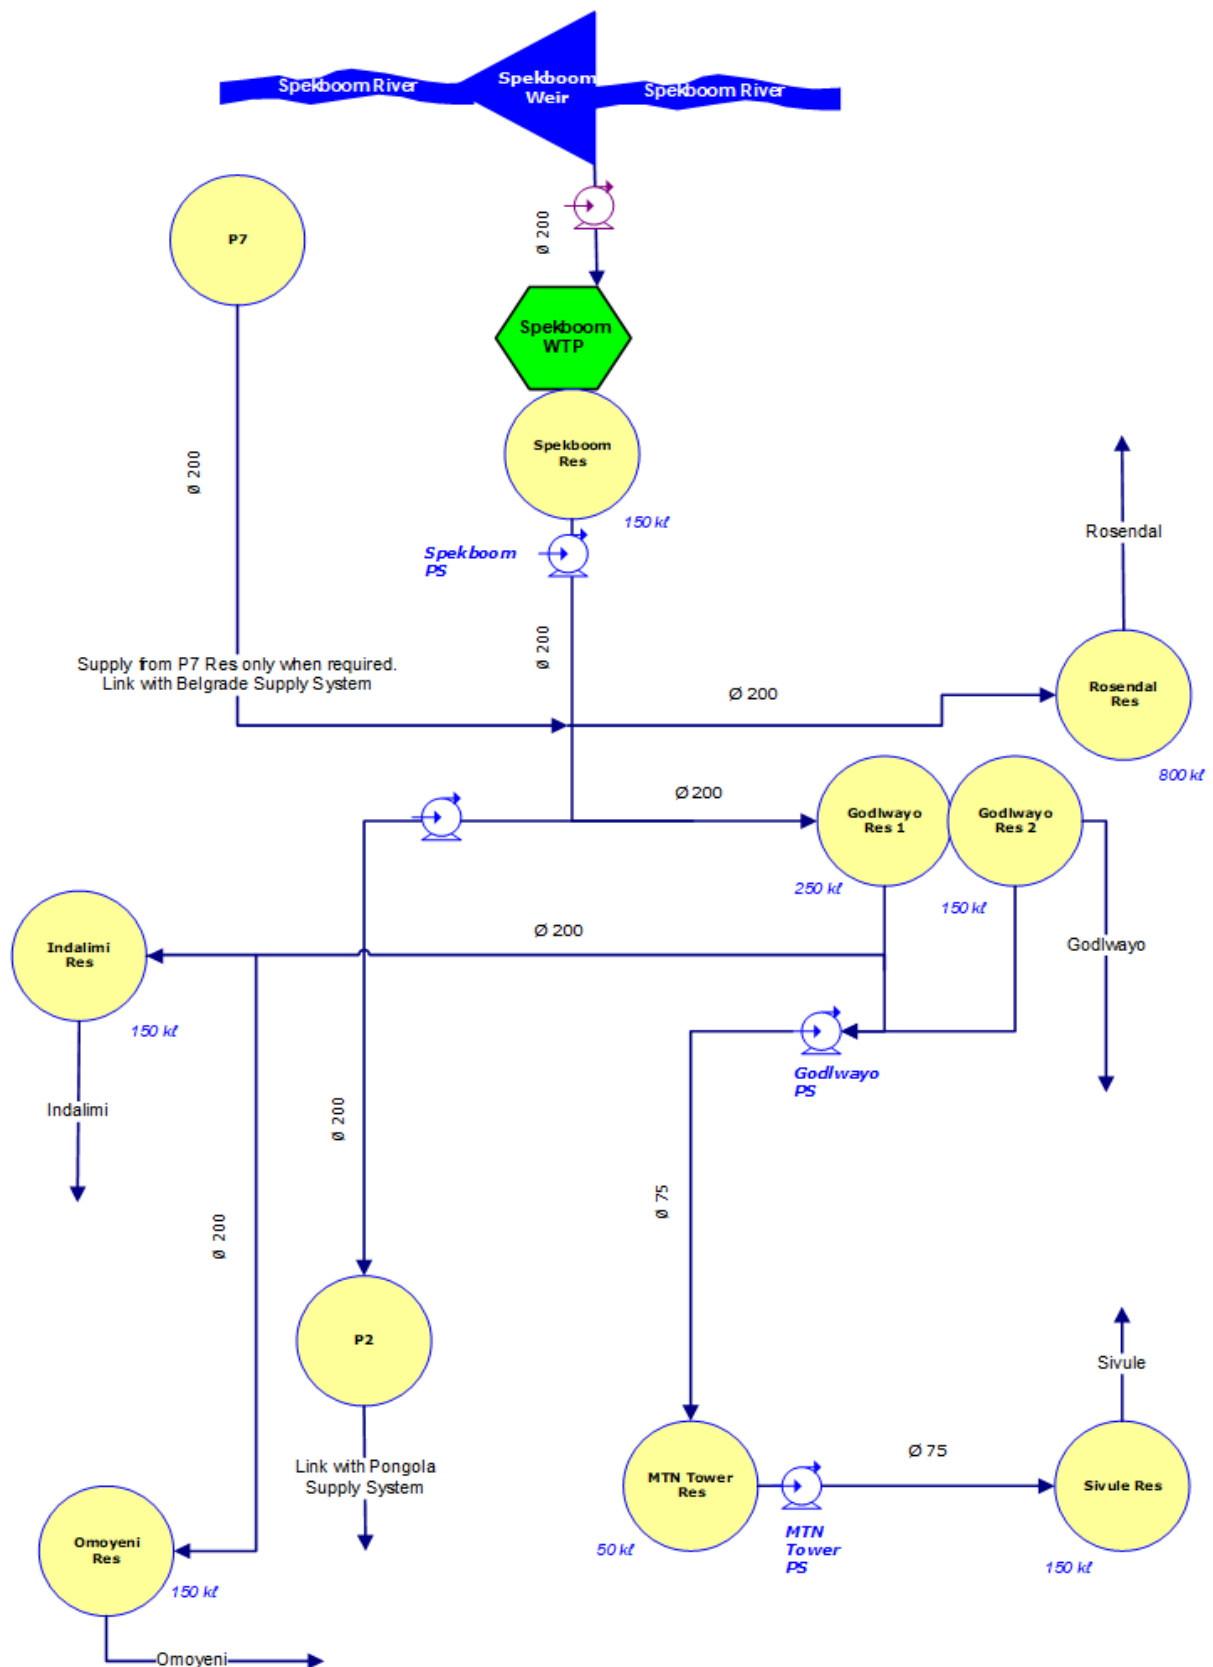


Figure 17.59 Schematic of Spekboom WTP Supply System

Table 17.65 Pump details: Spekboom Supply System

System	Pump Station Name	Number of Pumps		Pump Description	Supply From	Supply To	Static Head (m)	Duty Head (m)	Duty Capacity (Mℓ/day)
		Number of Duty Pumps	Number of Standby Pumps						
Spekboom	Spekboom Raw Water PS	2	1	Grundfos slv.80.100.75.2.5d.c	Spekboom Weir	Spekboom WTP	2	5**	1.5
Spekboom	Spekboom HL Pump Station	2	0	Mono pump pp5402	Spekboom WTP	Godlwayo Res & Bedle Res	84	90**	0.2
Spekboom	Godlwayo PS	2	0	Mono pump pp0404	Godlwayo Res	MTN Tower Res	96	100**	0.2
Spekboom	MTN Tower PS	1	1	Mono pump pp0404	MTN Tower Res	Sivule Res	172	178**	0.2

- ** These figures are based on calculated head loss

Table 17.66 Reservoir details: Spekboom BWSS.

System	Reservoir Site	Reservoir Name	Capacity (Mℓ)	Function	TWL (aMSL)	FL (aMSL)
Spekboom	Spekboom	Godlwayo Res 1	0.25	Distribution	663*	658*
Spekboom	Spekboom	Godlwayo Res 2	0.15	Distribution	663*	658*
Spekboom	Spekboom	Rosendal Res	0.15	Distribution	704*	699*
Spekboom	Spekboom	MTN Tower Res	0.05	Balancing	759*	754*
Spekboom	Spekboom	Sivule Res	0.15	Terminal	931*	926*
Spekboom	Spekboom	Indalimi Res	0.15	Terminal	726*	722*
Spekboom	Spekboom	Omoyeni	0.15	Terminal	687*	683*

*These figures are estimates and must be verified

Table 17.67 Pipeline details: Spekboom BWSS.

System	Pipeline Name	From	To	Length (km)	Nominal Diameter (mm)	Material	Capacity (Ml/day)	Age (years)
Spekboom	Raw water pipeline	Spekboom River	Spekboom WTP	0.01	200	uPVC	4.07**	42#
Spekboom	Potable water pipeline	Spekboom WTP	Rosendal Res	2.18	200	uPVC	4.07**	42#
Spekboom	Potable water pipeline	Spekboom WTP	Godlwayo Res Complex	2.0	200	uPVC	4.07**	42#
Spekboom	Potable water pipeline	Godlwayo Res	MTN Tower Res	1.7	75	uPVC	0.5**	42#
Spekboom	Potable water pipeline	MTN Tower Res	Sivule Res	2.2	75	uPVC	0.5**	42#
Spekboom	Potable water pipeline	Godlwayo Res	Indalini Res	1.0	200	uPVC	5.42*	42#
Spekboom	Potable water pipeline	Godlwayo Res	Omoyeni Res	1.7	200	uPVC	5.42*	42#

Based on a velocity of 2 m/s ** Based on a velocity of 1.5 m/s # Age need to be verified

(b) uPhongolo Water Treatment Supply System

The uPhongolo Water Treatment Plant (**Figure 17.60, Table 17.68**) is located south of the town of Pongola in the Zululand District of Kwazulu-Natal. The WTP receives raw water from an old irrigation canal system that was built for farm plantations. Some of the water from the canal collects in two ponds outside the water works before it gravitates into the head of works where the flow of water is metered.

For approximately four weeks of the year, when the canal is undergoing planned maintenance, raw water is pumped from a pump station, which abstracts water from the uPhongolo River and delivers directly into the canal, just upstream of a gauging sluice. The pump station and rising main only supply when the main irrigation canal is not operational. The plant operator estimates the capacity of the existing raw water pumping system at 8.5 Mℓ/day. This is sufficient to meet the average annual daily water treatment capacity of 8 Mℓ/day but not the peak requirements.

There is one water treatment plant, the Phongola Regional WTP, currently in operation, that is supplying treated water to the Simdlangentsha East Regional Water Supply Scheme area, which includes the town of Pongola. The design capacity of the uPhongolo WTP is for an average annual daily flow rate of 8 Mℓ/day. The maximum flow rate of the treatment plant is 12 Mℓ/day. The current treated water production from the uPhongolo Regional WTP alone was 8.37 Mℓ/day (3.05 million m³/annum) in 2019, which represents 105% of its design capacity and as a result the WTP is now being over-utilised. This is as a result of communities, south west of the supply area, being connected to the scheme (these areas were largely dependent on the local water supplies, which became unreliable).



Figure 17.60 Aerial view of Phongola Water Treatment Plant

Table 17.68 Characteristics of the Phongola WTP.

WTP Name:	Phongola WTP
System:	Phongola Supply System
Maximum Design Capacity:	12 Mℓ/day
Current Utilisation:	8.7 Mℓ/day
Raw Water Storage Capacity:	8.7Mℓ
Raw Water Supply Capacity:	8.5 Mℓ/day
Pre-Oxidation Type:	None
Primary Water Pre-Treatment Chemical:	Polymeric Coagulant
Total Coagulant Dosing Capacity:	13 ℓ/hour
Rapid Mixing Method:	Conventional Paddle Flash Mixer
Clarifier Type:	Dortmund Manual Clarifiers
Number of Clarifiers:	14
Total Area of all Clarifiers:	236.88 m ²
Total Capacity of Clarifiers:	12 Mℓ/day
Filter Type:	Slow Sand Filters
Number of Filters:	14
Filter Floor Type	Laterals with Nozzles
Total Filtration Area of all Filters	40.87 m ²
Total Filtration Design Capacity of all Filters:	12 Mℓ/day
Total Capacity of Backwash Water Tanks:	Unknown
Total Capacity of Sludge Treatment Plant:	None
Capacity of Used Washwater System:	0 Mℓ/day
Primary Post Disinfection Type:	Chlorine gas
Disinfection Dosing Capacity:	10 kg/hr Chlorinator
Disinfectant Storage Capacity:	
Total Treated Water Storage Capacity:	3.0 Mℓ

Figure 17.61 shows a schematic of the Phongola Supply System. Water is pumped (**Table 17.69**) from the WTP through a 250mm diameter pipeline (**Table 17.71**) to a number of distribution reservoirs in the system (**Table 17.70**).

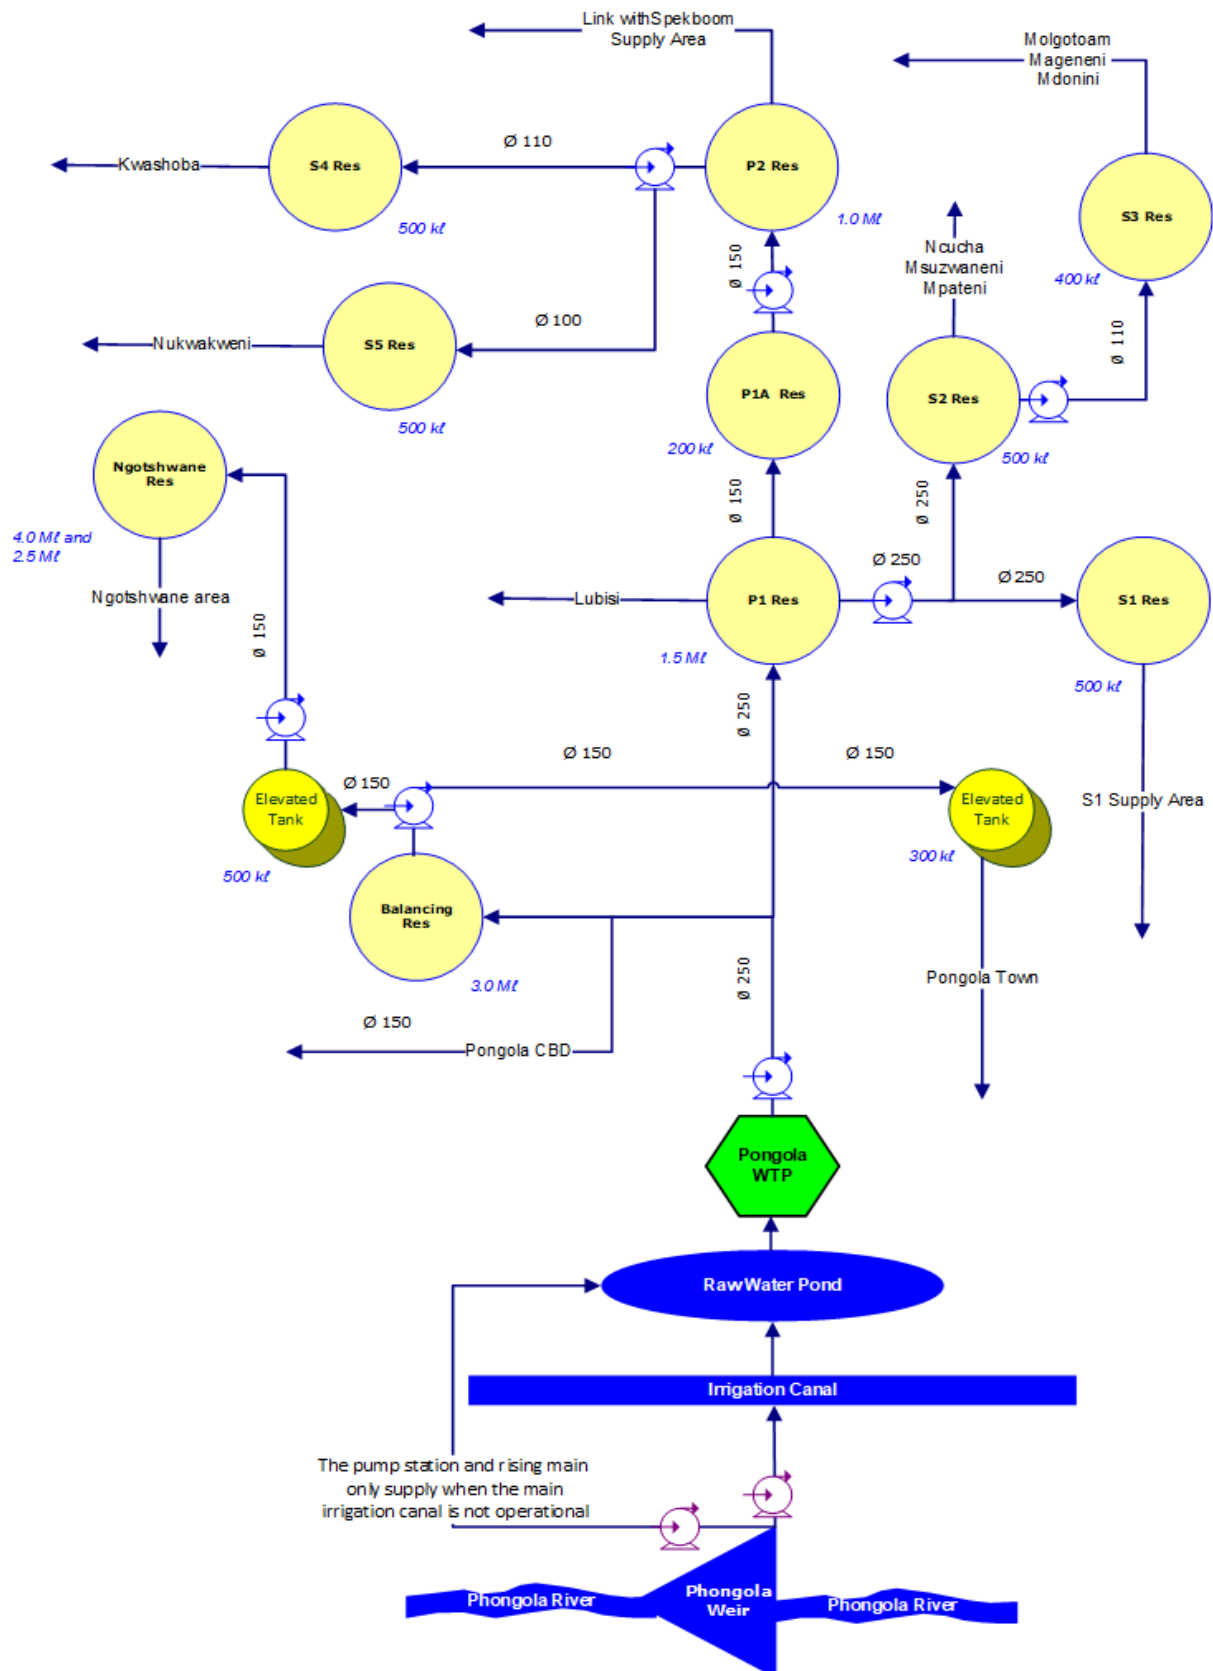


Figure 17.61 Schematic of Phongola WTP Supply System

Table 17.69 Pump details: Phongola Supply System

System	Pump Station Name	Number of Pumps		Pump Description	Supply From	Supply To	Static Head (m)	Duty Head (m)	Duty Capacity (ML/day)
		Number of Duty Pumps	Number of Standby Pumps						
Phongola	Raw water PS	1	1	Xylem 2201.012.0097 & Tsurumi KR 8822	Phongola River	Irrigation canal	36	43**	8
Phongola	Phongolo Raw Water PS	1	1	KSB LCC-M 80-300.2	Phongola Weir	Raw Water Pond			
Phongola	Pongola HL Pump Station	2	0	KSB ETA 125 - 50/1	Phongola WTP	Town Res	75.8	85**	4.8
Phongola	Pongola HL Pump Station	0	2	KSB ETA 125 - 50/2	Phongola WTP	Town Res	18	20**	2.5
Phongola	Ncotshana Tower Station	1	1	KSB WKLn 100/6	Town Res	Ncotshana Res	15	18**	1.2
Phongola	Simudlangentsha HL Station	2	2	KSB WKLn 80/3	Pongola WTP	P1 Pump Station	145	164**	2.5
Phongola	P1 Pump Station	2	1	KSB WKLn 65/3	Simudlangentsha HL Station	P1a	142	160**	1.1
Phongola	P1 Pump Station	2	1	KSB WKLn 32/10	Simudlangentsha HL Station	S1 Res	264	280**	0.177
Phongola	P1 Pump Station	1	1	KSB WKLn 80-4	Simudlangentsha HL Station	S2	171	180**	0.5
Phongola	P1 Pump Station	1	1	KSB WKLn 40/5	Simudlangentsha HL Station	S2	121	139**	0.5
Phongola	P1a Pump Station	2	1	KSB WKLn 65/5	P1 Pump Station	P2 Res	182	211**	3
Phongola	P2 Pump Station	2	1	KSB WKLn 40/4	P1a Pump Station	S4 Res	128	140**	0.5
Phongola	P2 Pump Station	2	1	KSB WKLn 32/8	P1a Pump Station	S5 Res	186	206**	0.5
Phongola	S2 Pump Station	2	1	KSB WKLn 32/7	S2 Pump Station	S3 Res	121	175	0.5

* These figures are based on calculated head loss

Table 17.70 Reservoir details: Phongola BWSS.

System	Reservoir Site	Reservoir Name	Capacity (Mℓ)	Function	TWL (aMSL)	FL (aMSL)
Phongola	Phongola	Phongola Balancing Res	3.0	Balancing	350*	343*
Phongola	Phongola	Elevated Tank 1	0.5	Distribution	368*	360*
Phongola	Phongola	Elevated Tank 2	0.3	Terminal	362*	354.45*
Phongola	Phongola	P1 Res	1.5	Distribution	393*	386*
Phongola	Phongola	Ngotshwane Res	6.5	Terminal	413*	406*
Phongola	Phongola	S1 Res	0.5	Terminal	647*	641*
Phongola	Phongola	S2 Res	0.5	Distribution	564*	558*
Phongola	Phongola	S3 Res	0.4	Terminal	685*	679*
Phongola	Phongola	P1 A Res	0.2	Balancing	520*	514*
Phongola	Phongola	P2 Res	1.0	Distribution	711*	704*
Phongola	Phongola	S4 Res	0.5	Terminal	839*	833*
Phongola	Phongola	S5 Res	0.5	Terminal	897*	891*

*These figures are estimates and must be verified

Table 17.71 Pipeline details: Phongola BWSS.

System	Pipeline Name	From	To	Length (km)	Nominal Diameter (mm)	Material	Capacity (Mℓ/day)	Age (years)
Phongola	Raw water pipeline	Phongola River	Phongola WTP	2.6	2 x 150	Steel	4.07**	42#
Phongola	Potable water pipeline	Phongola WTP	Phongola Balancing Tank	1.6	250	Steel	6.36**	42#
Phongola	Potable water pipeline	Phongola WTP	P1 Res	2.0	250	Steel	6.36**	42#
Phongola	Potable water pipeline	Balancing Tank	Elevated Tank 2	0.52	150	Steel	2.3**	42#
Phongola	Potable water pipeline	Elevated Tank 1	Ngotshwane Res	4.7	150	Steel	2.3**	42#
Phongola	Potable water pipeline	P1 Res	S1 Res	2.7	250	Steel	6.36**	42#
Phongola	Potable water pipeline	P1 Res	S2 Res	2.0	250	Steel	6.36**	42#
Phongola	Potable water pipeline	S2 Res	S3 Res	2.0	110	uPVC	1.23**	42#
Phongola	Potable water pipeline	P1 Res	P 1A Res	4.8	150	Steel	3.05*	42#
Phongola	Potable water pipeline	P1 A Res	P2 Res	3.2	150	Steel	2.3**	42#
Phongola	Potable water pipeline	P2 Res	S4 Res	2.4	110	Steel	1.23**	42#
Phongola	Potable water pipeline	P2 Res	S5 Res	3.6	100	Steel	1.02**	42#

Based on a velocity of 2 m/s

** Based on a velocity of 1.5 m/s # Age need to be verified

18.2.7 Mjindi Water Treatment Supply System (0.35 Ml/day)

The Mjindi Water Treatment Plant (**Figure 17.62, Table 17.72**) is located North towards Mafefe along the S1834. The bulk pipeline branches on the D21 road towards the Biva community and also on the A1188 towards Maputaland.

Raw water is pumped (**Table 17.73**) from the uPhongolo River and treatment takes place in a small plant consisting of a sedimentation tank and three pressure filters. Treated water is stored in a jojo tank on site before it is distributed to the reticulation network through pipelines (**Table 17.74**) and reservoirs (**Table 17.75**).

The current operating capacity of the plant is 0.27 Ml/day.



Figure 17.62 Aerial view of Mjindi Water Treatment Plant (Unknown source).

Table 17.72 Characteristics of the Mjindi WTP.

WTP Name:	Mjindi WTP
System:	uPhongolo Supply System
Maximum Design Capacity:	0.35 Mℓ/day
Current Utilisation:	0.27 Mℓ/day
Raw Water Storage Capacity:	1 Jojo tank
Raw Water Supply Capacity:	0.35 Mℓ/day
Pre-Oxidation Type:	None
Primary Water Pre-Treatment Chemical:	Polymeric Coagulant
Rapid Mixing Method:	Conventional Paddle Flash Mixer
Clarifier Type:	Plastic Clarifiers
Number of Clarifiers:	2 new & 1 old
Total Capacity of Clarifiers:	0.35 Mℓ/day
Filter Type:	Pressure Filters
Number of Filters:	3
Filter Floor Type	Filter Media
Total Filtration Design Capacity of all Filters:	0,35 Mℓ/day or 14,5m ³ /hr
Total Capacity of Backwash Water Tanks:	0m ³
Total Capacity of Sludge Treatment Plant:	None
Capacity of Used Washwater System:	None
Primary Post Disinfection Type:	Sodium Hypochlorite
Disinfection Dosing Capacity:	*1.0 l/hr
Disinfectant Storage Capacity:	25 ℓ tank
Total Treated Water Storage Capacity:	1 Jojo storage tank

Figure 17.63 shows a schematic of the Mjindi Supply System

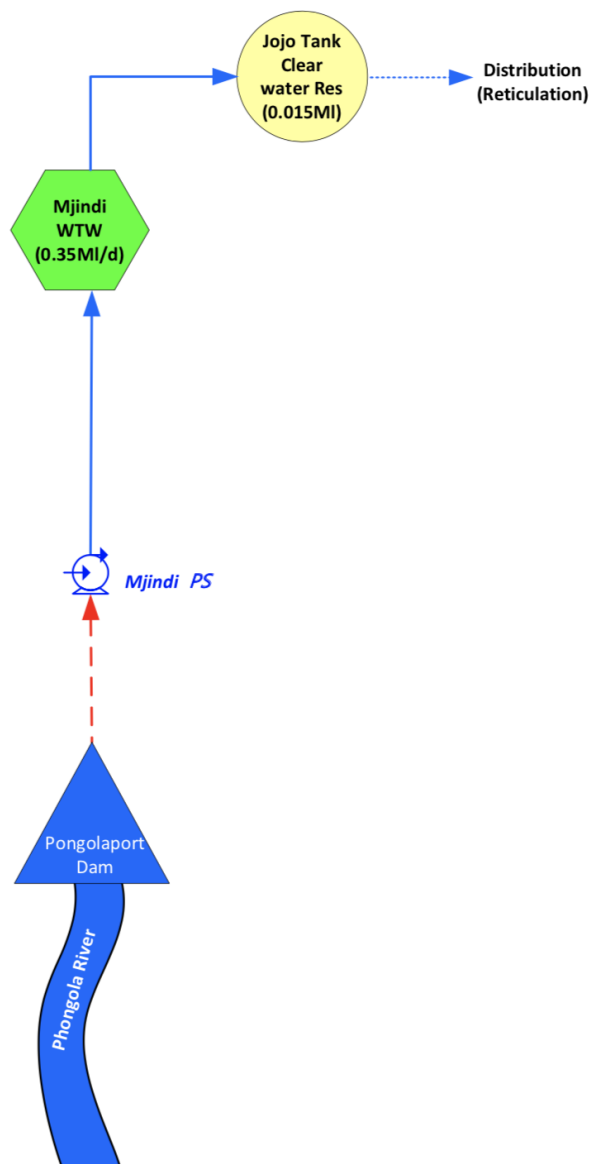


Figure 17.63 Schematic of Mjindi WTP Supply System

Table 17.73 Mjindi Pump Details

System	Pump Station Name	Number of Pumps		Pump Description	Supply From	Supply To	Static Head (m)	Duty Head (m)	Duty Capacity (Mℓ/day)
		Number of Duty Pumps	Number of Standby Pumps						
Phongola River	Mjindi PS	1	0		uPhongolo River	Mjindi WTP	71	73	0.35

Table 17.74 Mjindi Pipeline Details

System	Pipeline Name	From	To	Length (km)	Nominal Diameter (mm)	Material	Capacity (Mℓ/day)	Age (years)
Phongola River	Raw water pipeline	PhongolaPoort Dam	Mjindi WTP	0.2	80	uPVC	0.4	42#

Table 17.75 Mjindi Reservoir Details

System	Reservoir Site	Reservoir Name	Capacity (Mℓ)	Function	TWL (mASL)	FL (mASL)
Phongola River	Mjindi	Mjindi WTP	0,0015	Distribution	72	71

18.2.8 Nondebuya Water Treatment Supply System

The Nondabuya Water Treatment Plant Package Plant (**Figure 17.64, Table 17.76**) is located East of Jozini within the uMkhanyakude District Municipality of KwaZulu-Natal. The supply area extends North towards Kwasukela and West along the Mangqwashi River towards Ophondweni. The main source of supply to Nondabuya WTP is from the Phongola River. Nondebuya Clearwater Reservoir (**Table 17.78**) and Clearwater Pump Station is located in Nondebuya area. The current demand from the Nondebuya WTP exceeds the available supply volumes. Water is supplied from the WTP to two distribution reservoirs through a number of pipelines with details presented in (**Table 17.77**).

The current operating capacity of the plant is 0.3 Mℓ/day.



Figure 17.64 Aerial view of Nondebuya Water Treatment Plant & Nondabuya Reservoirs (unknown source).

Table 17.76 Characteristics of the Nondabuya WTP.

WTP Name:	Nondabuya WTP
System:	uPhongolo Supply System
Maximum Design Capacity:	0.3 Mℓ/day
Current Utilisation:	0.3 Mℓ/day
Raw Water Storage Capacity:	0.3 Mℓ
Raw Water Supply Capacity:	0.3 Mℓ/day
Pre-Oxidation Type:	None
Primary Water Pre-Treatment Chemical:	None
Total Coagulant Dosing Capacity:	None
Rapid Mixing Method:	None
Clarifier Type:	None
Number of Clarifiers:	None
Total Area of all Clarifiers:	None
Total Capacity of Clarifiers:	None
Filter Type:	Slow Sand Filters
Number of Filters:	2
Filter Floor Type	Filter Sand
Total Filtration Area of all Filters	m ²
Total Filtration Design Capacity of all Filters:	0.3 Mℓ/day
Total Capacity of Backwash Water Tanks:	None
Total Capacity of Sludge Treatment Plant:	None
Capacity of Used Washwater System:	None
Primary Post Disinfection Type:	Sodium Hypochlorite
Disinfection Dosing Capacity:	None
Disinfectant Storage Capacity:	25 ℓ tank
Total Treated Water Storage Capacity:	2 tanks x 0.2Mℓ and 0.1Mℓ

Figure 17.65 shows a schematic of the Nondabuya Supply System

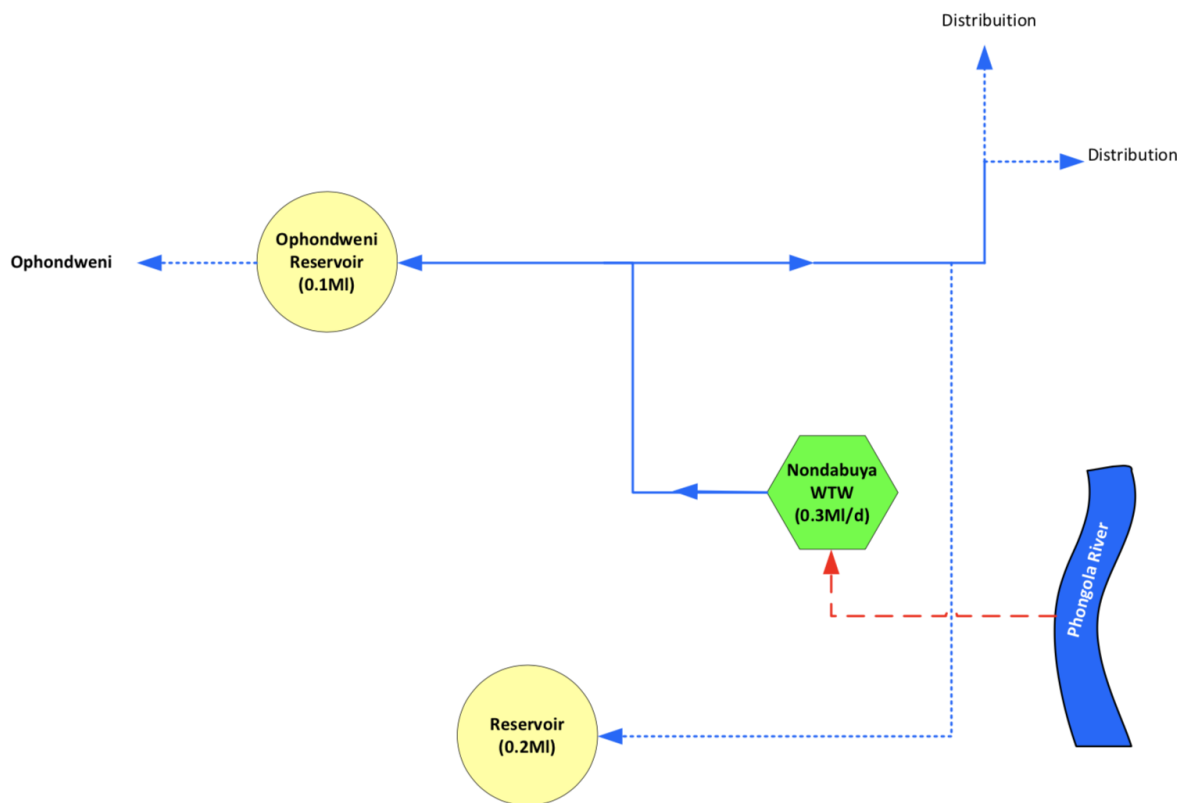


Figure 17.65 Schematic of Nondabuya WTP Supply System

Table 17.77 Nondebuya Pipeline Details

System	Pipeline Name	From	To	Length (km)	Nominal Diameter (mm)	Material	Capacity (Mℓ/day)	Age (years)
Phongola River	Raw Water	Phongola River	Nondabuya WTP	0.5	80*	*uPVC	0.3	42#
Phongola River	Potable Water	Nondabuya WTP	Ophondweni Res	0.1	80*	*uPVC	0.15	42#
Phongola River	Potable Water	Nondabuya WTP	Reservoir (0,2Mℓ)	0.1	80*	*uPVC	0.15	42#

Table 17.78 Nondebuya Reservoir Details

System	Reservoir Site	Reservoir Name	Capacity (Mℓ)	Function	TWL (mASL)	FL (mASL)
Phongola River	Nondabuya WTP	Ophondweni Res	0,1 Mℓ	Distribution	165*	160*
Phongola River	Nondabuya WTP	Reservoir (0,2Mℓ)	0,3 Mℓ	Distribution	252*	248*

18.2.9 Othobothini Water Treatment Supply System

The Othobothini Water Treatment Plant (**Figure 17.66, Table 17.79**) is located North East of Jozini within the uMkhanyakude District Municipality. The Othobothini WTP obtains raw water from the uPhongolo River which is then pumped to the Othobothini Water Treatment Plant.

The water is treated and distributed to a 200 kℓ Reservoir, which in turn supplies the area of Othobothini and its surrounding communities through both gravity and pumping system (**Table 17.80, Table 17.81, Table 17.82**). The maximum processing capacity of the plant is 2 Mℓ/day.

The current operating capacity of the plant is 0.5 Mℓ/day.

Othobothini Water Treatment Works New (20Mℓ/day upgradeable to 40Mℓ/day is under construction). The bulk backbone extends from Othobothini rural area towards Hlatikula and Mombeni along road D 1837, north of Othobothini rural towards Ophondweni and its diameter ranges from 250 to 320 mm diameter for Hlatikhulu/ Mombeni section and 220 to 350 mm diameter for the Ophondweni line.



Figure 17.66 shows an aerial view of the Othobothini WTP (unknown source).

Table 17.79 Characteristics of the Othobothini WTP.

WTP Name:	Othobothini WTP Old
System:	uPhongolo Supply System
Maximum Design Capacity:	2 Mℓ/day
Current Utilisation:	0.5 Mℓ/day
Raw Water Storage Capacity:	200 kℓ
Raw Water Supply Capacity:	0.5 Mℓ/day
Pre-Oxidation Type:	None
Primary Water Pre-Treatment Chemical:	Polymeric Coagulant
Total Coagulant Dosing Capacity:	ℓ/hour -
Rapid Mixing Method:	Conventional Paddle Flash Mixer
Clarifier Type:	Circular
Number of Clarifiers:	2
Total Area of all Clarifiers:	m ²
Total Capacity of Clarifiers:	Mℓ/day
Filter Type:	Pressure Sand Filters
Number of Filters:	2
Filter Floor Type	Filter Sand
Total Filtration Area of all Filters	m ²
Total Filtration Design Capacity of all Filters:	Mℓ/day or m ³ /hr
Total Capacity of Backwash Water Tanks:	0m ³
Total Capacity of Sludge Treatment Plant:	None
Capacity of Used Washwater System:	Mℓ/day
Primary Post Disinfection Type:	Sodium Hypochlorite
Disinfection Dosing Capacity:	4 ℓ/hr
Disinfectant Storage Capacity:	25 ℓ tanks
Total Treated Water Storage Capacity:	200kℓ

Figure 17.67 shows a schematic of the Othobothini Supply System

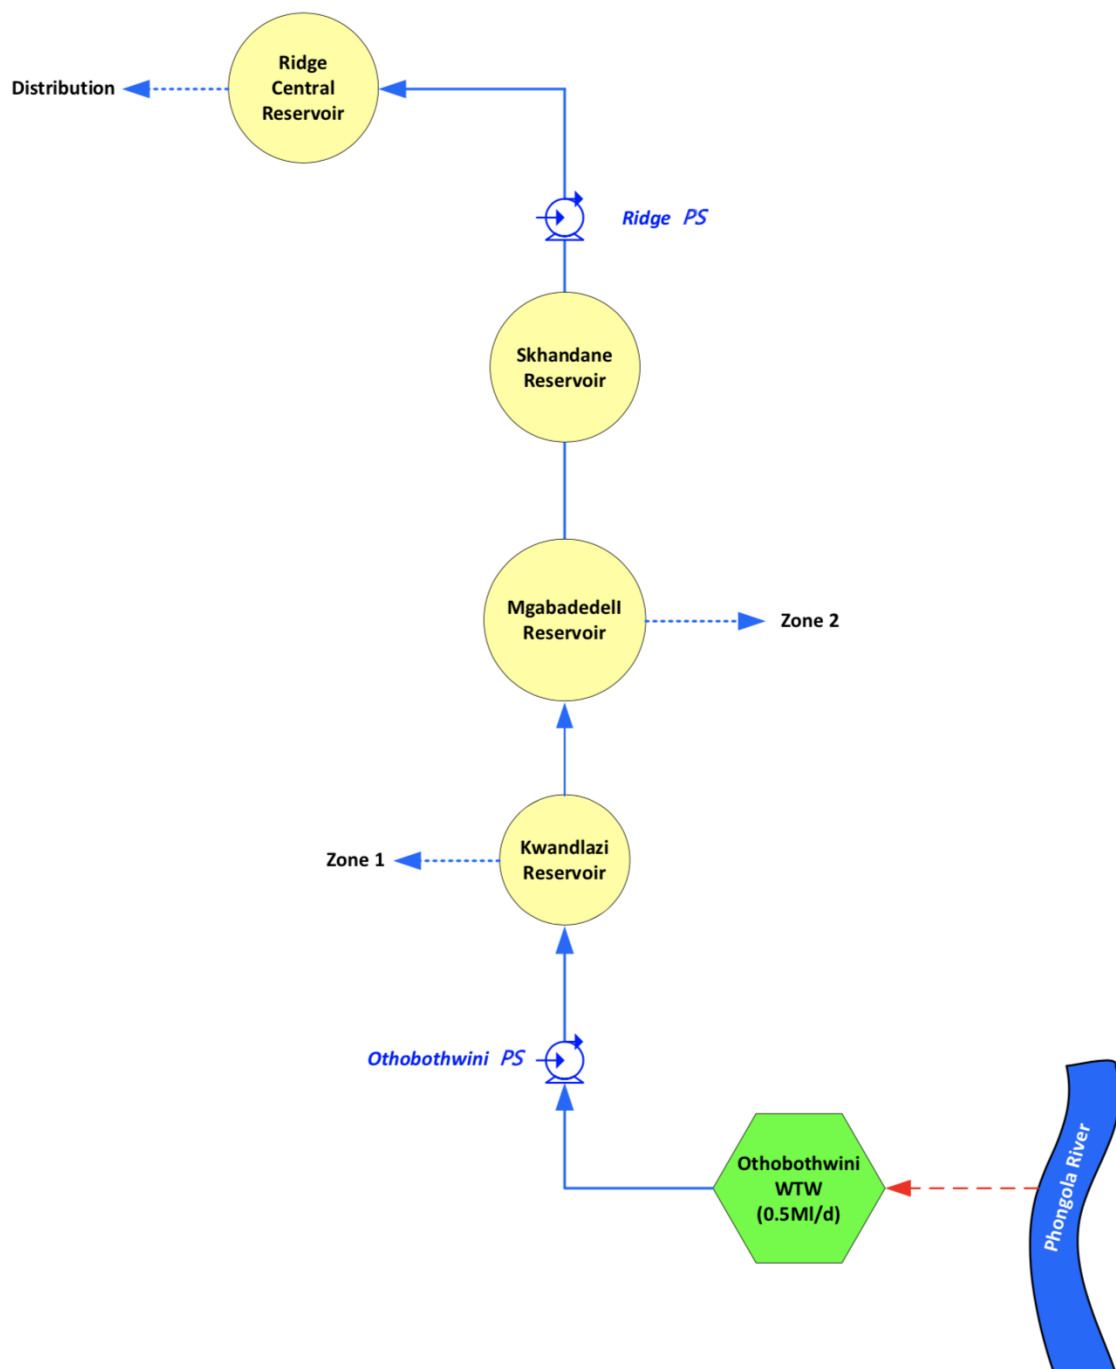


Figure 17.67 Schematic of Othobothini WTP Supply System

Table 17.80 Othobothini Pump Details

System	Pump Station Name	Number of Pumps		Pump Description	Supply From	Supply To	Static Head (m)	Duty Head (m)	Duty Capacity (Mℓ/day)
		Number of Duty Pumps	Number of Standby Pumps						
Phongolo	Raw Water PS	1	1		Phongolo River	Othobothini WTP	80		
Phongolo	Othobothini PS	2	1		Othobothini WTP	Kwandlazi Res			
Phongolo	Ridge PS	1	1		Skhandane Res	Ridge Central Res			

Table 17.81 Othobothini Pipeline Details

System	Pipeline Name	From	To	Length (km)	Nominal Diameter (mm)	Material	Capacity (Mℓ/day)	Age (years)
Phongolo	Othobothini bulk	Othobothini WTP	Othobothini PS		80	Steel	1.0*	41#
Phongolo	Othobothini bulk	Othobothini PS	Kwandlazi Res		50	Steel	0.7	41#
Phongolo	Othobothini bulk	Kwandlazi Res	Mgabadedell Res		50	Steel	0.5	41#
Phongolo	Othobothini bulk	Mgabadedell Res	Skhandane Res		50	Steel	0.3	41#
Phongolo	Othobothini bulk	Skhandane Res	Ridge Central Res		50	Steel	0.2	41#

Table 17.82 Othobothini Reservoir Details

System	Reservoir Site	Reservoir Name	Capacity (Mℓ)	Function	TWL (mASL)	FSL (mASL)
Othobothini	Othobothin WTP	Reservoir 1	200kl*	Storage		
Othobothini	Othobothin WTP	Elevated Tank	200kl*	Distribution		
Othobothini	Kwandlezi	Kwandlezi Res	200kl*	Terminal		
Othobothini	Mgabadedell	Mgabadedell Res	200kl*	Terminal		
Othobothini	Skhandane	Skhandane Res	200kl*	Balancing		
Othobothini	Ridge Central	Ridge Central Res	200kl*	Distribution	385*	380*

18.2.10 Jozini Water Treatment Supply System (Old & New)

The Jozini Old and New bulk pipelines extend from the Mseleni Town towards KwaMlamula in the north west and towards KwaSonto in the north east. The uPhongolo River and boreholes are the main water source for the Jozini bulk scheme. The information currently available indicates that the availability of water in the river and Phongolapoort Dam is insufficient to support the scheme. The bulk pipeline sizes range from 200mm to 250 diameters.

(a) Jozini Old

The Jozini Water Treatment Plant (Old) (**Figure 17.68, Table 17.83**) is located in the town of Jozini just off the D1907 Road within the uMkhanyakude District Municipality close to the town of Hlabisa. The Old Jozini WTP supplies Hlabisa and surrounding areas. The majority of the households within the Jozini supply area also obtain water from local streams.

(b) Jozini New

The Jozini Water Treatment Plant (New) (**Figure 17.69, Table 17.84**) is located in the town of Jozini just off the D1907 Road within the uMkhanyakude District Municipality. The Jozini New WTP receives raw water from the Jozini Dam via a channel and gravity Pump Station 2. The raw water is stored in a raw water holding tank before treatment. It is then pumped from the Jozini New Pumpstation (**Table 17.85**) to the Clear Water Makonyeni Storage Reservoir (**Figure 17.70, Table 17.87**). Thereafter it supplies the reticulation schemes of the Jozini Supply System (**Table 17.86**).

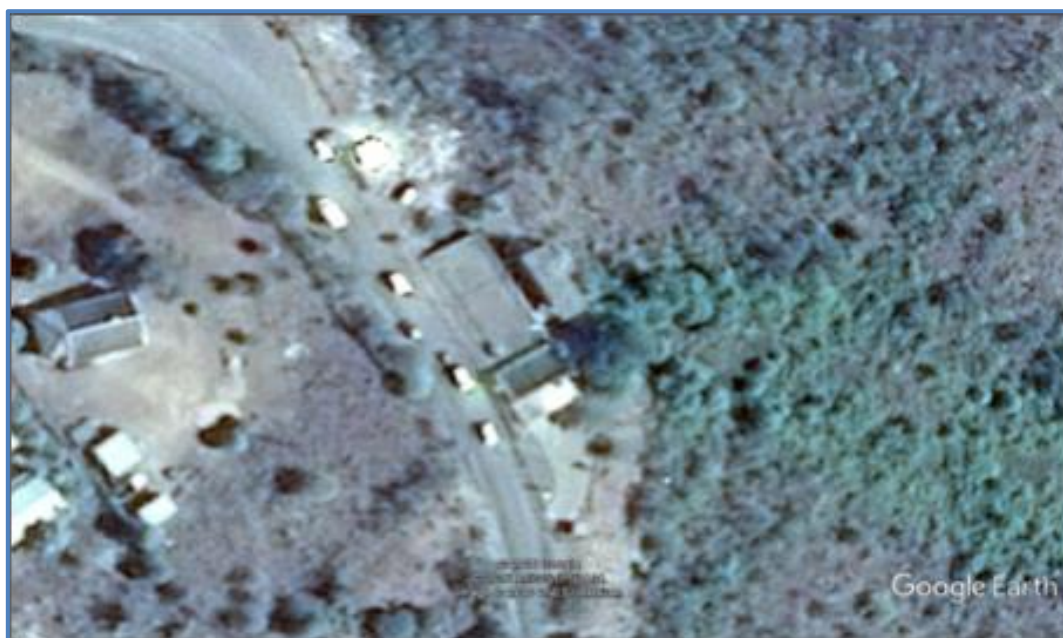


Figure 17.68 Aerial view of Jozini Old Water Treatment Plant (Google Earth 2020: website).



Figure 17.69 Aerial view of Jozini New Water Treatment Plant (unknown source).



Figure 17.70 Aerial view of Jozini Reservoir (unknown source).

Table 17.83 Characteristics of the Jozini OLD WTP.

WTP Name:	Jozini OLD WTP (Bottom)
System:	uPhongolo River Supply System
Maximum Design Capacity:	2.5 Mℓ/day
Current Utilisation:	2.5 Mℓ/day
Raw Water Storage Capacity:	0 Mℓ
Raw Water Supply Capacity:	Mℓ/day
Pre-Oxidation Type:	None
Primary Water Pre-Treatment Chemical:	Polymeric Coagulant
Rapid Mixing Method:	Conventional Paddle Flash Mixer
Clarifier Type:	Dortmund Clarifier
Number of Clarifiers:	4
Total Capacity of Clarifiers:	2.5 Mℓ/day
Filter Type:	Pressure Filter Vessels (18) & Tanks (2)
Number of Filters:	20
Filter Floor Type	Filter Media
Total Filtration Design Capacity of all Filters:	1.6 Mℓ/day at 7m/h or 2.3 Mℓ/day at 9m/h
Total Capacity of Backwash Water Tanks:	None
Total Capacity of Sludge Treatment Plant:	None
Capacity of Used Washwater System:	0
Primary Post Disinfection Type:	Chlorine gas
Disinfection Dosing Capacity:	Unknown at this stage
Disinfectant Storage Capacity:	10 kg Chlorine Gas Cylinders
Total Treated Water Storage Capacity:	1 Mℓ/day*

Table 17.84 Characteristics of the Jozini NEW WTP.

WTP Name:	Jozini NEW WTP
System:	PongolaPoort Canal
Maximum Design Capacity:	5 Mℓ/day
Current Utilisation:	5 Mℓ/day
Raw Water Storage Capacity:	2 Mℓ/day
Raw Water Supply Capacity:	5 Mℓ/day
Pre-Oxidation Type:	None
Primary Water Pre-Treatment Chemical:	Polymeric Coagulant
Total Coagulant Dosing Capacity:	ℓ/hour
Rapid Mixing Method:	Conventional Paddle Flash Mixer
Clarifier Type:	Rectangular Clarifier
Number of Clarifiers:	2
Total Capacity of Clarifiers:	5 Mℓ/day
Filter Type:	Slow Sand Filters
Number of Filters:	4
Filter Floor Type	Filter Sand Media
Total Filtration Design Capacity of all Filters:	5 Mℓ/day
Total Capacity of Backwash Water Tanks:	None
Total Capacity of Sludge Treatment Plant:	Sludge Lagoons
Capacity of Used Washwater System:	None
Primary Post Disinfection Type:	Chlorine gas
Disinfection Dosing Capacity:	Unknown at this stage
Disinfectant Storage Capacity:	70Kg Cylinders
Total Treated Water Storage Capacity:	1 Mℓ/day*

Figure 17.71 shows a schematic of the Jozini Old Supply System

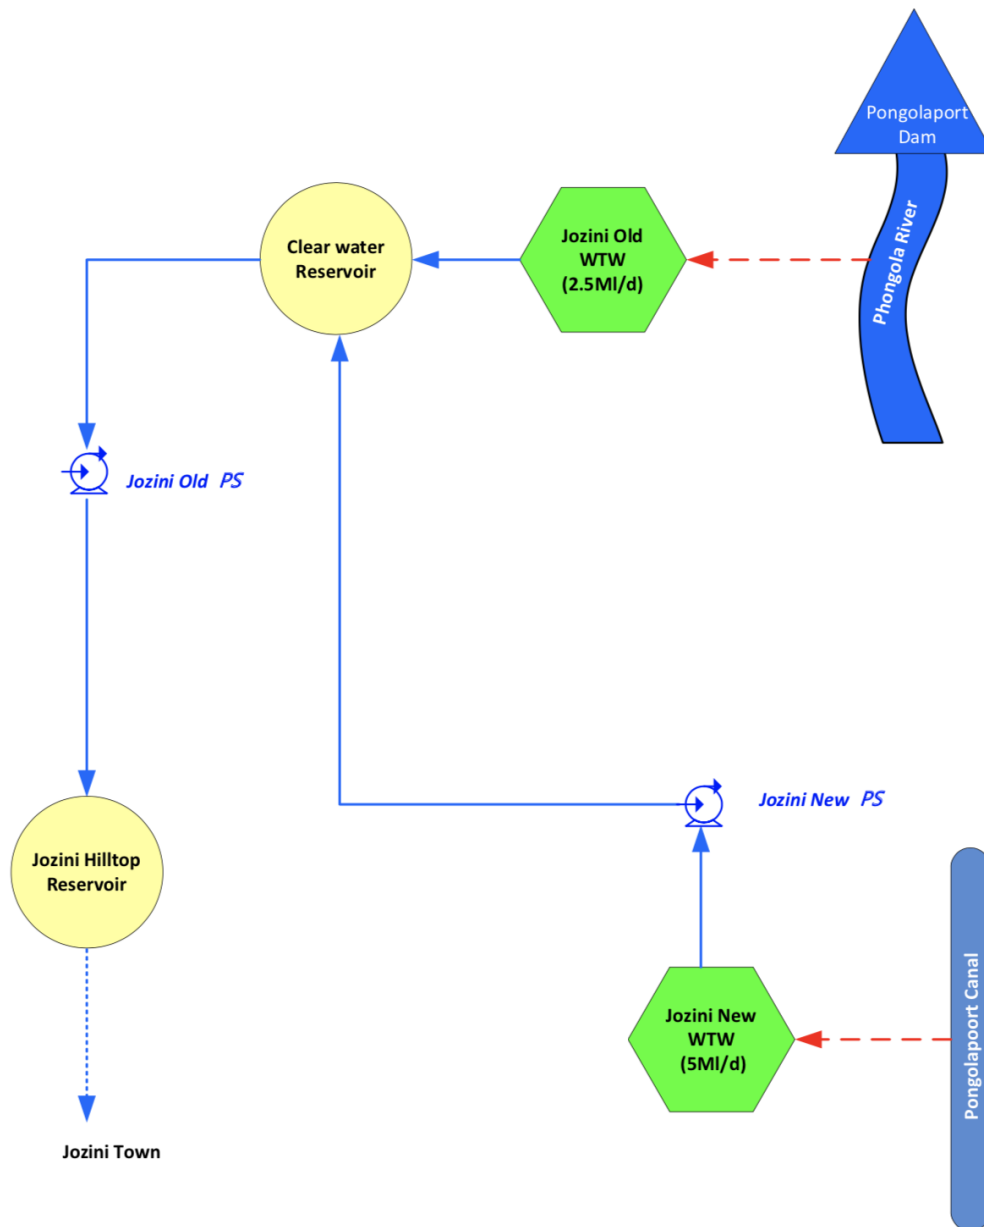


Figure 17.71 Schematic of Jozini WTP Supply System

Figure 17.72 shows a schematic of the Jozini New Supply System

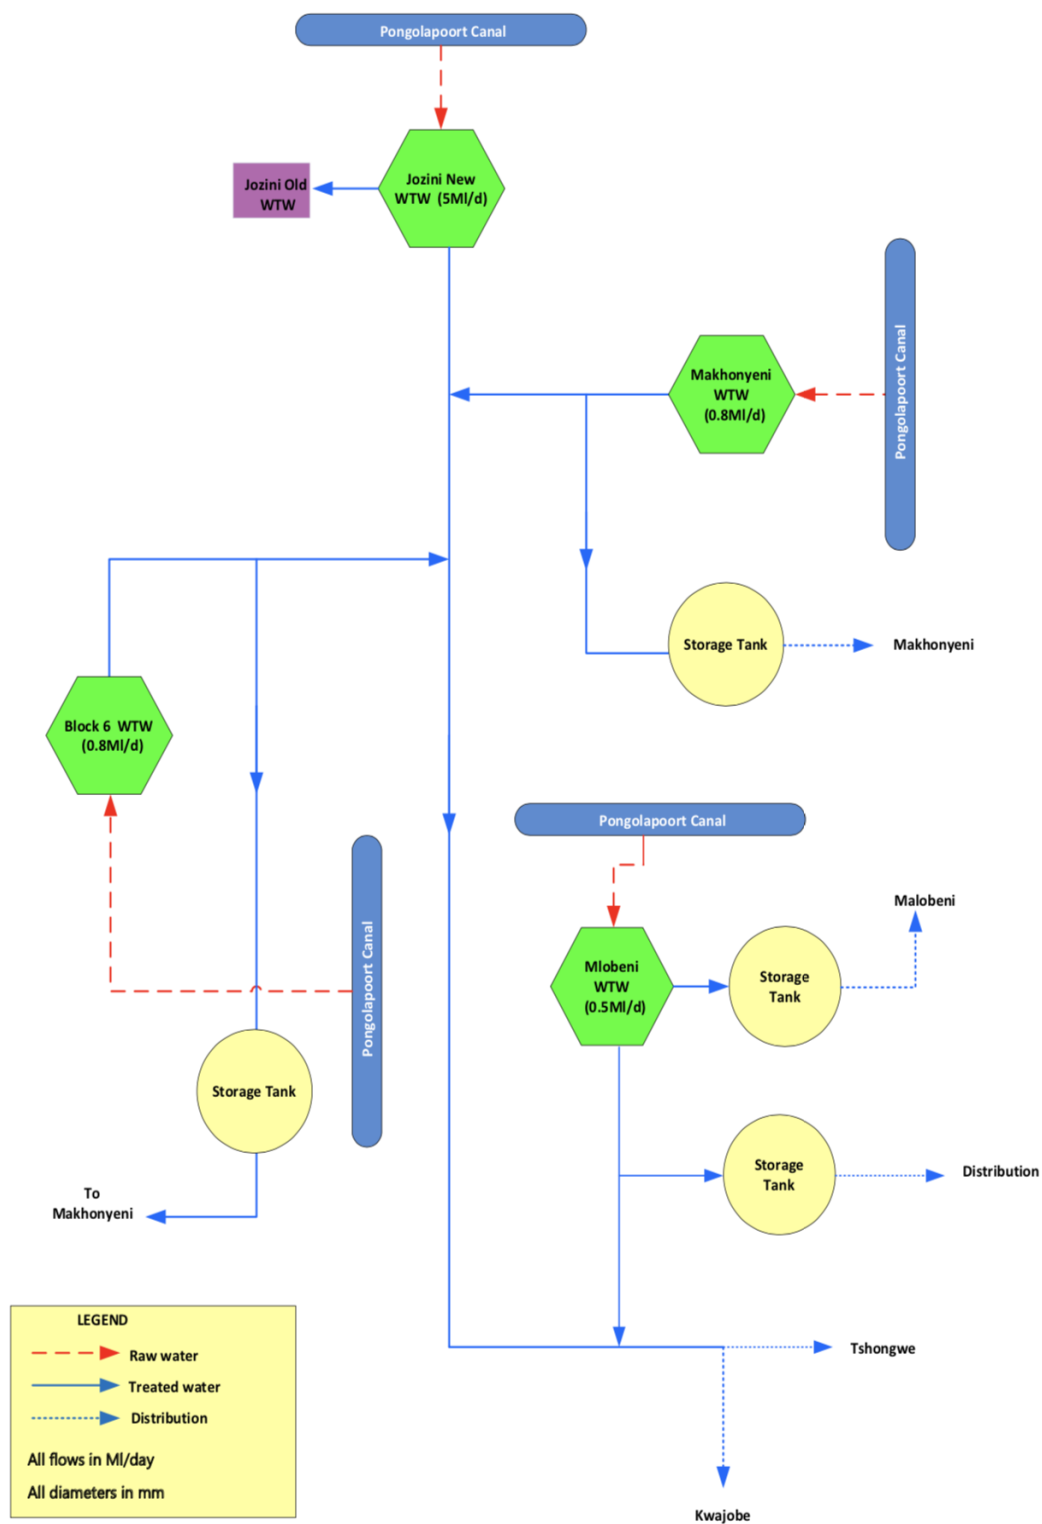


Figure 17.72 Schematic of Jozini WTP Supply System

Table 17.85 Jozini Pump Details

System	Pump Station Name	Number of Pumps		Pump Description	Supply From	Supply To	Static Head (m)	Duty Head (m)	Duty Capacity (Mℓ/day)
		Number of Duty Pumps	Number of Standby Pumps						
Phongola River	Jozini Old PS	2	1		Jozini Clear Water Res	Jozini Hilltop Res	180	265	2.5
PhongoaPoort Canal	Jozini New PS	2	1		Jozini New WTP	Jozini Old WTP	94	180	5.0

Table 17.86 Jozini Pipeline Details

System	Pipeline Name	From	To	Length (km)	Nominal Diameter (mm)	Material	Capacity (Mℓ/day)	Age (years)
Phongola River	Raw water pipeline	uPhongolo River (Canal)	Jozini Old WTP	0.5	100	Steel	2.5	42#
Phongola River	Potable water pipeline	Jozini Old WTP	Jozini Clear Water Res	1.0	100	Steel	5.0	7#

Table 17.87 Jozini Reservoir Details

System	Reservoir Site	Reservoir Name	Capacity (Mℓ)	Function	TWL (mASL)	FSL (mASL)
Phongola River	Jozini	Jozini Clear Water Res		Balancing	184*	180
Phongola River	Jozini	Jozini Hilltop Res		Distribution	269*	265
PhongoaPoort Canal	Makhonyeni	Makhonyeni Res		Storage	109*	105
PhongoaPoort Canal	Block 6	Block 6		Storage	136*	133
PhongoaPoort Canal	Mlobeni	Malobeni Tank 1		Distribution	94*	92
PhongoaPoort Canal	Mlobeni	Malobeni Tank 2		Distribution	94*	92

18.2.11 Shemula Water Treatment Supply System

The Shemula Bulk Water Supply System is currently served by one of two large capacity water treatment plants in the uMkhanyakhude District Municipality. The source for both the water treatment plants is the uPhongolo River. The remainder of the District is served by small conventional package treatment plants or schemes with chlorination only.

The Shemula Old WTP (**Figure 17.73**) has a design capacity of 7 Mℓ/day and. The newly commissioned Shemula New water treatment plant (**Figure 17.74** and **Table 17.88**) has a design capacity of 20 Mℓ/day. Treated water from Shemula Water Treatment Plant is pumped (**Table 17.89**) through a rising main (**Table 17.90**) to Shemula Command Reservoir (**Table 17.91**) where it is stored and supplied to Ndumo and Mboza Reservoirs. Ingwavuma Command Reservoir 01 and Ingwavuma Command Reservoir 02, supplied from the Shemula WTP, are located in the town of Ingwavuma. Ndumu Town Reservoir located in Ndumo receives its water from Shemula Booster pumpstation, where it is stored and supplied via gravity to the Shemula Elevated Tank.



Figure 17.73 Aerial view of the Shemula (Old) WTP (unknown source).

Figure 17.74 shows an aerial view of the Shemula (New) WTP



Figure 17.74 Aerial view of Shemula New Water Treatment Plant (Google Earth 2020: website).

Table 17.88 Characteristics of the Shemula NEW WTP.

WTP Name:	Shemula Old and New WTP
System:	uPhongolo River
Maximum Design Capacity:	Old 7 Mℓ/day New 20 Mℓ/day (Augmentation)
Current Utilisation:	27 Mℓ/day
Raw Water Storage Capacity:	4.5 MI*
Raw Water Supply Capacity:	27 Mℓ/day
Pre-Oxidation Type:	None
Primary Water Pre-Treatment Chemical:	Coagulant
Total Coagulant Dosing Capacity:	ℓ/hour
Rapid Mixing Method:	Conventional Paddle Flash Mixer
Clarifier Type:	Clarifloculator
Number of Clarifiers:	2
Total Capacity of Clarifiers:	27 Mℓ/day
Filter Type:	Rapid Gravity Sand Filters
Number of Filters:	4
Filter Floor Type	Filter Sand Media
Total Filtration Design Capacity of all Filters:	20 Mℓ/day
Total Capacity of Sludge Treatment Plant:	Sludge Lagoons*
Capacity of Used Washwater System:	Mℓ/day
Primary Post Disinfection Type:	Chlorine gas
Disinfection Dosing Capacity:	Unknown at this stage
Disinfectant Storage Capacity:	1 Tonne Cylinders*
Total Treated Water Storage Capacity:	2.5 MI; 4.5MI exisiting reservoir

Figure 17.75 shows a schematic of the Shemula Supply System

**Shemula, Ndumo, Ngwavuma
& Phelandaba Existing
Schematic Diagram**

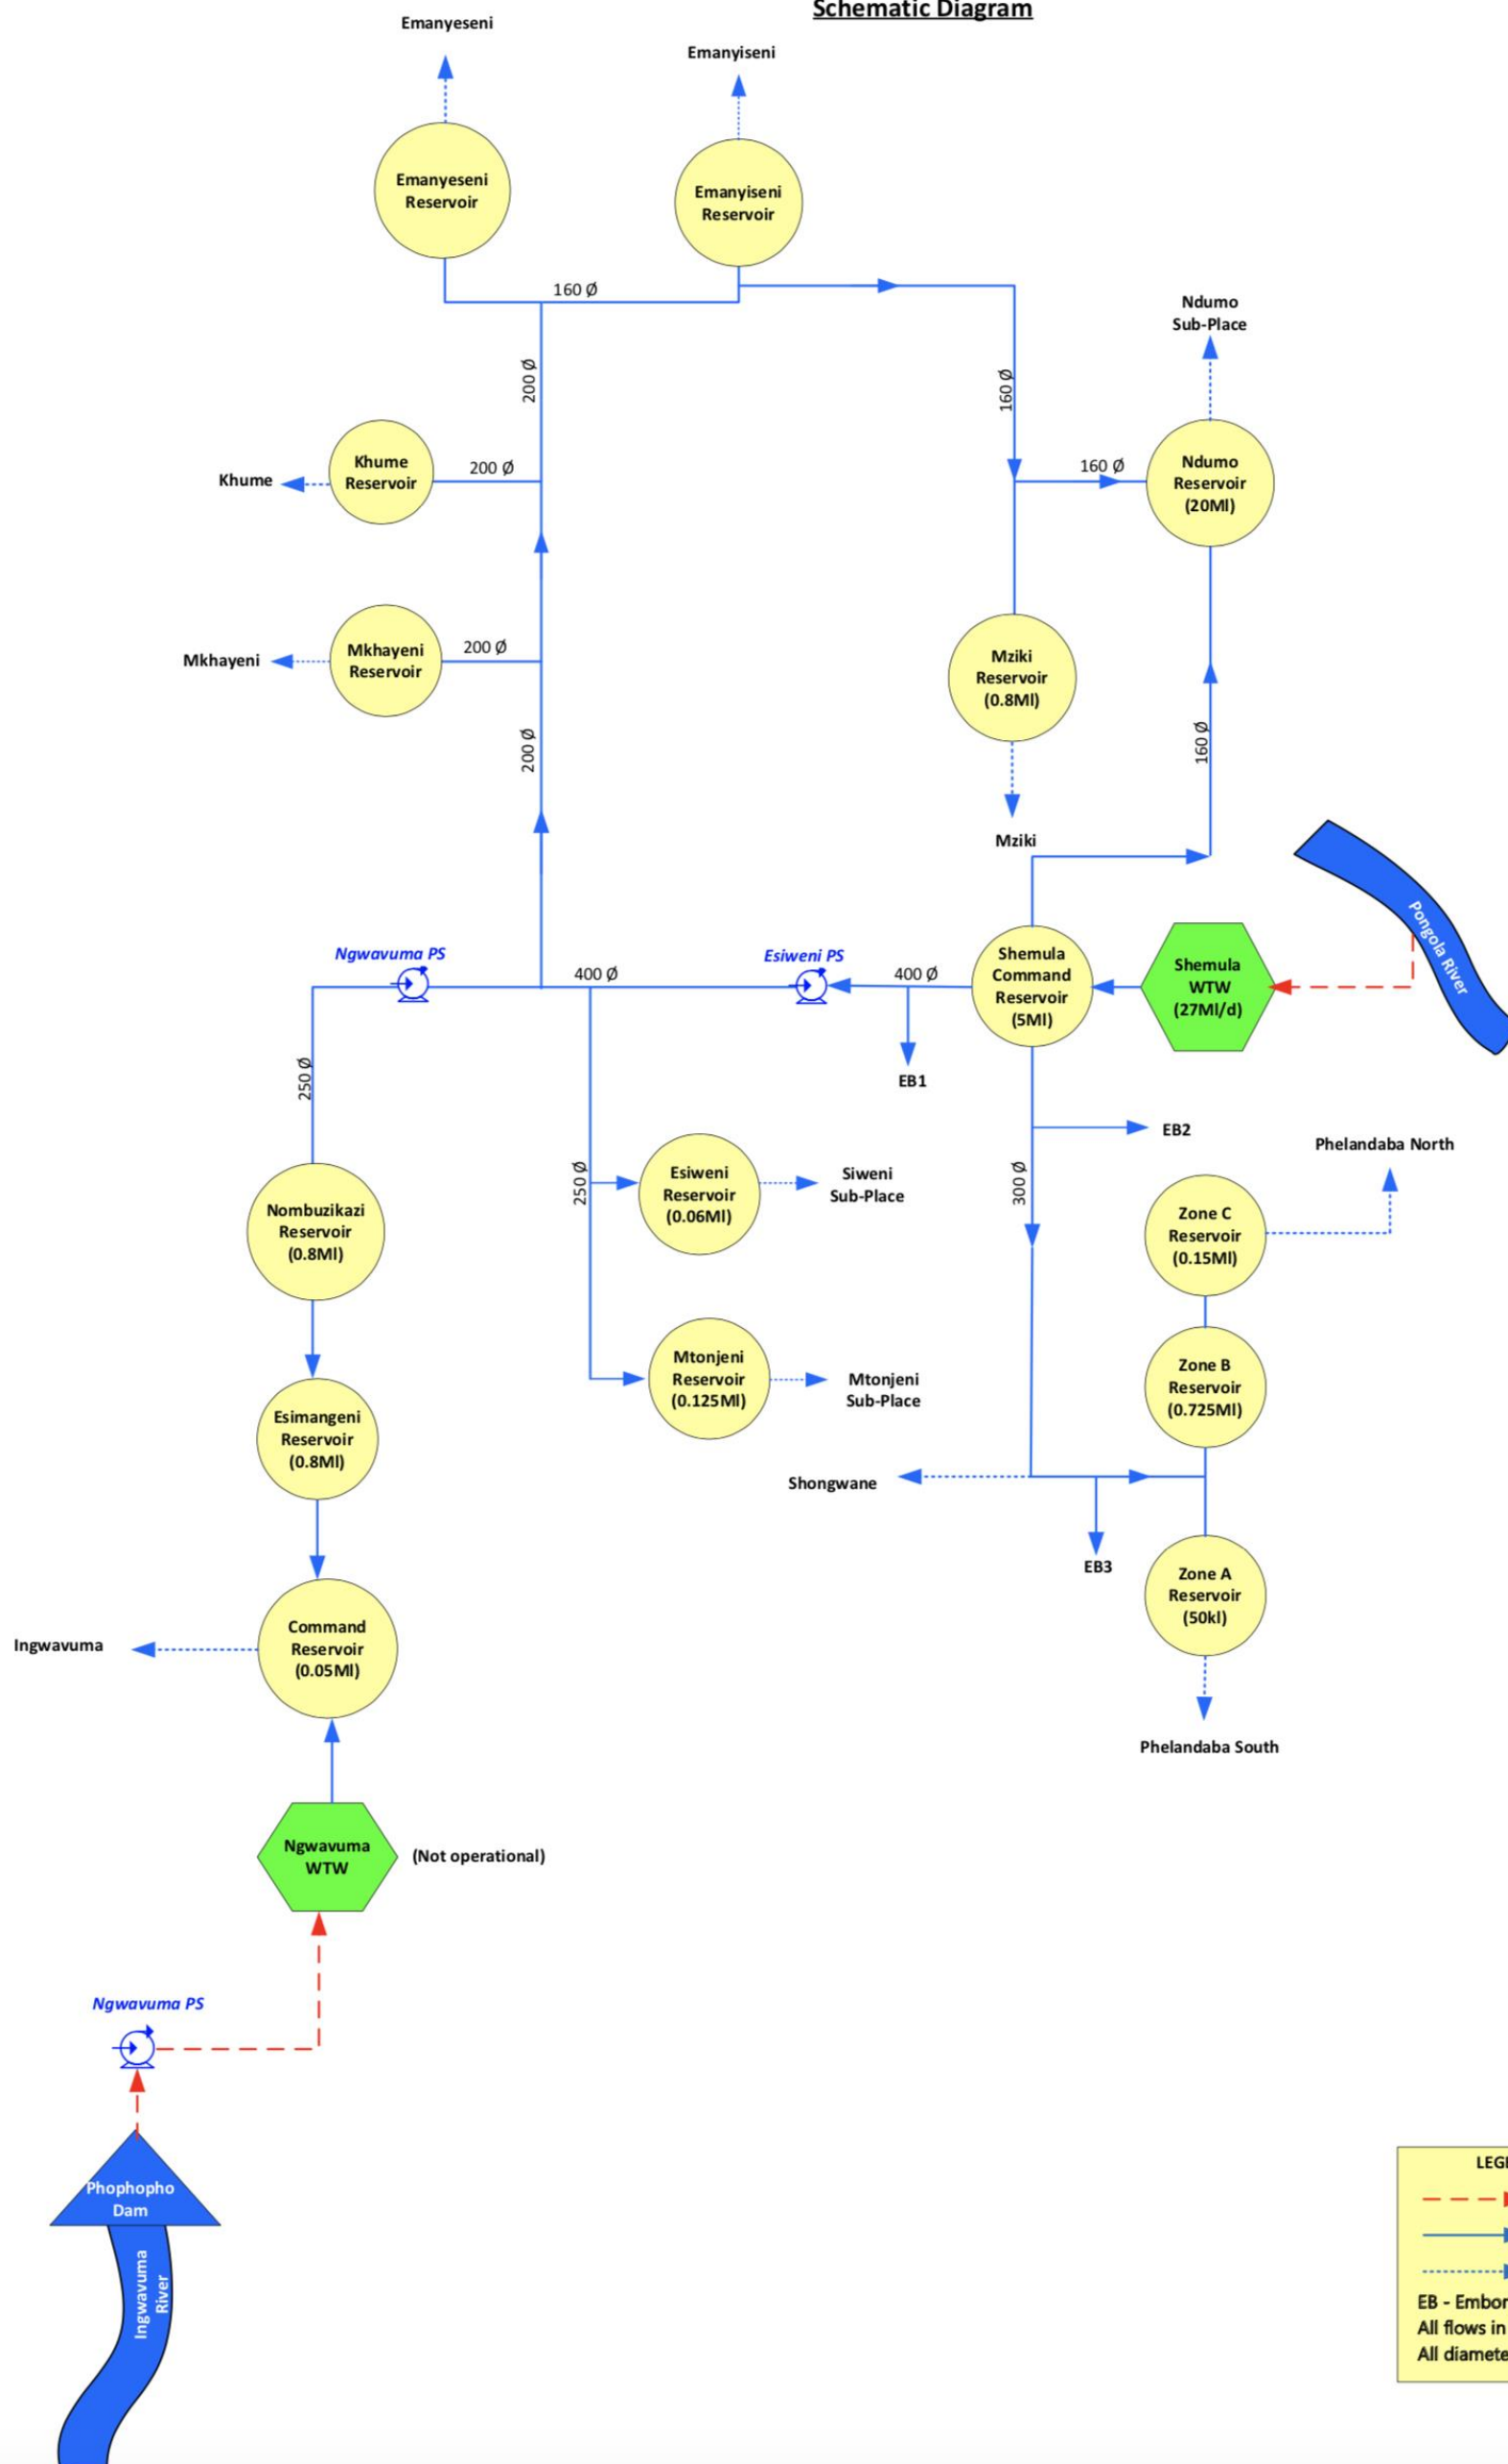


Figure 17.75 Schematic showing the Shemula Supply System

Table 17.89 Shemula Pump Details

System	Pump Station Name	Number of Pumps		Pump Description	Supply From	Supply To	Static Head (m)	Duty Head (m)	Duty Capacity (m³/hr)
		Number of Duty Pumps	Number of Standby Pumps						
uPhongolo River	Raw Water PS	2	1	ETA 200-40, 75kw motor	uPhongolo River	Shemula Command Res	33	49	520 m³/hr
uPhongolo River	Clear Water PS	3	1	Centrifugal multistage WKLN 150-4, 250kw motor	Shemula Command Res	Ngwavuma PS & supply reservoirs	53	70	80 m³/hr
uPhongolo River	Esiweni PS/Phuntaza PS	2	1		Shemula Command Res	Ngwavuma PS & supply reservoirs	114	134*	50 m³/hr*
uPhongolo River	Ngwavuma PS	2	1		Shemula Command Res	Nombuzikazi Res	124	140*	

Table 17.90 Shemula Pipeline Details

System	Pipeline Name	From	To	Length (km)	Nominal Diameter (mm)	Material	Capacity (Ml/day)	Age (years)
Phongola River	Raw water pipeline	Phongola River	Shemula WTP	1.5	700	Steel	20	7
Phongola River	Potable water pipeline	Shemula WTP	Shemula Command Res	2.5	700	Steel	20	7
Phongola River	Potable water pipeline	Shemula Command Res	Esiweni PS	5.0*	400	Steel	10*	7
Phongola River	Potable water pipeline	Esiweni PS	Ngwavuma PS	10.0*	300	Steel	2*	7
Phongola River	Potable water pipeline	Esiweni PS	Esiweni Reservoir	10.0*	250	Steel	2*	7
Phongola River	Potable water pipeline	Esiweni PS	Ndumo Reservoir	10.0*	400	Steel	20	7
Phongola River	Potable water pipeline	Ngwavuma PS	Nombuzikazi Reservoir	10.0*	250	Steel	0.8	7

Table 17.91 Shemula Reservoir Details

System	Reservoir Site	Reservoir Name	Capacity (Mℓ)	Function	TWL (mASL)	FL (mASL)
Phongola River	Shemula	Shemula Command Res	10	Balancing	50*	45
Phongola River	Ndumo	Ndumo Reservoir	2 x 5	Distribution	160*	155
Phongola River	Ndumo	Esiweni Reservoir	150kl	Distribution	253*	251
Phongola River	Ndumo	Mtonjeni Reservoir	0,125	Distribution	322*	320
Phongola River	Ngwavuma	Ngwavuma Command Reservoir	570kl	Distribution	85	83

18.3 Status Quo and Limitations

18.3.1 Hlobane/Coronation Supply System

The Hlobane WTP is in need of major refurbishment. Hlobane Reservoir 2, a steel tank, is also badly corroded and failure of this unit would have consequences on water supply to the town.

The Zululand District Municipality does not foresee the demand increasing beyond the current capacity of the plant and upgrading of the plant may not be necessary in the short to medium term.

Similarly, the Coronation WTP is now classed as aging infrastructure. The Coronation village is no longer an active mining village and the population is only a fraction of its previous figures. It is recommended that planned maintenance be implemented at the WTP to ensure that a reliable and efficient operation continues in the medium term and, at present, there is no need to extend / upgrade the WTP.

The Zululand District Municipality is in the process of identifying Regional Bulk Water Supply Schemes, to, ultimately, absorb these smaller schemes. As a result, the Hlobane and Coronation Supply Systems will be incorporated in the Greater Khamabi Regional Bulk Water Supply Scheme. A detailed feasibility study would be required to confirm the viability and financial implications of this regional scheme.

18.3.2 uMkhuze Supply System

The 1.5 Mℓ/day uMkhuze WTP has been upgraded. This upgrade, however, did not include an increase of the raw water supply infrastructure. The water is pumped from the Jozini Dam to Blackie Dam and then pumped to the uMkhuze River. The R34 million upgrades included the following:

- Construction of 1Mℓ Concrete Reservoir
- Construction of rapid gravity sand filter
- Construction backwash pump station
- Construction of Chlorine building & blower room
- Construction of chemical dosing unit
- Construction of Pipework, chambers and manholes
- Renovation of WTP including buildings and concrete structures

The Ubombo WTP requires to be upgraded and refurbished. A bulk line has been proposed from Jozini New WTP via Mkhuze to Mhlekezi which includes a new bulk line to supply Jozini Town and augment Mkhuze and uMhlekezi. Jozini New is a 5 Mℓ/day plant abstracting water from the irrigation canal fed from Pongolapoort Dam. uMhlekezi Water proposed a bulk pipeline to Mkhuze and Mhlekezi.

From the Demand model, a 250mm diameter pipe from the water treatment plant to uMkhuze has been recommended and a 200 mm diameter pipeline from Bethesdal Hospital to Mhlekezi. The total water demand for Jozini, Mkhuze and Bethesdal WTP is 5.8 Mℓ/day, while the capacity of the three plants adds up to 6.8 Mℓ/day; therefore, the treatment plants are sufficient to supply those three areas currently.

18.3.3 Simdlangentsha West RBWSS

(a) Edumbe WTP Supply System

The 2018 potable water demand for the supply area was 2.7 Mℓ/day and the abstraction was 3 Mℓ/day. The current registered water use for the town of Paulpietersburg and Edumbe Township is 0.87 Mℓ/day and insufficient to meet the current raw water abstraction requirements for the Edumbe WTP although the Edumbe Dam has a firm yield to sustain the current demand. The total storage capacity of the Edumbe WTP Supply System is 5 Mℓ, which amounts to an average 46 hour storage capacity, but in summer months this reduces to a 30 hour storage capacity.

The WTP is coping with the required demand and is producing water of a reasonable quality.

(b) Frischgewaagd WTP Supply System

Frischgewaagd WTP (**Figure 17.76**) is the largest of three plants that supply the Simdlangentsha West Regional Water Supply Scheme with a design capacity of 2 Mℓ/day. The Frischgewaagd WTP do encounter operational problems from time to time because of seasonal changes to the quality of the raw water, particularly the high turbidity levels that are experienced in summer.

Growing demand in the area has the WTP operating at 98% of its design capacity and with operational difficulty renders the plant insufficient to meet the demand.

Zululand District Municipality is in the process to consolidate the smaller WTP's with the larger ones and set up a regional BWSS. The Frischgewaagd WTP is one such plant and ZDM is busy with the construction of a 15 Mℓ/day WTP next to the Phongola River to serve the Simdlangentsha West Regional Water Supply Scheme.



Figure 17.76 Construction of new 15 Mℓ /day WTP at Frischgewaagd along the Phongola River (Google Earth 2020: website).

18.3.4 Simdlangentsha Central RBWSS

(a) Belgrade WTP's Supply Systems

Although the area is generally well-served, all schemes are old, and regional scheme planning will include infills to provide water to additional households. The existing Sim Central Package Plant (4Mℓ/day) is running at full capacity and cannot supply the remaining regional supply area as it also supplies the northern section of Simdlangentsha East. Simdlangentsha East does not receive adequate water all the way from the Pongola abstraction works.

18.3.5 Simdlangentsha East RBWSS

(a) Spekboom and Phongola WTP's Supply Systems

The Simdlangentsha East RBWSS supplies water to the town of Phongolo as well as a vast rural area which stretches from the border with Swaziland in the north, the communities of Manyandeni and Highlands to the east and the Pongola River to the south and Spekboom to the west

The design capacity of the uPhongolo Water Treatment Plant (WTP) is for an average annual daily flow rate of 8 Mℓ/day. The maximum flow rate of the treatment plant is 12 Mℓ/day. The current treated water production from the Phongola Regional WTP alone was 8.37 Mℓ/day (3.05 million m³/annum) in 2018, which represents 105% of its design capacity.

It is the intention of the Zululand District Municipality to develop the Simdlangentsha East Regional Water Supply Scheme to supply water for domestic use to the whole of the Simdlangentsha East area including the communities currently supplied from springs or not supplied at all. The current capacity of the Phongola WTP alone is insufficient to meet the future water requirements of the villages and rural towns in its intended supply area. The capacity of the Phongola WTP will need to be upgraded in the near future if it is to supply the whole of the Simdlangentsha East Regional Water Supply Scheme area.

(b) Umkhanyakhude WTP Supply System

The areas within the UKDM area are supplied by various smaller WTP which are unable to meet the current demands. The Shemula Water Master Plan Supply Area covers the northern-most area of the UKDM cutting across the Jozini and uMhlabuyalinga Local Municipalities. The Jozini Water Master Plan Supply Area is in the northern half of the UKDM, cutting across the southern parts of Jozini and uMhlabuyalinga LMs.

The uMkhanyakhude District Municipality have a registered water allocation of 13.5 million m³/annum or 37 Mℓ/day at the Jozini New WTP abstraction weir. The Jozini Regional Bulk upgrade is in the implementation phase. The Shemula WTP has been augmented by 20 Mℓ/day. A new Othobothini 40 Mℓ/day treatment works is under construction (**Figure 17.77**) and will have the capacity to supply the future demand for the scheme area including the proposal to supply Hluhluwe Phase 3. The 40 Mℓ/day extension and upgrade will be adequate to meet the future demands beyond 2035. The planned bulk line from Othobothini to augment the water deficits currently experienced is under construction. The 22 km, 200 mm diameter bulk distribution lines from Othobothini will augment Nondabuyo. Both bulk lines from Othobothini and from Bhokweni to Matshamhlophe have calculated volumes to meet the 2045 projected water demand for Othobothini and the surrounding communities.

The Othobothini to kwaJobe Branch, 250mm diameter bulk pipeline, when compared with the demand model is not adequate. The bulk lines have already been installed. The recommendation is to construct another 250 mm diameter pipe parallel to the existing one. The All Town strategies report states that the Nondabuyo 150 kℓ reservoir, precast concrete with a steel roof, is insufficient to meet the current and future 48 hours storage required. The recommendation is that a 3.5 Mℓ storage reservoir is required to meet the demands for the area.

The Regional Water Treatment Plant, this component of the project consists of the construction and installation of the following infrastructure:

- Raw Water Abstraction Works: A new raw water abstraction works capable of abstracting 40Mℓ per day (20Mℓ per day in Phase 1) is constructed on the banks of the uPhongolo River.
- Raw Water Rising Main: A new raw water rising main to carry raw water from the abstraction works to the new treatment works (800mm diameter, 1760 m long steel pipe from the River Abstraction Works.
- Water Treatment Plant: The construction a new water treatment plant (WTP) capable of treating 20Mℓ of water per day. The site selected will make allowance for future expansion of the WTP when this is required.
- Storage Reservoir: A balancing / storage reservoirs capable of storing 4.2Mℓ of treated water will be built at the water treatment plant.
- Potable Water Rising Main: A new potable water rising main (800mm in diameter, 2800m long) from the new treatment works to carry potable water to the KwaNdlazi (Jozini Local) reservoir



Figure 17.77 Aerial view of Regional Water Treatment Plant (NEW) (unknown source).

18.4 Water Balance/Availability

DWS is currently conducting a Water Resources Reconciliation Strategy study for the Usuthu to uMfolozi catchments and this is expected to be completed in July 2024. Updated water balance results from this study will be incorporated in the 2025 Infrastructure Master Plan. The latest water balance estimates for the uMkhuze, uPhongolo and Lake Sibaya systems are presented below.

18.4.1 uMkhuze Water Supply System

The first order water balance of the uMkhuze catchment suggests that there is a system deficit and part of the reason is the lack of storage in the system, which would improve assurance of supply. According to ZD-WSDP (2004), the deficit is also a result of the provision made for future implementation of the Reserve.

A reconciliation undertaken, which includes both Coronation and Khambi Water Supply Schemes, with estimated water requirements of 1 million m³/annum and 0.2 million m³/annum respectively, indicates that there is a deficit in the uMkhuze River (**Table 17.92**). This is a result of utilisation of the system yield by irrigation, without maintaining water for the Reserve (ZD-WSDP, 2004). The report suggests that this deficit can be addressed with the use of compulsory licensing and the re-allocation of water between different sectors.

Table 17.92 Water Balance – Water availability in UMkhuze System for year 2000 (ZDM WSDP,2004)

		UMkhuze (million m ³ /annum) 98% assurance
Available Water	Yield from Major Dams	0
	Yield from Minor Dams	5.6
	Run-of-River Yield	26.3
	Return flow	7.5
	Transfers in	30
	Total available	64.4
Requirements	Irrigation	74
	Urban & Rural	5
	Mining & Industry	0
	Ecological Requirements	13
	Total Used	92
Balance		-27.6

The water balance for the UMkhuze/Hluhluwe catchment, based on the net surface water resources as calculated in the DWAF 2004 Internal Strategic Perspective: Usuthu to Mhlathuze Water Management Area, and using updated and current registered use and return flows (WARMS December 2015) shows a deficit of 50.39 million m³/annum (**Table 17.93**).

A total volume of 14.8 million m³/annum is registered for Hluhluwe Dam and the major water user downstream of the dam is irrigation agriculture. The main crops being irrigated are sugarcane and pineapples. Domestic water use is the other significant water user, via the Hluhluwe Water Supply Scheme. There is also 0.8 million m³/annum of forestry in the W32F catchment, which has some impact on water availability in the river. Based on the available information, the future water requirements for domestic water use from the Hluhluwe Dam cannot be met at the required levels of assurance of supply and without curtailment of existing water uses.

Table 17.93 uMkhuze Catchment Water Balance (Mhlathuze Water, 2016)

uMkhuze Catchment	Available/Impact (million m ³ /annum)
Gross surface water resource	71
Ecological Reserve	-54
Invasive alien plants	-2
Net surface water resource	15
Groundwater	12
Agriculture return flow	6
Mining Return Flow W31	7.12
Urban Return Flow W31	0.26
Urban Return Flow W32	0.46
Transfer from uPhongolo	33
Total Available	73.84
Total Registered Water Use W31	-89.49
Total Registered Water Use W32	-34.74
Water Balance	-50.39

18.4.2 uPhongolo Water Supply System

The recent water resources yield analysis by DWS (2021) shows that the historical firm yield of Pongolapoort Dam is 443 million m³/a. The environmental and Makhathini floodplain releases made from Pongolapoort Dam reduce the yield of the dam substantially by up to 250 million m³/annum (ZD-WSDP, 2004). UUW (2019) suggests that the catchment yield is already oversubscribed by 133 million m³/a. However, it is recognised that there is likelihood of an overlap between the Ecological Reserve and Flood Release allocations for Makhathini flood plains. Without this overlap, there is surplus water available in the uPhongolo River system to meet the future water requirements of the domestic sector in the supply areas that can be supplied from or supported by the Pongolapoort Dam (Table 17.94).

Table 17.94 Water balance - Water availability in uPhongolo System (ZD WSDP, 2004)

		Bivane Dam	Pongolapoort Dam Incremental Catchment	Pongolapoort Dam Total Catchment
		98% assurance (million m ³ /annum)	98% assurance (million m ³ /annum)	98% assurance (million m ³ /annum)
Available Water	Yield from Major Dams	153	734	887
	Yield from Minor Dams	1.8	1.2	3.0
	Run-of-River Yield	0	0	0
	Return flow	1.8	17.4	19.2
	Total available	156.6	752.6	909.2
Requirements	Irrigation	18	169	197
	Urban & Rural	1	5	6
	Mining & Industry	0	1	1
	Ecological Requirements	62	152	152
	Transfers Out	0	35	35
	Total Used	81	362	391
Balance		75.6	390.6	518.2

As a short to medium term water reconciliation strategy option, a significant amount of water can be saved by implementing WC/WDM measures in uMkhuze, Jozini town, as well as Shemula WSS (DWS, 2016). Therefore, WC/WDM measures should be implemented in the uPhongolo River system in order to reduce the amount of water required from the local water resources.

18.4.3 Lake Sibaya Water Supply Area

A study by Smithers et al. (2017) indicates that the demands for community water supply were in order of 1.35 million m³/annum (3.5 Mℓ/day) in the year 2014. This study used historical levels of afforestation and abstractions as input to the model, and for a specified minimum lake level of 16 m above sea level. The maximum additional monthly abstraction that can be made is 0.085 million m³/month at a 98% assurance of supply (2.8 Mℓ/day). This yield shows a 90% increase on 2015 abstractions, and is maintaining simulated lake levels of more than 16 m for 98% of the months simulated.

18.5 Recommendations

18.5.1 Simdlangentsha West Regional Bulk Water Supply Scheme (Frischgewaagd BWSS, Edumbe BWSS)

The following infrastructure upgrades and augmentation will be required in order to adequately supply the Simdlangentsha West RBWSS

- Upgrade the existing primary bulk pipeline from the Dumbe Dam to the Paulpietersburg WTP to \varnothing 200mm;
- Upgrade existing secondary bulk pipelines (64km) ranging between \varnothing 50mm and \varnothing 500mm;
- Add secondary bulk pipelines ranging from \varnothing 50mm and \varnothing 200mm (38 km) and tertiary pipelines (27 km) ranging between \varnothing 50mm and \varnothing 200mm;
- Increase existing primary storage capacity (5.2Mℓ) to 7.8 Mℓ and the existing secondary storage (1.6 Mℓ) to 14.7 Mℓ. The existing tertiary storage capacity (5.6 Mℓ) would need to increase to 9.7 Mℓ;
- Additional secondary storage capacity of approximately 5.3 Mℓ would be required. The total tertiary storage that will be needed amounts to approximately 790 kℓ.

18.5.2 Simdlangentsha Central Regional Bulk Water Supply Scheme (Belgrade BWSS)

The following infrastructure upgrades and augmentation will be required in order to adequately supply the Simdlangentsha Central RBWSS

Initiate hydrology studies to determine the yield of the rivers and spring from where the following infrastructure components could be commissioned:

- Construction of a new WTP (10Mℓ/day) at the existing weir at Mozana River;
- Upgrade 9km existing primary bulk pipeline ranging from \varnothing 150mm to \varnothing 450mm;
- Upgrade existing secondary pipelines (16km) ranging between \varnothing 75mm and \varnothing 450mm;
- Upgrade 18km existing tertiary pipelines (18km) ranging from \varnothing 50mm to \varnothing 160mm;
- Add secondary bulk pipelines ranging from \varnothing 75mm to \varnothing 250mm (29km) and tertiary pipelines (39km) ranging between \varnothing 63mm and \varnothing 140mm;

Increase existing storage capacities with 5.27Mℓ. Existing secondary storage (1.7Mℓ) to be increased to 4.45Mℓ and existing tertiary storage (220kℓ) to 2.76Mℓ;

- Additional secondary storage capacity of approximately 2.28 Mℓ would be required. The total tertiary storage that will be needed amounts to approximately 7.1Mℓ; and
- Hydrology studies are required to determine the yield of the rivers.

18.5.3 Simdlangentsha East Regional Bulk Water Supply Scheme (Spekboom and Phongola WTP's Supply Systems)

The following infrastructure upgrades and augmentation will be required in order to adequately supply the Simdlangentsha East RBWSS

Initiate hydrology studies to determine the yield of the rivers from where the following infrastructure components could be commissioned:

- Upgrade the existing primary bulk pipelines (3.4km) to \varnothing 200mm and \varnothing 630mm;
- Upgrade 33.6km existing secondary pipelines ranging between \varnothing 75mm and 630mm;
- Upgrade 91km existing tertiary pipeline ranging between \varnothing 50mm and \varnothing 250mm;
- Add secondary bulk pipelines ranging from \varnothing 75mm to \varnothing 250mm (7.5km) and tertiary pipelines (39km) ranging between \varnothing 63mm and \varnothing 140mm;
- Increase the existing secondary storage capacity (1.25M ℓ) to 10.85M ℓ and the existing tertiary storage (3.8M ℓ) to 14.47M ℓ ;
- Additional secondary storage capacity of approximately 2.28M ℓ would be required. The total tertiary storage that will be needed amounts to approximately 7.1M ℓ ; and
- Hydrology studies are required to determine the yield of the rivers.

18.5.4 Lake Sibaya and Mkhuze System

It is recommended that detailed water resources analysis and reconciliation studies are undertaken for the entire uPhongolo System to determine a current water balance. It is recommended that detailed water resources analysis study is undertaken for the Lake Sibaya System to determine the current lake water balance.

The areas within the UKDM area are supplied by various smaller WTPs which are unable to meet the current demands and it is recommended that larger regional schemes are implemented in the long term. The Shemula Water Master Plan Supply Area covers the northern-most area of the UKDM cutting across the Jozini and uMhlabuyalinga Local Municipalities. The Jozini Water Master Plan Supply Area is in the northern half of the UKDM, cutting across the southern parts of Jozini and uMhlabuyalinga LMs.

The UKDM mainly receives their funding from the Municipal Infrastructure Grant (MIG) and the Water Services Infrastructure Grant (WSIG). One regional bulk infrastructure project received funding from the Regional Bulk Infrastructure Grant and that is the Pongolapoort Bulk Water Scheme in Jozini.

The results of the assessment conducted for this scheme has indicated that the proposed Shemula Bulk Water Supply Project will have sufficient capacity to supply the ultimate future demand. As this project has been sub-divided into 6 Phases, it is recommended that the various phases be in-line with the growing demands for the supply areas within the scheme i.e. the scheme to be completed by 2030.

The Umkhanyakude District Water Services Master Plan of 2016 proposed the following infrastructure capacity and upgrade requirements for Western and Central Shemula (Ingwavuma to Phelandaba) and is summarized as follows:

- *The current water treatment works of 7.5 Mℓ/day has been upgraded to 27.5Mℓ/day and will therefore address the current demand. There is a shortfall of 5Mℓ/day for the projected 2035 demand.*
- *The water treatment works will also supply the demand from Shemula Eastern Region. This will increase the demand of 32.6Mℓ/day to 36.7Mℓ/day if the Eastern Region current supply sources are retained or 44Mℓ/day if the ground water sources are discontinued.*
- *The Greater Mseleni Bulk Water Supply Scheme: The proposed Greater Mseleni Water Supply Scheme would convert the existing standalone schemes into a single regional scheme. Depending on the funding of the recommended hydrological studies on Lake Sibayi it may be feasible to upgrade the lake abstraction to 4.78Mℓ/day. This would allow the scheme to operate at its full design capacity and will remove the need to construct the bulk line from Jozini Dam to Mseleni. The proposed scheme will upgrade the abstraction and treatment works (which are currently only operating at 69 % capacity as a result of abstraction problems).*

It is recommended that the Jozini Regional Bulk Water Supply Project be further assessed to ensure that there is adequate capacity to meet the future demands for each supply area.

It is also recommended that detailed water resources analysis and reconciliation studies are undertaken for the entire uKDM Systems to determine a current water balance.

REFERENCES

Department of Water Affairs. 2010. Water Supply and Drought Operating Rules for Stand-Alone Dams and Schemes Typical of Rural/Small Municipal Water Supply Schemes: Eastern Cluster. Prepared by BKS (Pty) Ltd. Department of Water Affairs: Pretoria.

Department of Water Affairs. 2013. Continuation of Reconciliation Strategies for All Towns (CRSAT) In The Eastern Region: Update of The Water Reconciliation Strategy of the White uMfolozi River System in Zululand District Municipality for The Period -2012 To 2040. Prepared by Tlou Consulting (Pty) Ltd in association with WR Nyabeze & Associates. Department of Water Affairs: Pretoria.

Mhlathuze Water. 2016. Umkhanyakude District Water Services Master Plan. Prepared by BIGEN AFRICA Services (Pty) Ltd. Mhlathuze Water: Richards Bay.

uMngeni-uThukela Water. 2019. Universal Access Plan Phase Iii – Progressive Development of a Regional Concept Secondary Bulk Water Master Plan for The Zululand District Municipality. Prepared by Mariswe (Pty) Ltd. uMngeni-uThukela Water: Pietermaritzburg.

uMngeni-uThukela Water. 2020. Universal Access Plan Phase iii – Progressive Development of a Regional Concept Secondary Bulk Water Master Plan for The Zululand District Municipality. Prepared by Mariswe (Pty) Ltd. uMngeni-uThukela Water: Pietermaritzburg.

Zululand District Municipality Water Services Development Plan, 2004

Zululand District Municipality IDP, 2016

Department of Water and Sanitation. 2015. An update on the water reconciliation strategy options for the Nongoma supply system Zululand District municipality

DWS, 2014. Update of the water reconciliation strategy of the White uMfolozi River System in Zululand District Municipality

DWS, 2013. White uMfolozi river catchment; Vryheid, Ulundi, Emondlo and Nondweni water supply scheme areas including *Klipfontein, Bloemveld, Grootgewacht & Mvunyana dams as well as the Ulundi balancing weir*.

DWA, 2013. The Greater Nongoma water supply scheme: Vokwana Dam and Vuna Dam decision support system

DWS, 2018. *Pongolapoort Dam Short-term Yield Curves Development*

UUW, 2019. UAP Phase III Umkhanyakude DM: Due Diligence Report

DWS, 2016. *Summary of water reconciliation strategy options for the schemes in the Umkhanyakude District Municipality*

Zululand District Municipality, 2004. *Zululand District Municipality Water Services Development Plan*

Lankford, Pringle, Dickens, *et al.* 2011 *Hydrological modelling of water allocation, ecosystem services and poverty alleviation in the Pongola floodplain, South Africa*

JC Smithers, RP Gray, S Johnson and D Still (2017). Modelling and water yield assessment of Lake Sibaya

<https://infrastructurenews.co.za>

R Meyer and L Godfrey, 2003. Report on the geohydrology around Lake Sibaya, Northern Zululand Coastal plain, KwaZulu-Natal

uMngeni-uThukela Water. 2019. Universal Access Plan Phase III – Progressive Development of a Regional concept Secondary Bulk Water Master Plan for the UMkhanyakude District Municipality. Prepared by Mariswe and JTN Consulting. uMngeni-uThukela Water: Pietermaritzburg.

uMngeni-uThukela Water. 2020. Universal Access Plan Phase III – Progressive Development of a Regional concept Secondary Bulk Water Master Plan for the UMkhanyakude District Municipality. Prepared by Mariswe. uMngeni-uThukela Water: Pietermaritzburg.

Mhlathuze Water. 2016. UMkhanyakude District Water Services Master Plan. Prepared by BIGEN AFRICA Services (Pty) Ltd. Mhlathuze Water: Richards Bay.

Zululand District Municipality Water Services Development Plan, 2004.

DWS. 2016. Development of Operating Rules for Water Supply and Drought Management for Stand-Alone Dams and Schemes: Eastern Cluster - Drought operating rules for Hluhluwe Dam

ACKNOWLEDGEMENTS

uMngeni-uThukela Water's comprehensive 2023 Infrastructure Master Plan has been updated and improved to produce this 2024 version. The concerted effort of the Planning Services Department as a whole in producing this document is acknowledged and appreciated. Specific contributions by the various team members deserves acknowledgement:

- Alka Ramnath (Planner) Project management, Section 2, Spatial information, Research and input to all volumes
- Graham Metcalf (Geohydrologist) Groundwater and Wastewater
- Gavin Subramanian (Planning Engineer) Infrastructure on the North Coast System
- Angus Nicoll (Planning Engineer) Infrastructure on the South Coast and uMngeni Central Systems
- Vernon Perumal (Planning Engineer) Infrastructure on the uMkhomazi, Upper uMzintlava, Upper uMzimkhulu and the uMhlathuze and Middle uThukela Systems and compiling the Energy Section
- Mark Scott (Planning Engineer) Infrastructure on the uMngeni Inland, uMfolozi, uMkhuze, uPhongolo and Lake Sibiya Systems
- Nathaniel Padayachee (Planning Engineer) Infrastructure on the Upper uThukela and Buffalo Systems
- Ntuthuko Ngcamu (Head – Water Demand Management Unit) with support from Siphokazi Mabaso, Mathews Nokhanga and Dillon Jacks Water Demand Management Section
- Sakhile Hlalukane (Hydrologist) Water resources of the North Coast, South Coast and Upper uThukela Systems
- Sandile Sithole (Hydrologist) Water resources of all systems excluding the North Coast, South Coast and Upper uThukela Systems
- Mlungisi Shabalala (Hydrologist) Water resources of the Middle uThukela, uMhlathuze, uMfolozi, uMkhuze, uPhongolo and Lake Sibiya Systems
- Sithembile Mbonambi (Planning Analyst) Water resources of the uMkhomazi, Upper uMzintlava and Upper uMzimkhulu Systems

The 2024 Infrastructure Master Plan was not completed by the abovementioned people without the valued assistance of numerous other persons and parties. Their contributions are gratefully acknowledged. These include uMngeni-uThukela Water and WSA Operations Staff, uMngeni-uThukela Water's Water and Environment Department (water quality) and uMngeni-uThukela Water's Process Services Department (process and treatment details for UUW plants and others).

Kevin Meier,
MANAGER: PLANNING SERVICES